

HTE# 17-5-419032

Harnett County Department of Public Health

24930

PERMIT # 29216

Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 283 Avery Pond Dr (Culpeper rd SW HWY)

Name: (owner) Wynn Construction Inc. SUBDIVISION Avery Pond LOT # 38

System Installer: Thorlons Plumbing Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% Reduction System IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

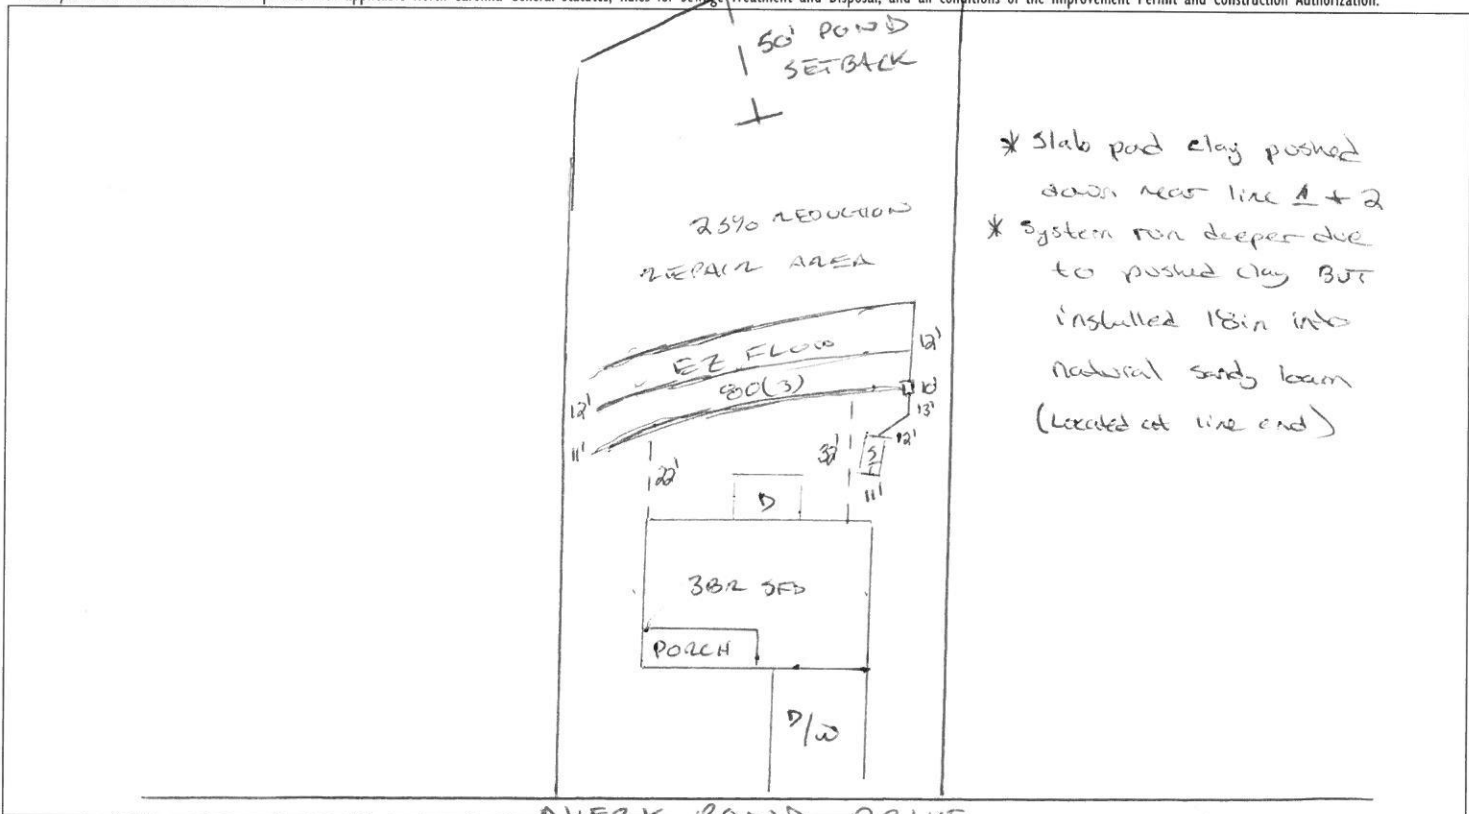

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW IIIg Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 80 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 03/23/2018

17-5-41903a

Avery Pond
Lot 38

