

HTE# 17-5-42434

Harnett County Department of Public Health

25296

PERMIT # 29766

Operation Permit

 New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 5098 NC 27 E.

Name: (owner) William & Lanice Puckett

SUBDIVISION

LOT #

System Installer: Cory Gilbert


Registration #

Basement with plumbing: Garage Number of Bedrooms 5Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: 25% reduction sys. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

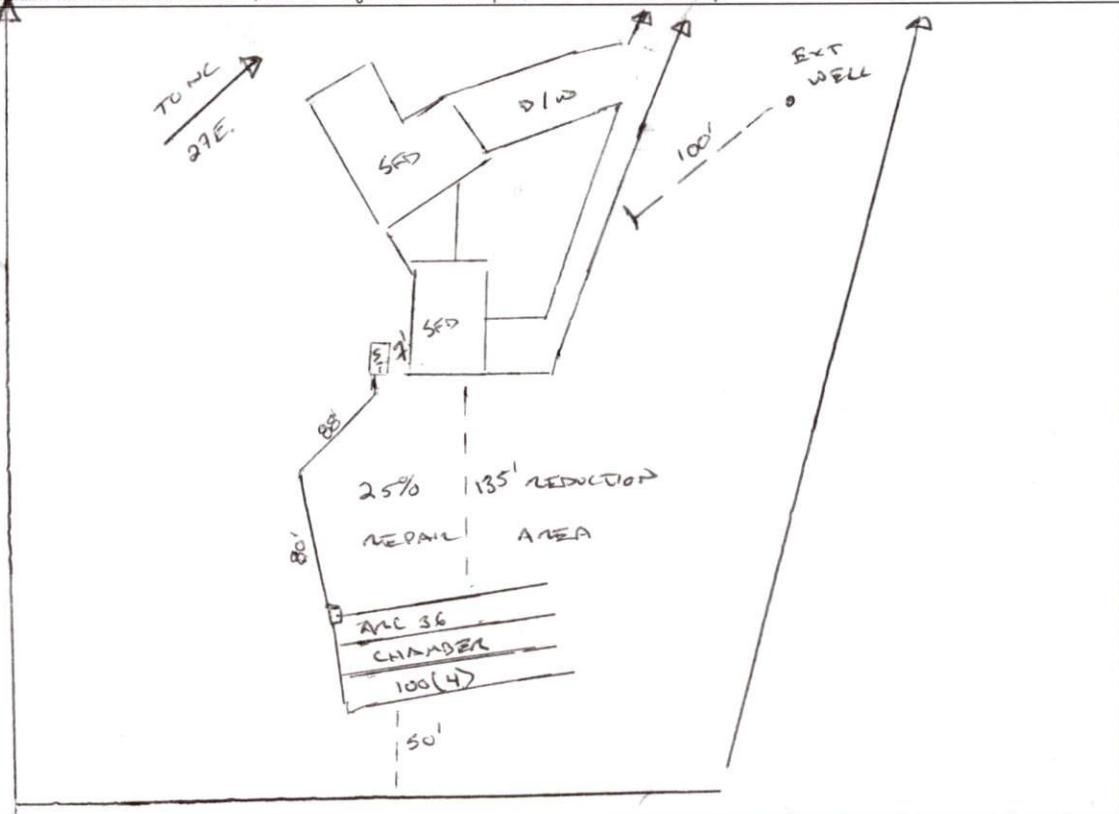

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

 D-Box Pump Alarm H2OLine PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other arc36 IIIg Septic Tank: 1250 gallons Pump Tank: _____ gallonsSubsurface No. of exact length width of ditches 4 feet 100 feet 3 feet depth of ditches 24-18 inchesDrainage Field ditches 4 feet 100 feet

French Drain Required: _____ Linear feet

Authorized State Agent

Date 01/02/2018