

HTE# 18-5-43274

Harnett County Department of Public Health

25274

PERMIT # 29900

Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 75 Southern Pl. (Clark Rd. SW 127)

Name: (owner) Lanco Custom Bldg, LLC SUBDIVISION Corrin Plantation LOT # 37

System Installer: Elvis Fajicloth Registration #


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% reduction sys. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

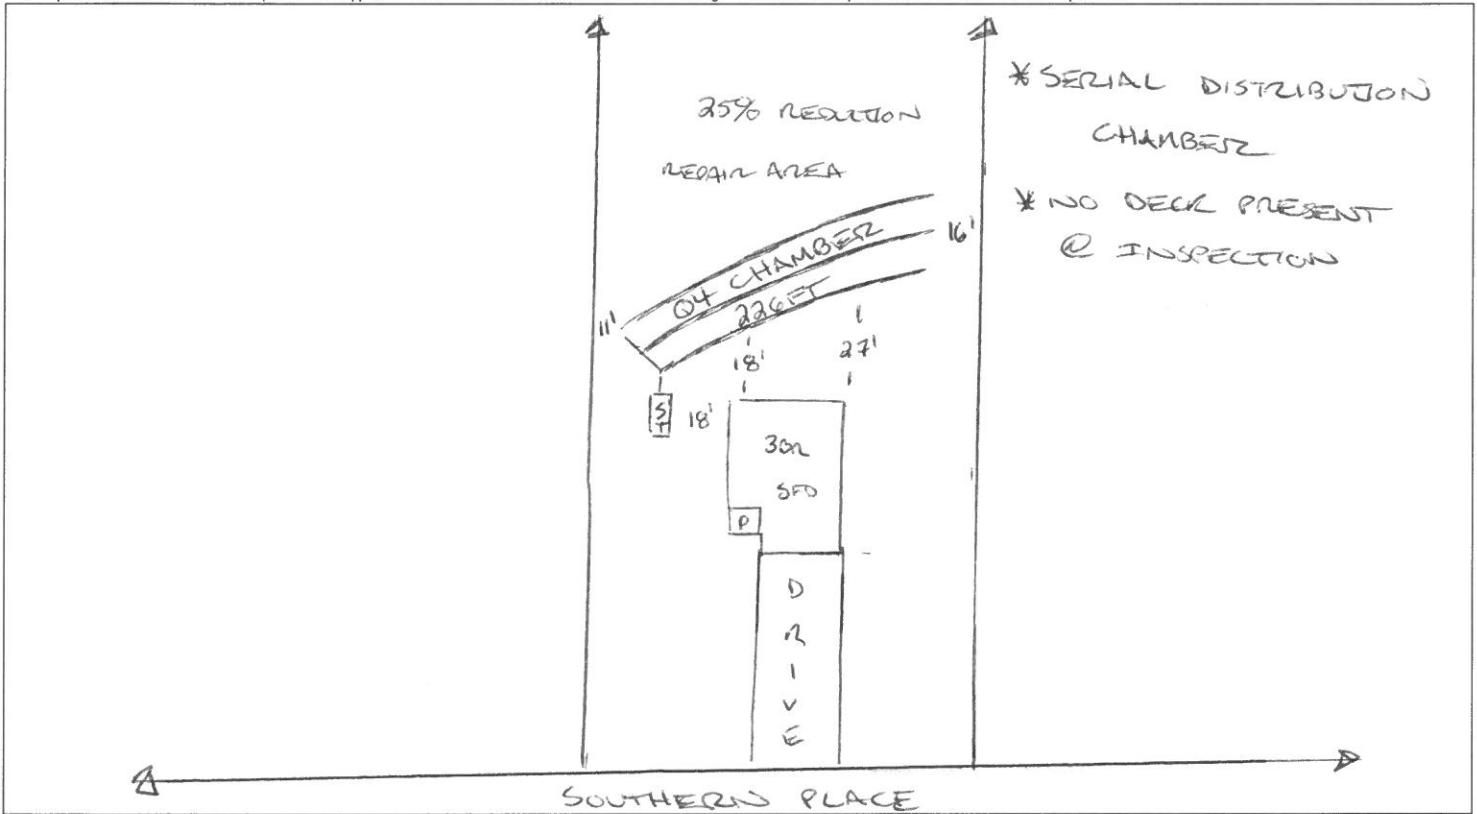

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Chamber IIIg Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field No. of ditches 1 exact length of each ditch 226 feet width of ditches 3 feet depth of ditches 24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 10/31/2018

18-5-43274

75 Southern Pl.

Corran Plantation Lot 37

