

HTE# 18-5-43775

Harnett County Department of Public Health

PERMIT # 30282

Operation Permit

25708

New Installation Septic Tank Nitrification Line Repair Expansion


Name: (owner) Precision Custom Homes PROPERTY LOCATION: 118 Beautiful Ln. (Milton Rd. Ch Rd.)
System Installer: GUSTOS SEPTIC SUBDIVISION: Summerlin LOT # 25

Basement with plumbing: Garage Number of Bedrooms 4 Registration # _____

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% nitrification sys. IIIb Types V and VI Systems expire in 5 years.
(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

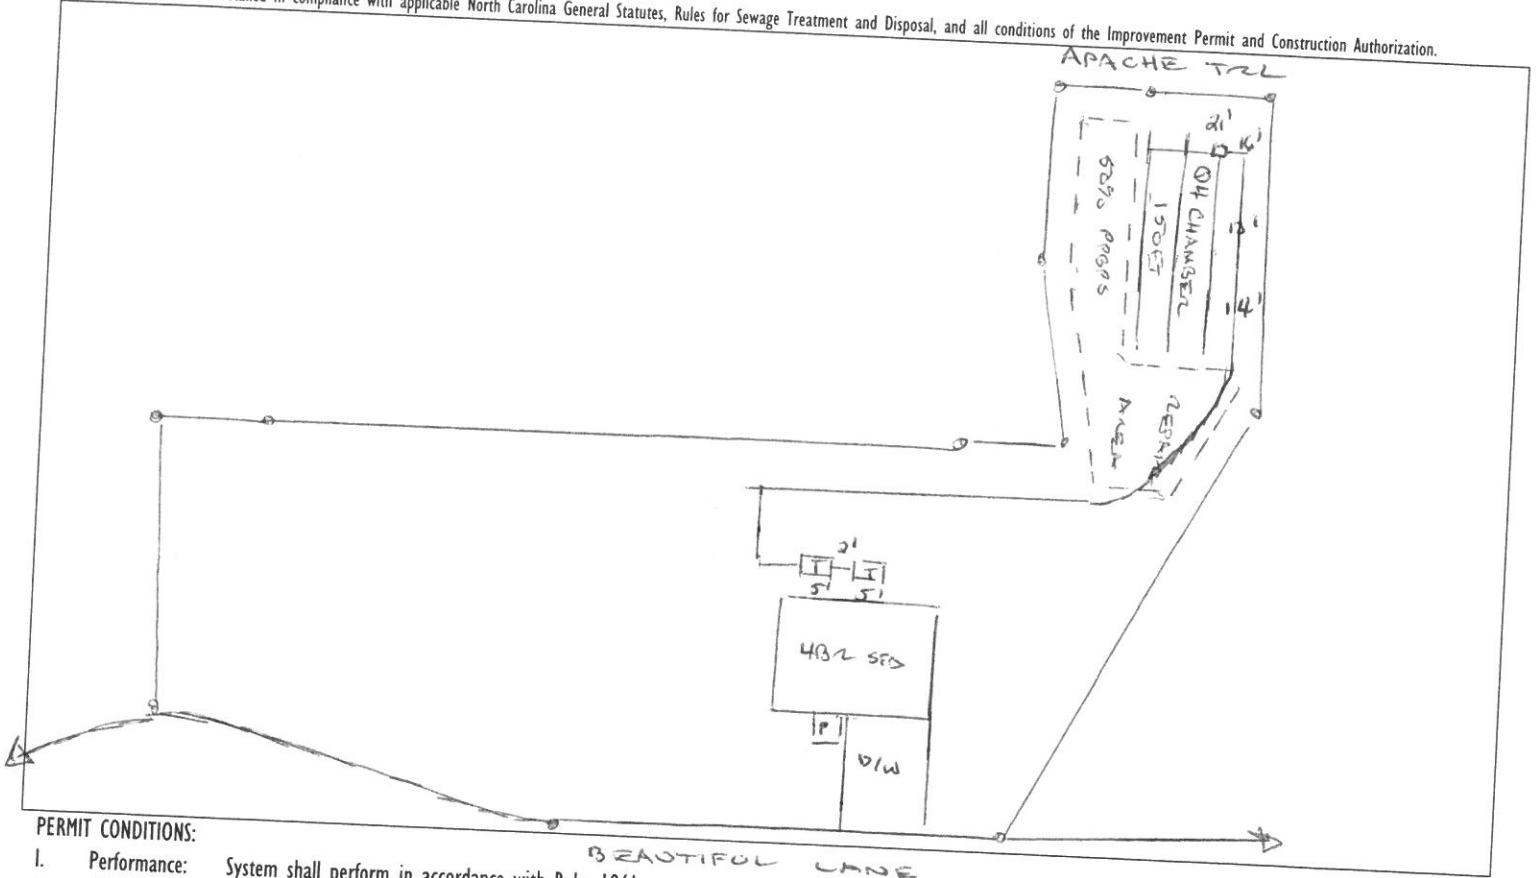

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 4 Chambers IIIb Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface Drainage Field: No. of ditches 1 exact length of each ditch 150 feet width of ditches 3 feet depth of ditches 24 inches
French Drain Required: _____ Linear feet

Authorized State Agent: [Signature]

Date 09/25/2019