HTE# 18-5-639712

## Harnett County Department of Public Health

**Improvement Permit** 

A building permit cannot be issued with only an Improvement Permit ISSUED TO: Lamco Custom Builders SUBDIVISION TINGEN POINTE EXPANSION Site Improvements required prior to Construction Authorization Issuance: Type of Structure: SEO (36 434) Proposed Wastewater System Type: Pump To Q590 REDUCTION STD. Projected Daily Flow: 360 Number of Occupants: S max Number of bedrooms: 3 Basement Yes Pump Required: XVes No ☐ May be required based on final location and elevations of facilities Type of Water Supply: 

Community Public Well Distance from well feet Permit valid for: Five years ☐ No expiration Permit conditions: Authorized State Agent:: The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.. Construction Authorization (Required for Building Permit) The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958. and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance ISSUED TO: LAMO CUSTUM BUILDERS PROPERTY LOCATION: JUNG DR.
SUBDIVISION TINGEN POINTE LOT # 158 SUBDIVISION 1106EN TO 127E LOI #

Facility Type: SFO (50 234) New Expansion Repair

Basement? Yes No Basement Fixtures? Yes No

Type of Wastewater System\*\* Prope to 25% Reduction System (Initial) Wastewater Flow: 360 GPD (See note below, if applicable 


) Pump To 25% ROD. Sys. (Repair) Installation Requirements/Conditions Exact length of each trench 230 feet Trench Spacing: 9 Feet on Center Septic Tank Size 1000 gallons Pump Tank Size 1000 gallons Soil Cover: Trenches shall be installed on contour at a Maximum Trench Depth of: (Maximum soil cover shall not exceed (Trench bottoms shall be level to +/-1/4" MPX 36" above the trench bottom) in all directions) Pump Requirements: \_\_\_\_\_ft. TDH vs. \_\_\_\_ inches below pipe Aggregate Depth: \_\_\_\_\_ inches above pipe Conditions: inches total WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA. \*\*If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit. Owner/Legal Representative Signature: This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. Authorized State Agent: Construction Authorization Expiration Date: (2)23

## Harnett County Department of Public Health Site Sketch

Authorized State Agent:

PROPERTY LOCATON: JUNO Da.

PROPE

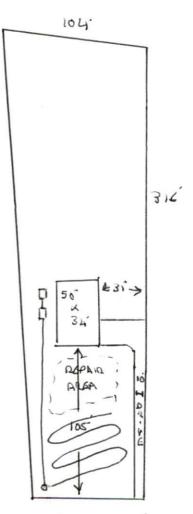

JUNO DENVE