

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: _____
 Address: *BCD SFP*
 Proposed Facility: _____ Design Flow (.1949): *3000*
 Location of Site: _____
 Water Supply: Public Individual Well
 Evaluation Method: Auger Boring Pit
 Type of Wastewater: Sewage Industrial Process

Applicant: *P2667*
 Date Evaluated: *4-10-08*
 Property Size: _____
 Property Recorded: _____
 Spring Other
 Cut
 Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Saprot Class	.1944 Restr Horiz	
1	L 4%	0-30	SL	FR GRNSNP					.4
		30-48	SCL	FR GRNSNP					
2	L 6%	0-28	SL	FR GRNSNP					.5
		28-48	SCL	FR GRNSNP	42" 2.5% 42"				
3	L 6%	0-25	SL	FR GRNSNP					.3
		25-48	SCL	FR GRNSNP	36" 2.5% 36"				

Description	Initial System	Repair System
Available Space (.1945)	/	/
System Type(s)	<i>25"</i>	<i>25"</i>
Site LTAR	<i>.6</i>	<i>.6</i>

Other Factors (.1946): _____
 Site Classification (.1948): *RS*
 Evaluated By: *[Signature]*
 Others Present: _____

COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	FI-FIRM	S-STICKY
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE	IV	CL-CLAY LOAM	0.4 - 0.1	VFI-VERY FIRM	VS-VERY STICKY
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SIC-SILTY CLAY		EFI-EXTREMELY FIRM	NP-NON-PLASTIC
FP-FLOOD PLAN		C-CLAY			SP-SLIGHTLY STICKY
		SC-SANDY CLAY			P-PLASTIC
					VP-VERY PLASTIC


STRUCTURE

- SG-SINGLE GRAIN
- M-MASSIVE
- CR-CRUMB
- GR-GRANULAR
- SBK-SUBANGULAR BLOCKY
- ABK-ANGULAR BLOCKY
- PL-PLATY
- PR-PRISMATIC

MINERALOGY

- SLIGHTLY EXPANSIVE
- EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

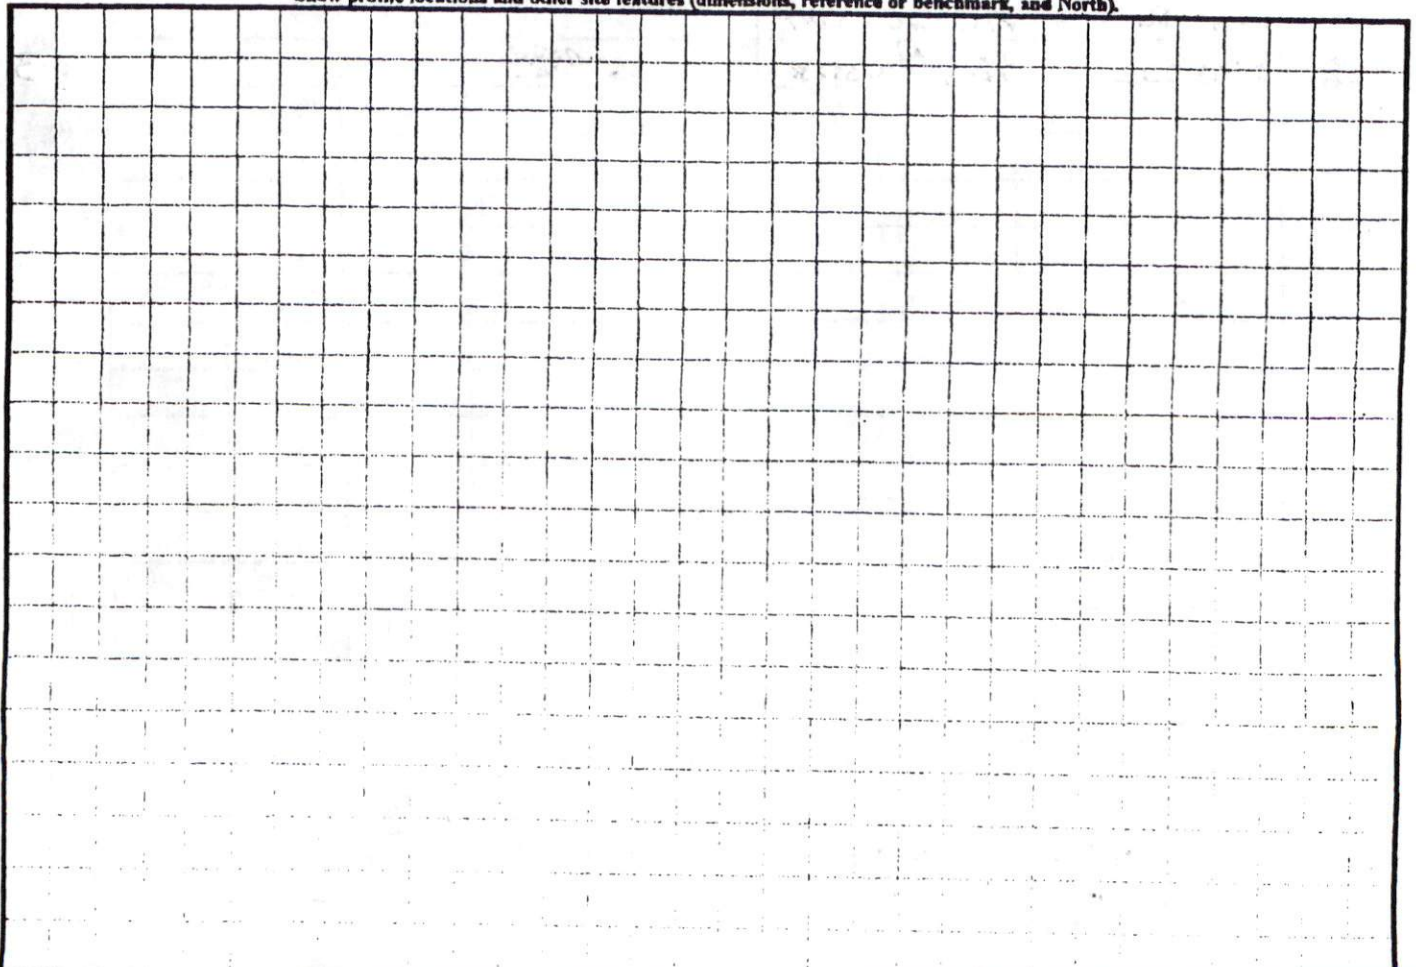

SITE PLAN APPROVAL


DISTRICT RA-30 USE 36X16 In Ground Pool
#BEDROOMS 2

Date 3-17-08 V.C. [Signature]
Zoning Administrator

SFD
OHPL (R/W UNKNOWN)

JANE H. D.B.10
P.P.

N 05°04'10"E 280.1'

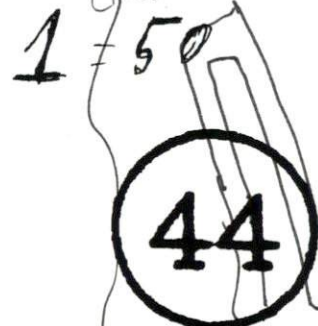

AREA =
43,009 SQ. FT.

N 05°38'59"E 280.01'

20' DRIVEWAY WALL

192.25'

125'

133'

280.00'

In ground pool

36X16

66'

Existing SFD

DRIVEWAY

DRAINAGE ESSENTIALS
(WIDTH VARIES)

108'

S 05°03'33"W

47

46

152.19'

195.13'

10'

10' TEMP. CO
N 84°56'2"

WWS DRIVE (50' PUBLIC R/W)

N 84°56'27"W 923.98'

44'