

HTE# 07-5-17033R

Harnett County Department of Public Health 19661

PERMIT # 24058

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: Hwy 401

Name: (owner) JARRELL COMPANY LLC SUBDIVISION _____ LOT # _____

System Installer: LARRY SHARPE Registration # _____

Basement with plumbing: Garage Number of Bedrooms 15000sq ft 6-10 W ROOM & WAREHOUSE


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

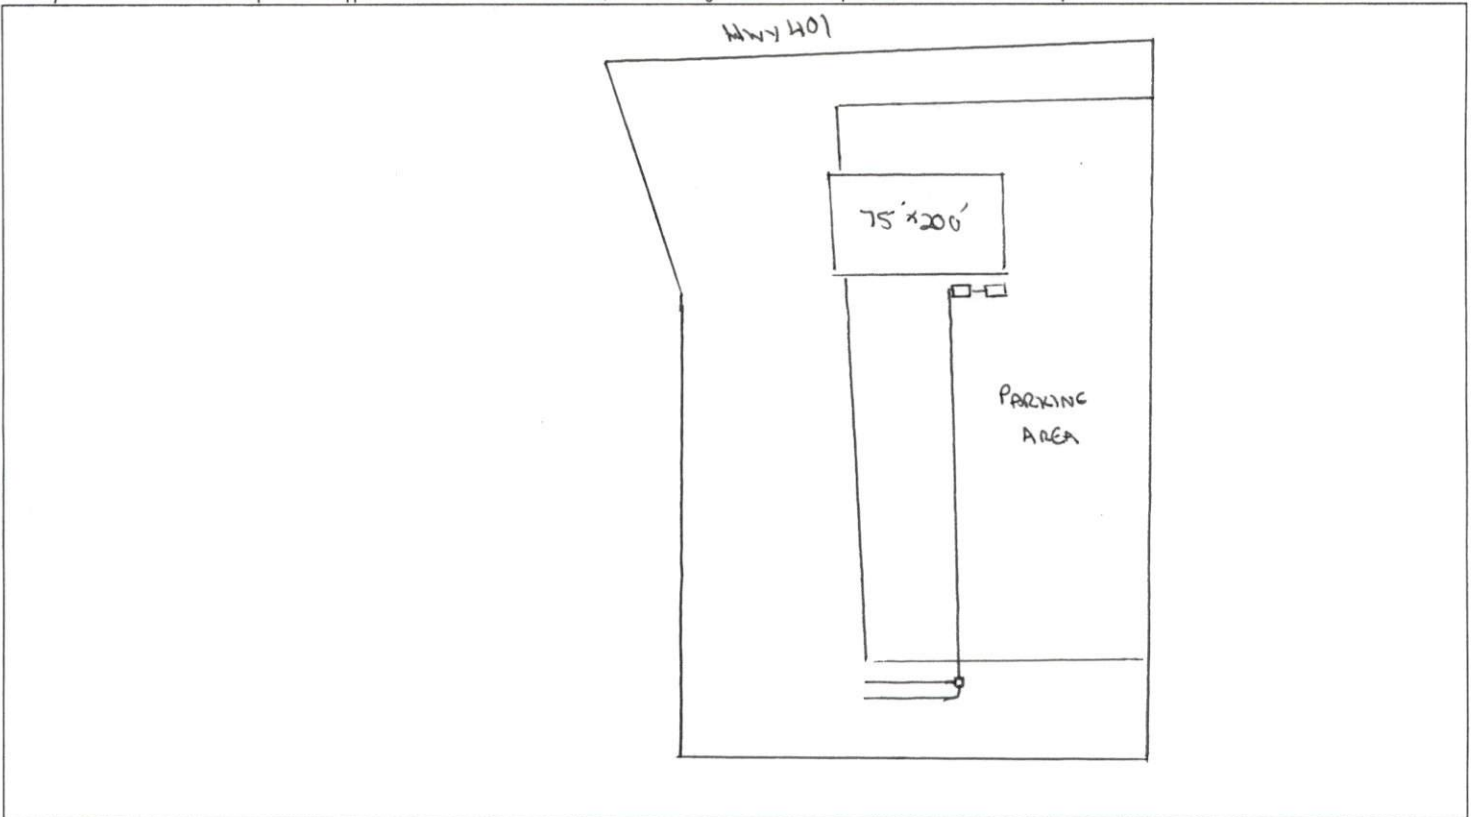

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: SUPPLY LINE 30" DEEP.

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other TIRE CHAINS Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 2 of each ditch 50 feet ditches 3 feet ditches 30 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 1/11/08