

HTE# 16-5-391818

Harnett County Department of Public Health

24986

PERMIT # 29125

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 252 Jarco Drive (US 401 N.)

Name: (owner) Casino Party Aces SUBDIVISION Tri South Industrial Park LOT # 5

System Installer: Clinton Road Septic Registration # _____

Basement with plumbing: Garage Number of Bedrooms NA Warehouse w/ 4 Employees


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% Reduction Sys. 11g Types V and VI Systems expire in 5 years. 100GPD MAX

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

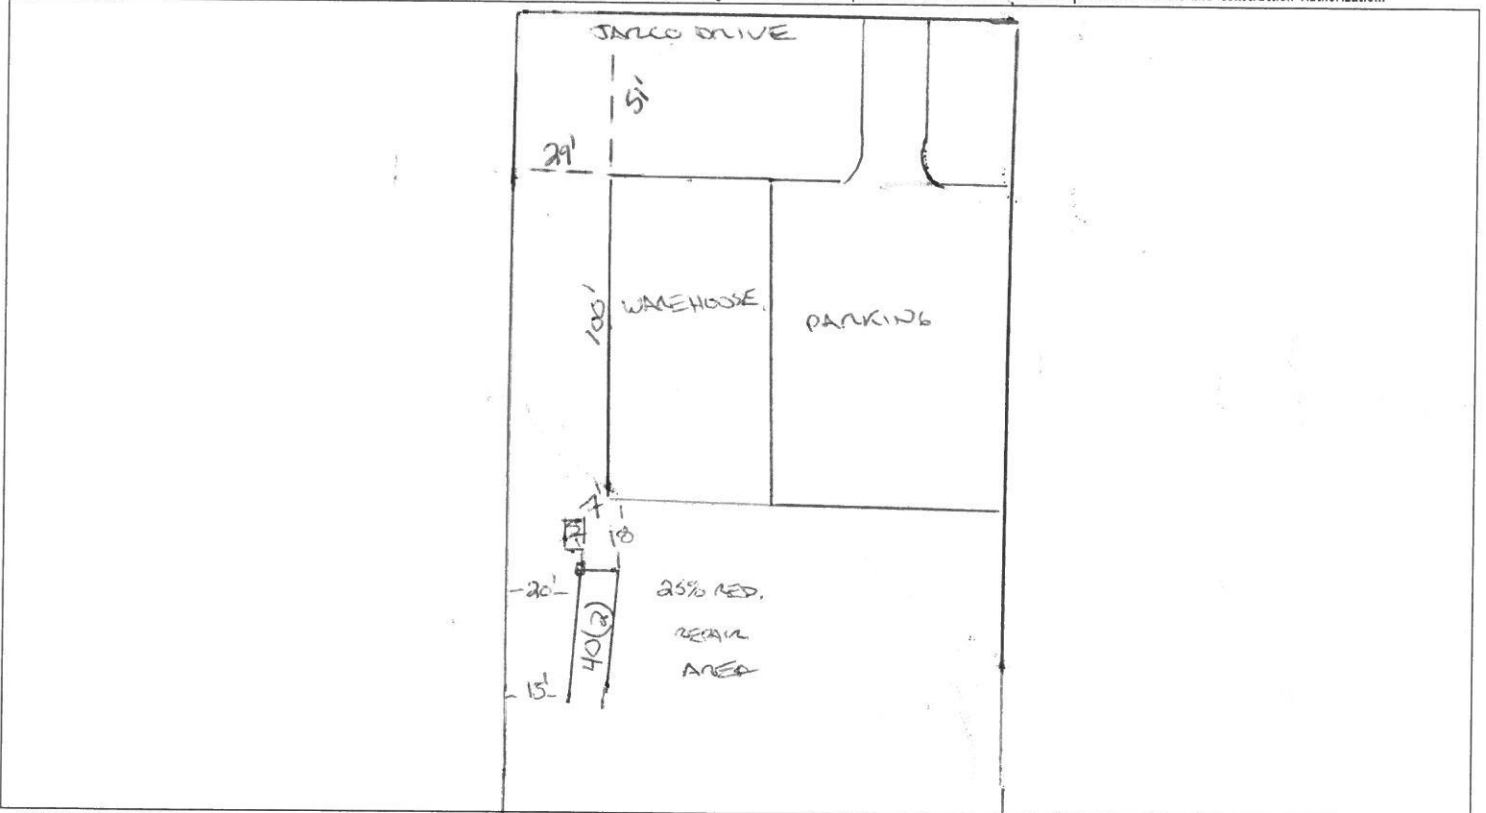

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 04 Chamber 11g Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 2 exact length of each ditch 40 feet width of ditches 3 feet depth of ditches 22 inches

French Drain Required: _____ Linear feet

Authorized State Agent

Date

06/20/2008