

HTE# REPAIR

Harlow County Department of Public Health

24004

PERMIT # 28770

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 1560 GEORGE PERRY LEE RD

Name: (owner) PJ's Truck Boogie's Equip SUBDIVISION _____ LOT # _____

System Installer: KENNETH WEEKS Registration # _____


Basement with plumbing: Garage Number of Bedrooms 400 gpd

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III b Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

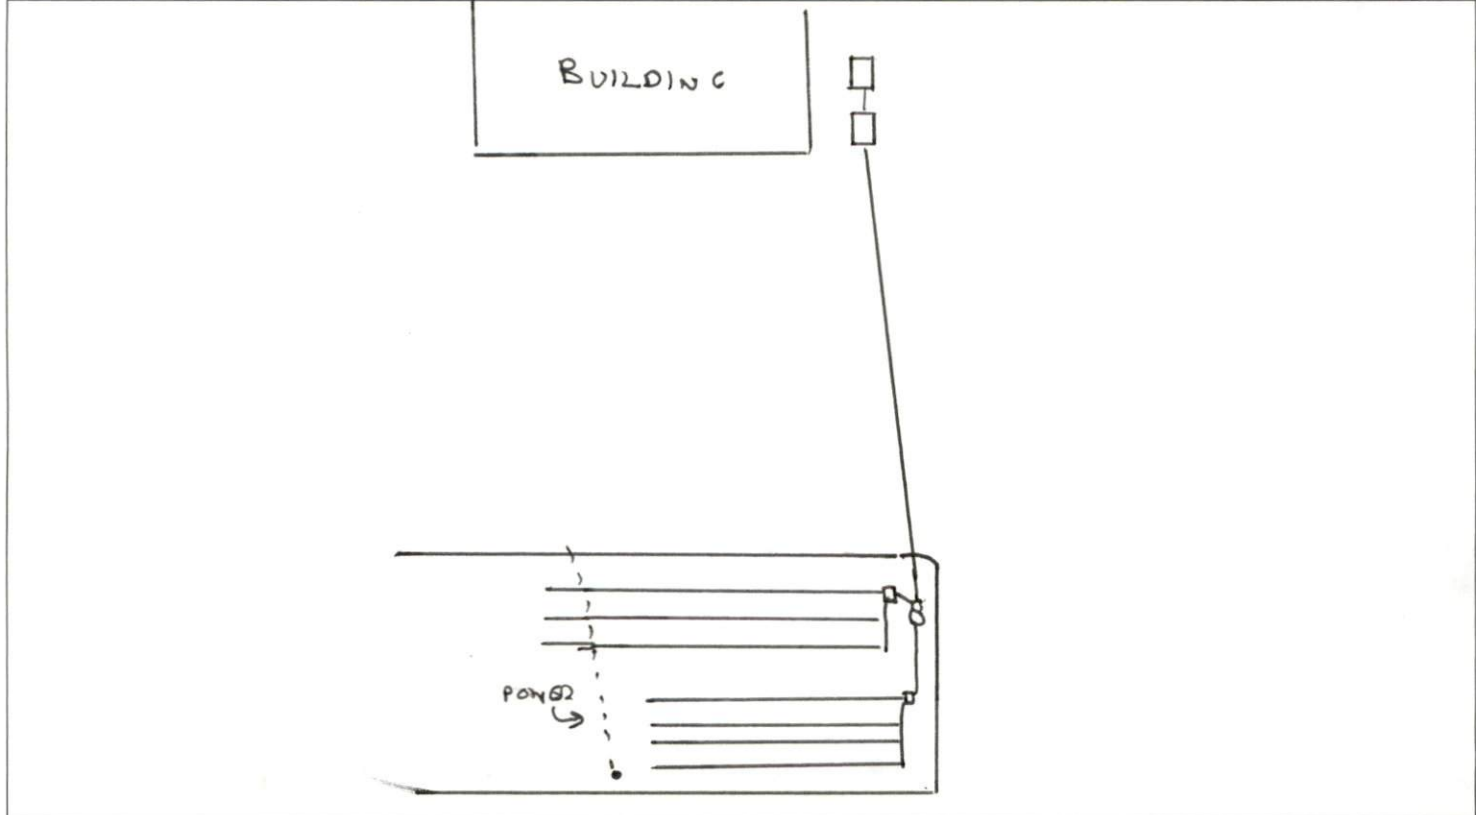

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.
 IV. Operation: TIME POSE PANEL INSTALLED - RUN 4 MIN ; REST 2 HOURS
CC 22 AL 21 3:15 PM 4/25/16

V. Other: 3 ZONE VALVE INSTALLED - ONCE TO OLD SYSTEM, TWICE TO NEW SYSTEM

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW Septic Tank: _____ gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 4 of each ditch 60 feet ditches 3 feet ditches 19-20 inches
 French Drain Required: _____ Linear feet

Authorized State Agent

REGINS

Date 4/25/16