

№ 16879

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Ballard Custom Builders

☐ New Installation☒ Septic Tank

Property Location: SR# 1810 STEWART 121

Repairs

☒ Nitrification Line

Subdivision Foundations Bible College Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 4 Lot Size: 1 acre

Basement with Plumbing: ☐ Garage: ☐

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: _____ ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ☒ Conventional ☐ Other _____

Size of tank: Septic Tank: 1700 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18-20 ^{max} in.


French Drain Required: — Linear feet

This permit is subject to revocation if site plans or intended use change.

Date: 10-2-28-01

Signed: James E. Maxwell ^{III} U.S.

Environmental Health Specialist

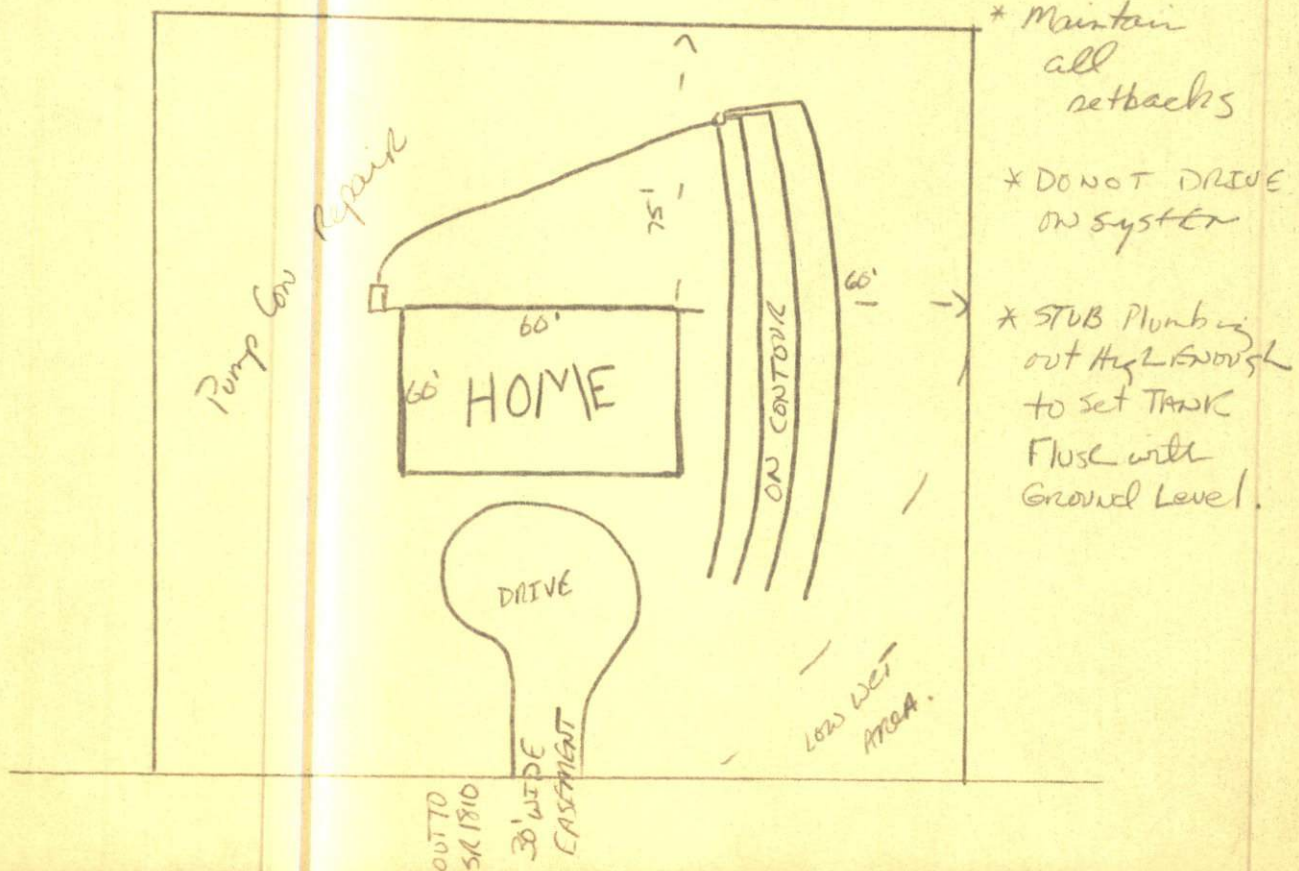

01-011690

HARNETT COUNTY HEALTH DEPARTMENT AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 16879. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Foundations Bible College

Name: Ballard Custom Homes Telephone # 919-207-0854

Address: 30 Perkins View Ln Donn N.C. 28334

Property Location: SR # 1810 Road Name Stewart Rd

New Installation ☒ Repair ☐ Septic Tank ☒ Nitrification Lines ☒

Subdivision Foundations Bible College Lot # -

Number of Bedrooms Proposed: 4 Lot size: 1 acre

Basement ☐ With Plumbing ☐ Without Plumbing ☐

Water Supply: Well ☒ Public ☒ Minimum Well Setback: 50' ft.

Type of System: Conventional ☒ Other ☐

Tank Volume: Septic Tank 1700 gallons Pump Chamber ☐ gallons

Nitrification Field Specifications

Number of fields 2 Number of Lines per Field 4 Length of lines 100

Width of ditches 3 ft. Depth of ditches 18-20 inches

French Drain: Linear feet required - Depth of gravel -

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: James E. Moulton Date: 2-28-01