

1-5-2587

HARNETT COUNTY HEALTH DEPARTMENT

No 18017

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Boyd Byrd New Installation Septic Tank
Property Location: SR# 421 Repairs Nitrification Line

Subdivision Myrtlewood Lot # 27

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: .68 Ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Polystyrene Aggregate Trench System I WWS-95-32

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 150 ft. width of ditches 3 ft. depth of ditches 24 in.

French Drain Required: _____ Linear feet

Date: 8/20/2001

This permit is subject to revocation if site plans or intended use change.


Signed: Bryan McSwain R.S.
Environmental Health Specialist

* Maintain all setbacks

* Ditches on contour

at 24 inches +

NO DEEPER

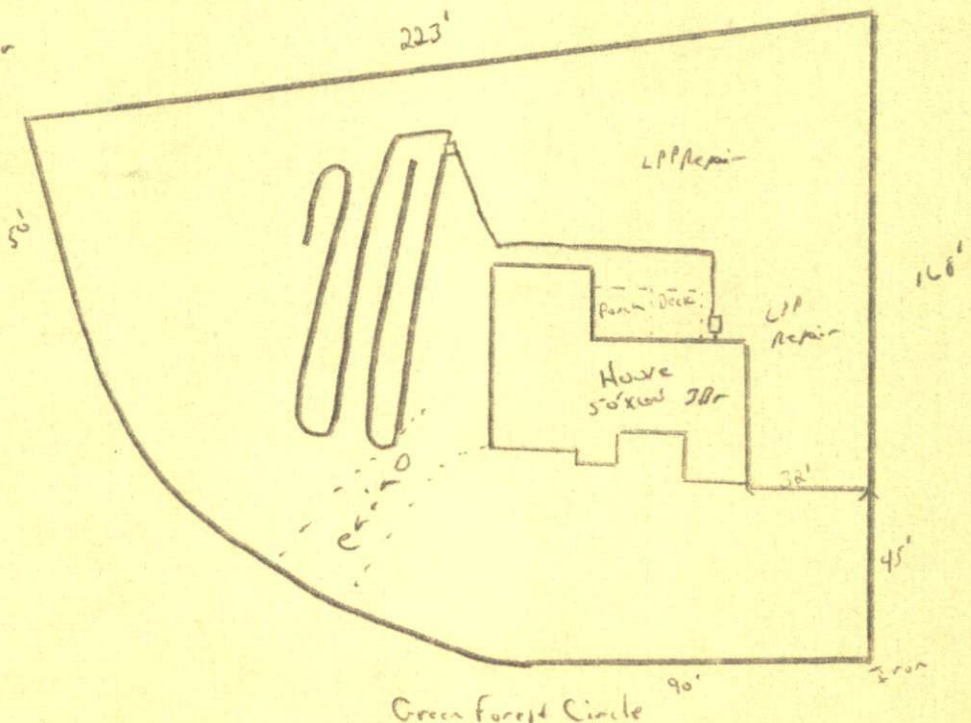

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 18017. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent _____

Name: Boyd Byrd Telephone # 814-8500

Address: P.O. Box 2337 Dunn, N.C. 28325

Property Location: SR # 421 Road Name _____

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision Myrtlewood Lot # 27

Number of Bedrooms Proposed: 3 Lot size: .684c

Basement With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public Minimum Well Setback: 50 ft.

Type of System: Conventional _____ Other Polystyrene Aggregate Trench System FWW-9532

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 2 Length of lines 150ft.

Width of ditches 3 ft. Depth of ditches 24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Debra McLean P.S. Date: 8/20/2001