

01-5-3111

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) WELCO CONTRACTORS INC New Installation Septic Tank
Property Location: SR# 1176 SANDALWOOD DR Repairs Nitrification Line

Subdivision HIDDEN LAKES Lot # 80/81

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 4 Lot Size: 2.15 AC

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 100 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 2 exact length of each ditch 80 ft. width of ditches 3 ft. depth of ditches 18-24 in.

French Drain Required: _____ Linear feet


Date: 10/8/01

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]
Environmental Health Specialist

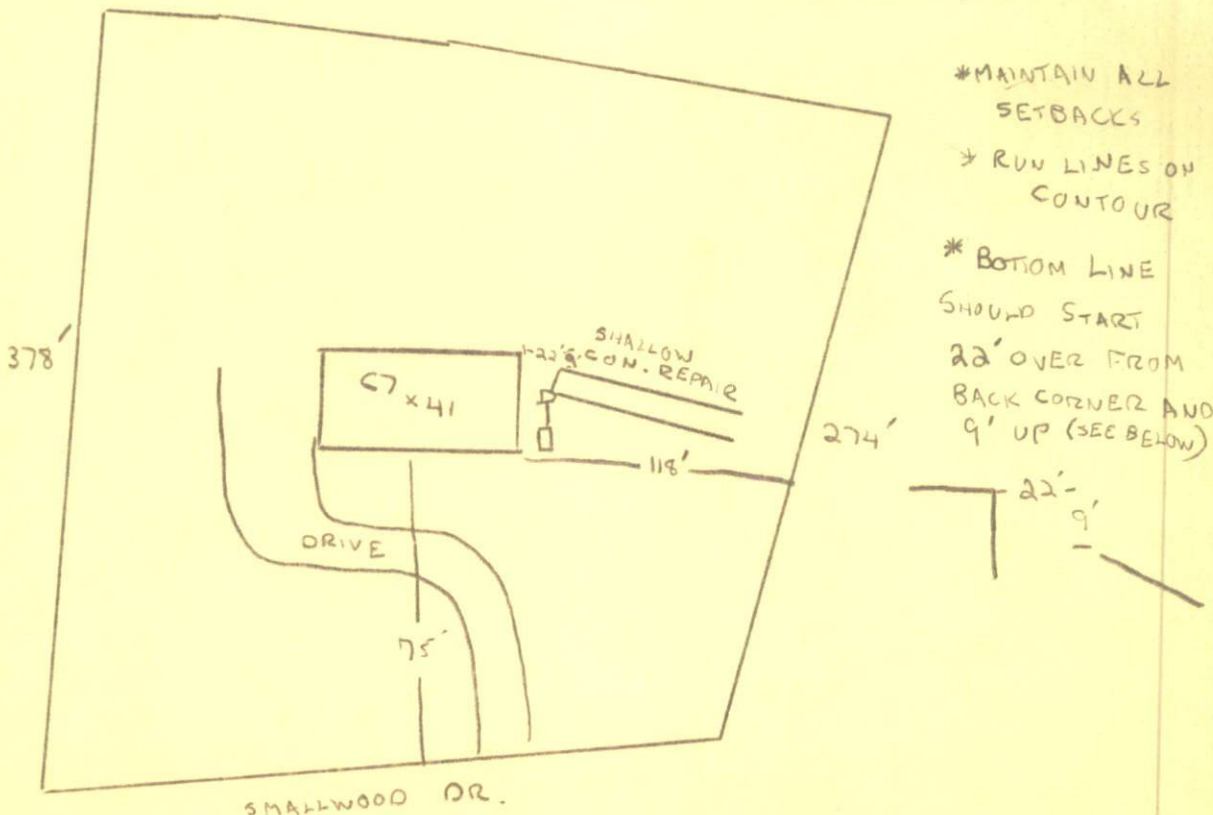

* MAINTAIN ALL SETBACKS
 * RUN LINES ON CONTOUR
 * BOTTOM LINE SHOULD START 22' OVER FROM BACK CORNER AND 9' UP (SEE BELOW)

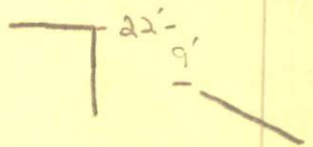

SANDALWOOD DR.

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 18653. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent WELLED CONTRACTORS INC

Name: _____ Telephone # 910-236-3131

Address: PO Box 766 SPRING LAKE 28390

Property Location: SR # 1176 Road Name SANDALWOOD DR

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision HIDDEN LAKES Lot # 80/81

Number of Bedrooms Proposed: 4 Lot size: 2.15 AC

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public Minimum Well Setback: 100 ft.

Type of System: Conventional Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 2 Length of lines 80'

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 10/8/01