

02-5-4217

HARNETT COUNTY HEALTH DEPARTMENT

No 19114

# IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) WILSHAR LLC  New Installation  Septic Tank  
Property Location: SR# HWY 401  Repairs  Nitrification Line

Subdivision WOODVIEW Lot # 17

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 Lot Size: 1.31 ac

Basement with Plumbing:  Garage:

Water Supply:  Well  Public  Community

Distance From Well: 100 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other POLYSTYRENE AGGREGATE TRENCH

Size of tank: Septic Tank: 1000 gallons Pump Tank: SEE BELOW gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 90 ft. width of ditches 3 ft. depth of ditches 12 in.

French Drain Required: \_\_\_\_\_ Linear feet


Date: 4/8/02

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]

250' Environmental Health Specialist

- \* MAINTAIN ALL SETBACKS
- \* RUN LINES ON CONTOUR
- \* 6" OF COVER NEEDED OVER ENTIRE FIELD
- \* SEPTIC TANK WILL SIT ABOVE GRADE. A PUMP TANK MAY BE USED IF TANK IS SET LOW.
- \* MEET ON SITE PRIOR TO INSTALLATION

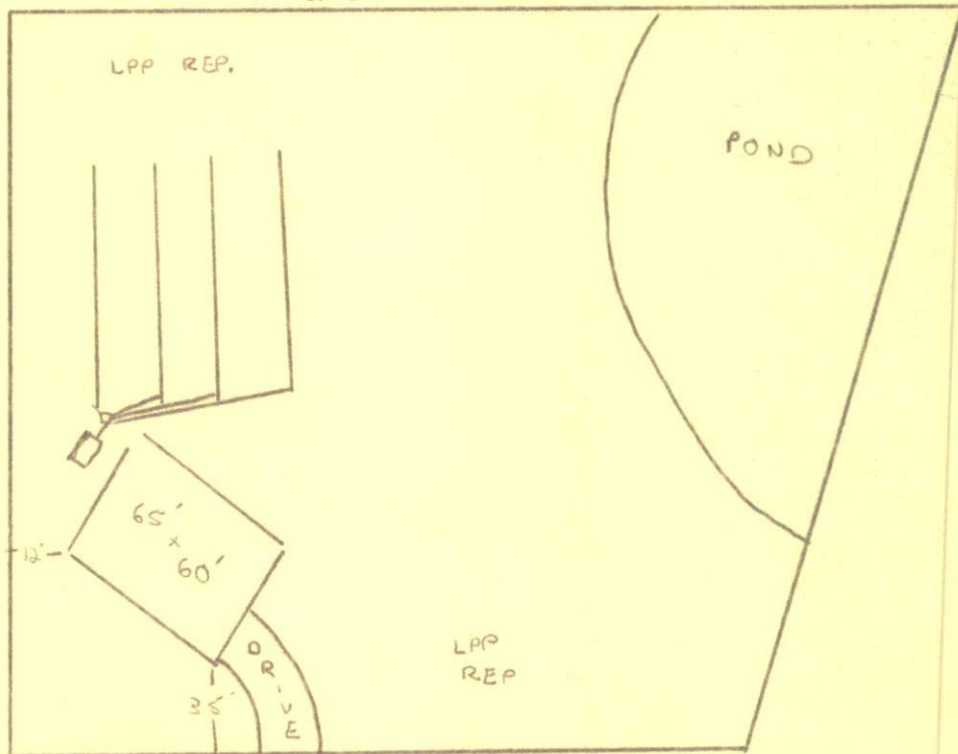

WOODVIEW CT

HARNETT COUNTY HEALTH DEPARTMENT  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19114. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

WILSHAR LLC 919-215-9861  
Name Telephone #  
184 JANSY ANGLER NC 27501  
Address  
US401  
Property Location SR# Road Name  
WOODVIEW 17 3 1.31 AC  
Subdivision Lot # # Bedrooms Proposed Lot size

TYPE OF SYSTEM

New Installation  Repair  Septic Tank  Nitrification Lines

Conventional Other POLYSTYRENE AGGREGATE TRENCH

Basement  With Plumbing  Without Plumbing

Water Supply:  Well  Public - Minimum Well Setback: 100 Ft.

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 90 Ft.

Width of ditches 3 ft. Depth of ditches 12 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature] 4/8/02  
Signature of Authorized Agent for Harnett County Date