


SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

FACTORS		PROFILES													
		1	2	3	4	5	6	7	8	9	10				
LANDSCAPE POSITION	.1940														
SLOPE (%)	.1940														
HORIZON 1 DEPTH		0-18	0-16	0-18	0-20										
TEXTURE GROUP	.1941(A)(1)	LS	LS	LS	LS										
CONSISTENCE	.1941	VF	VF	VF	VF										
STRUCTURE	.1941(A)(2)	C	C	C	G										
MINERALOGY	.1941(A)(3)	NCV	NCV	NCV	NCV										
HORIZON 2 DEPTH		8-20	16-20	18-26	20-34										
TEXTURE GROUP	.1941(A)(1)	SCI	SCI	SCI	SCI										
CONSISTENCE	.1941	F	F	F	F										
STRUCTURE	.1941(A)(2)	Sb	Sb	Sb	Sb										
MINERALOGY	.1941(A)(3)	Sd	Sd	Sd	Sd										
HORIZON 3 DEPTH		20+	20+												
TEXTURE GROUP	.1941(A)(1)	pm	pm												
CONSISTENCE	.1941														
STRUCTURE	.1941(A)(2)														
MINERALOGY	.1941(A)(3)														
HORIZON 4 DEPTH															
TEXTURE GROUP	.1941(A)(1)														
CONSISTENCE	.1941														
STRUCTURE	.1941(A)(2)														
MINERALOGY	.1941(A)(3)														
SOIL WETNESS	.1942	20"	20"		27"										
RESTRICTIVE HORIZON	.1944														
SAPROLITE	.1943/1956														
CLASSIFICATION	.1948	RS	RS	RS	RS										
LONG TERM ACCEPTANCE RANGE	.1955	4	3	3	2										

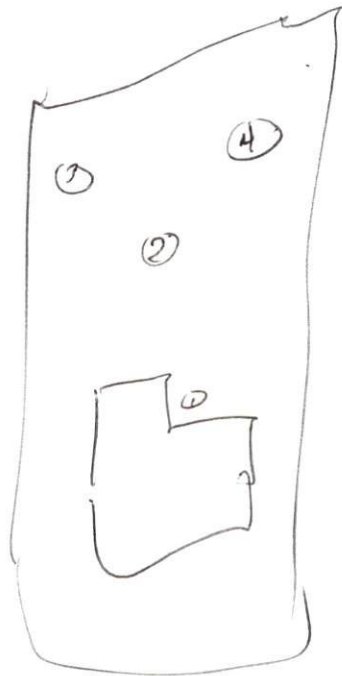

JENNING RD."

S 56°59'59"E
115.00'

7

N 21°44'36"E 394.97'



PROPOSED HOUSE LOCATION

DWAY

S 20°55'49"W 422.24'

Start at 20' front of corner
pump, 5x110

9

ditcher will be greater than 9' on corner

A leave flag meet outside

Pump alternate rear 1.08 AC.

8

200'

Required Property Line Setbacks

	Minimum	Actual
Front	5'	94'
Side	10'	111'
Corner	—	—
Rear	25'	200'
Nearest Building	10'	—

N 45°53'39"W 128.75'

DISTRICT RA30 USE SFD
BEDROOMS 4

5-24-02 Donna Johnson