

IMPROVEMENT PERMIT

03-5-6664 Rev.

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) JK Brown Bldg Inc New Installation Septic Tank
Property Location: SR# 2045 Repairs Nitrification Line

Subdivision TURAWOOD Lot # 4

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (64x33) Lot Size: .46 AC

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of 3 exact length 80 width of 3 depth of 18 1/2 in.
ditches of each ditch ft. ditches ft. ditches in.


French Drain Required: _____ Linear feet

Date: 03-18-03

This permit is subject to revocation if site plans or intended use change.

Signed: Joe Waters
Environmental Health Specialist

148

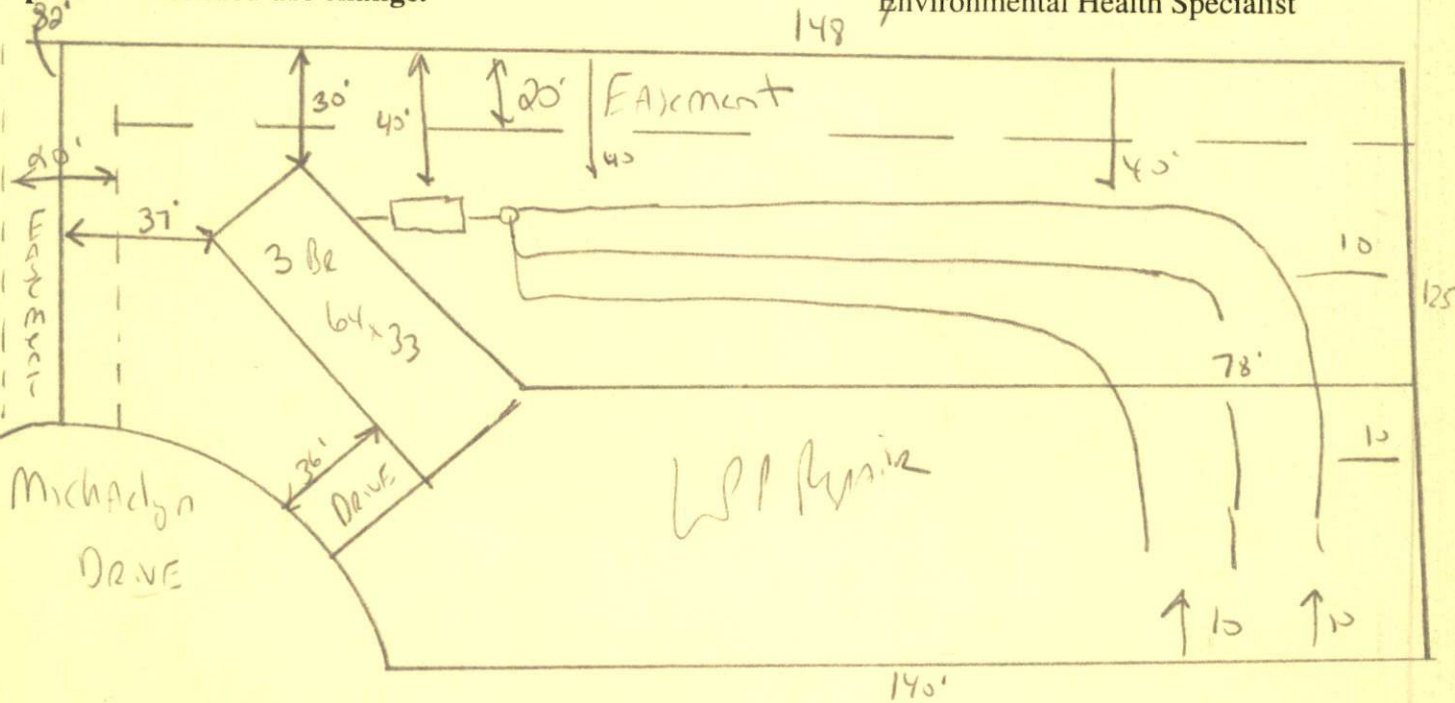

Maintain all set backs Do not Drive or park on Septic System keep system 40' from Property line with easement MAY INSTALL A 2x120 or 1x240.

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19275. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

JL Brown Bldg Inc
Name

852-4423
Telephone#

Address

2045

Property Location SR#

Turnwood

Road Name

Subdivision

4

Lot #

3 (64x30)

Bedrooms Proposed

46 AC

Lot Size

TYPE OF SYSTEM

New Installation Repair

Septic Tank

Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 3 Length of lines 80 Ft.

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature]

Signature of Authorized Agent for Harnett County of Harnett

03-18-03

Date