

IMPROVEMENT PERMIT

03-5-6760

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Wm. Kent Pierce New Installation Septic Tank
 Property Location: SR# 1115 Repairs Nitrification Line

Subdivision Peach Tree Lot # 128

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (50x35) Lot Size: 462 AC

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to Conventional


Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 75 ft. width of ditches 3 ft. depth of ditches 18-24 in.

French Drain Required: _____ Linear feet

Date: 4-3-03
 Signed: [Signature]
 Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

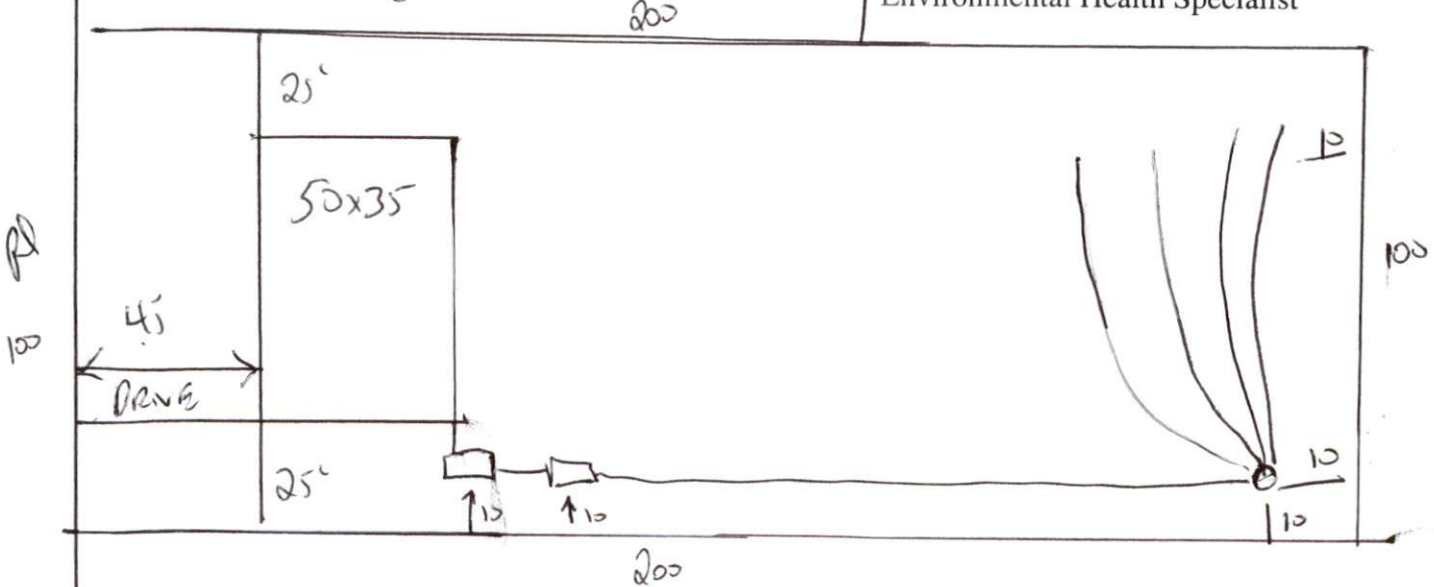

MAY NOT Require Pump - STUB out Plumbing high as Possible
 Meet on site Before stubbing Plumbing out to determine if
 Pump is needed MAINTAIN ALL SETBACKS Do not Drive or park
 ON septic system

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19230. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Kent Pierce 424-1294
Name Telephone#

Address

1115
Property Location SR# Road Name

Peach Tree 128 3 (35x50) 0.46Ac
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines
 Conventional Other Pump to Sewer
 Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: 50 Ft.
Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 75 Ft.
Width of ditches 3 ft. Depth of ditches 18.24 inches
French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature] 4-3-07
Signature of Authorized Agent for Harnett County of Harnett Date