

IMPROVEMENT PERMIT

03-5 6971

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Bass Built Homes Inc

New Installation Septic Tank

Property Location: SR# NC87

Repairs Nitrification Line

Subdivision Forest Ridge Lot # 5

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (58x71) Lot Size: 160x275x160x275

Basement with Plumbing: Garage: NOTICE CHANGE IN HOUSE

Water Supply: Well Public Community location

Distance From Well: _____ ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to Convent

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 3 exact length 135 width of ditches 3 depth of ditches 18 in.


French Drain Required: _____ Linear feet

Date: 05-02-03

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]

Environmental Health Specialist

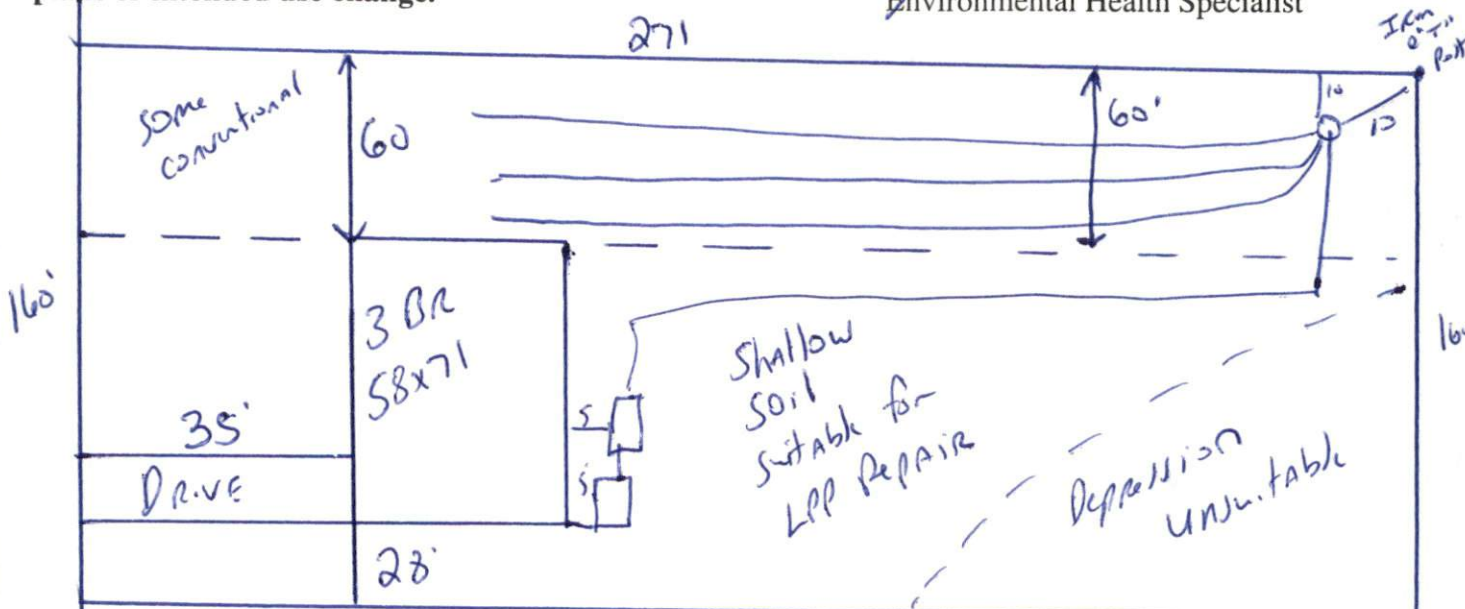

NOTE Change In howe ~~to~~ Location MAINTAIN ALL SET BACKS - DO NOT DRIVE OR PARK ON SEPTIC SYSTEM

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 20028. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Name Bass Built Homes Telephone# 864-1253

Address _____

NC 87

Property Location SR# Forest Ridge Lot # 5 # Bedrooms Proposed 3 (58x71) Road Name 160x275x160x275
Subdivision _____ Lot # _____ # Bedrooms Proposed _____ Lot Size _____

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other Plug to Connect

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 3 Length of lines 135 Ft.

Width of ditches 3 ft. Depth of ditches 18 in inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County of Harnett [Signature] Date 5-2-03