

IMPROVEMENT PERMIT

03-5-7261

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) SPK Home New Installation Septic Tank
Property Location: SR# 1115 Repairs Nitrification Line

Subdivision Peach Tree Lot # 123

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (52x27) Lot Size: .462 ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to Conventional

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18 in


French Drain Required: _____ Linear feet

Date: 6-23-03

This permit is subject to revocation if site plans or intended use change.

Signed: Joe W. [Signature] Environmental Health Specialist

STAB and Plumbing shallow where shown and pump may not be required. Meet DSHH Maintain All Set Backs Do not Drive on

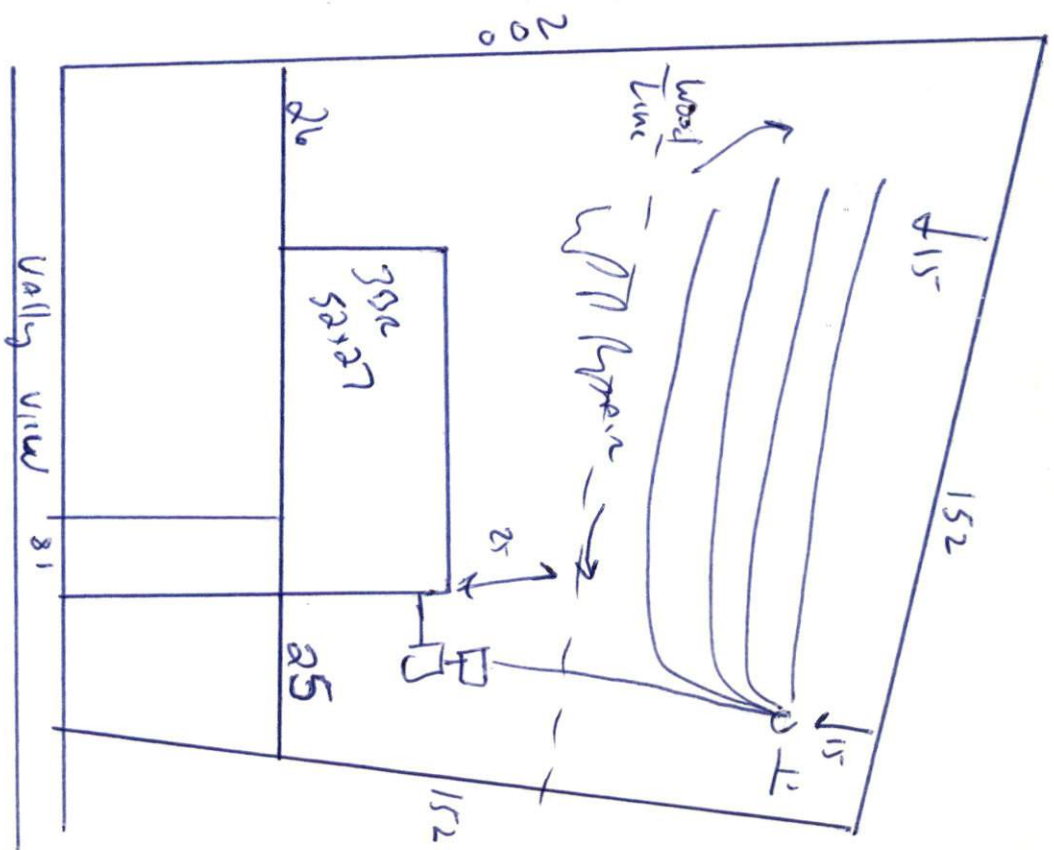

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19439. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Srk Honey Telephone# 919 231-4925

Address _____

Address 1115

Property Location SR# Prachtree Road Name 462A
Subdivision 123 Lot # 3 (3652x27) # Bedrooms Proposed 4 Lot Size 462A

TYPE OF SYSTEM

- New Installation Repair Septic Tank Nitrification Lines
 Conventional Other Pump & Conv.
 Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 100 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County of Harnett Joe White Date 6-23-03