

HTE 03-5 8134R

IMPROVEMENT PERMIT

21161

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Bruce Bryant New Installation Septic Tank
Property Location: SR# Murphy rd Repairs Nitrification Line

Subdivision Woodshire Lot # 13

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (58x50) Lot Size: 1/4 AC

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 75 ft. width of ditches 3 ft. depth of ditches 18 in.


French Drain Required: _____ Linear feet

Date: 12-12-03

Signed: Joe L. Wray
Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

*Line may start at 24"
May install as 1x300
But still must meet onsite*

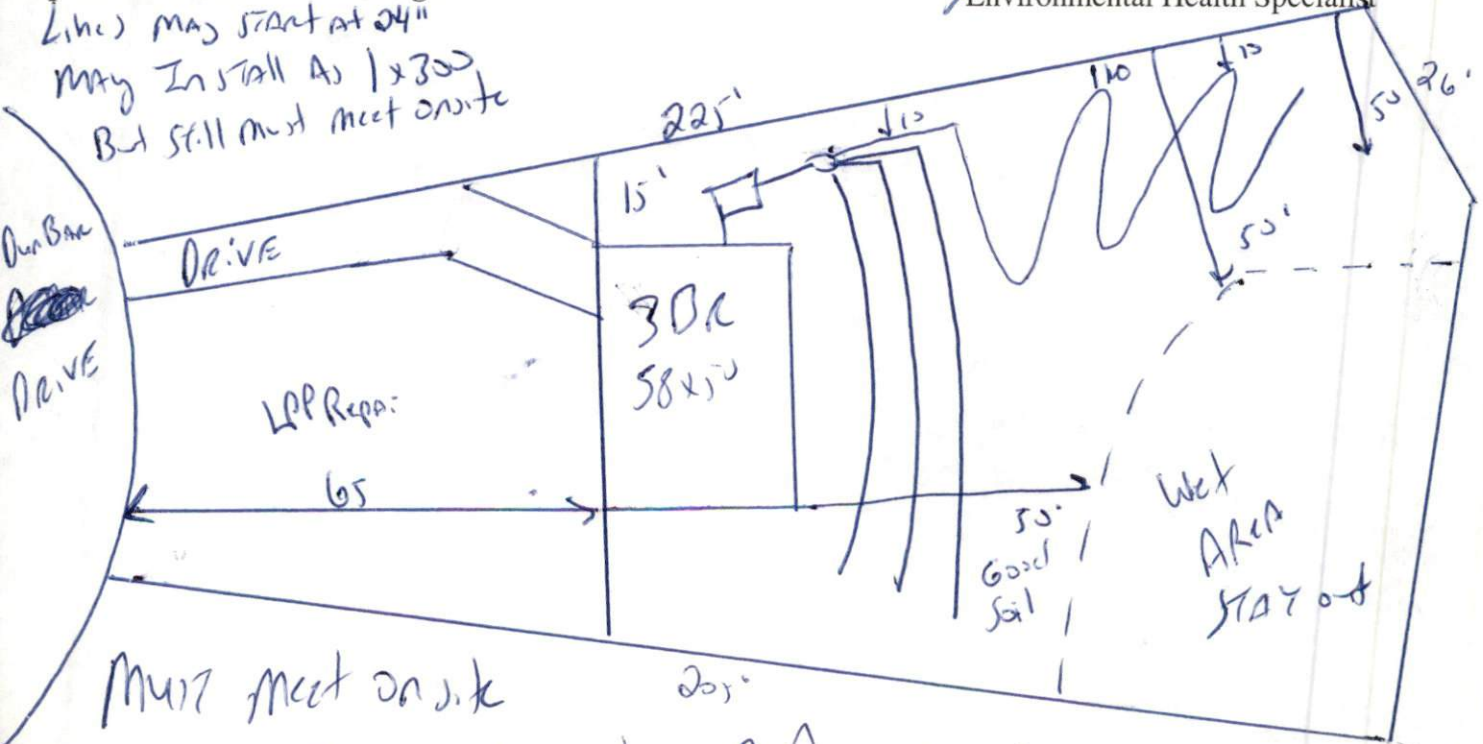

*I must flag out system before installing
CALL AT LEAST 3 days before system is to be installed*

HARNETT COUNTY HEALTH DEPARTMENT
AUTORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 03-5-8174R. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Bruce Bryant

Name

Telephone#

Address

Nurses, M

Property Location SR#

Road Name

Woodhine

13

3(58x50)

0.5/02

Subdivision

Lot #

Bedrooms Proposed

Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 75 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

J. W. H. R. S.

Signature of Authorized Agent for Harnett County of Harnett

12-12-07

Date