

HTE 04-5 8883

IMPROVEMENT PERMIT

20687

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Kent Pierce New Installation Septic Tank
 Property Location: SR# 1141 Repairs Nitrification Line

Subdivision Highland Forest Lot # 124

Tax ID # _____ Quadrant # _____
 Number of Bedrooms Proposed: 3 (28x50) Lot Size: .47Ac

Basement with Plumbing: Garage:
 Water Supply: Well Public Community
 Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of 1 exact length 200 ft. width of 3 ft. depth of 18" x 4" in.
 ditches of each ditch


French Drain Required: _____ Linear feet

Date: 03-15-04

This permit is subject to revocation if site plans or intended use change.

Signed: J. W. [Signature]
 Environmental Health Specialist

Highland Forest Drive
 150'

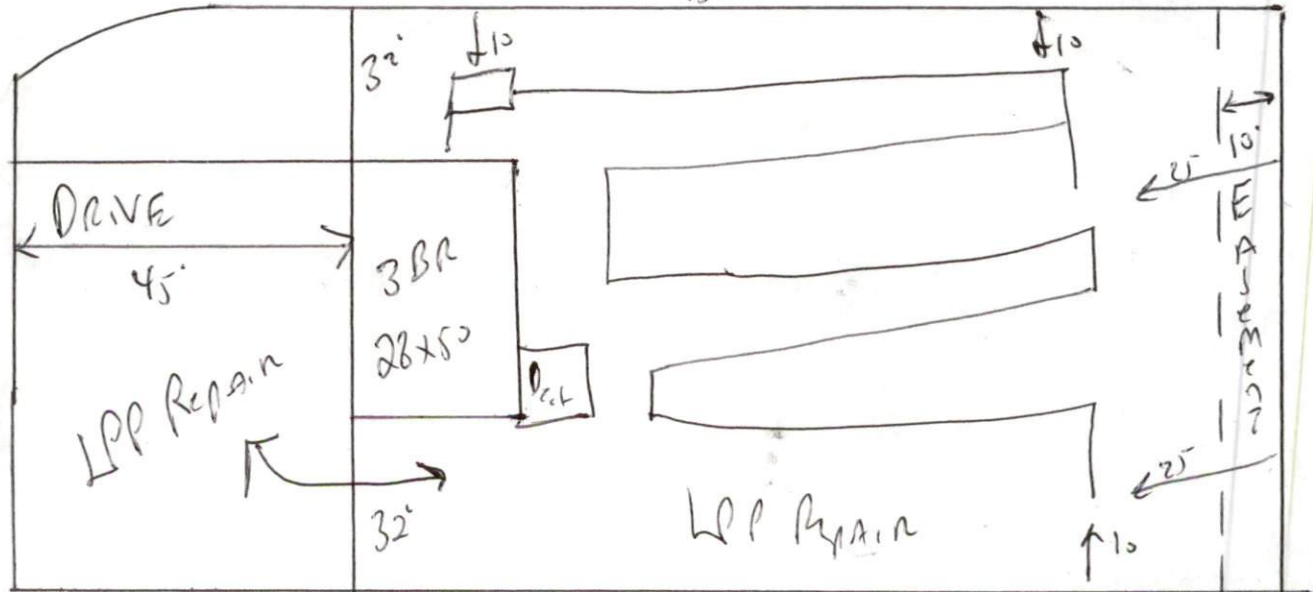

MAINTAIN ALL SETBACKS
 Keep Drain Lines 15' from Top of Ditch (EAST) approx 25'

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20687. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Kent Pierce
Name _____ Telephone # _____

Address _____

1141
Property Location SR# _____ Road Name _____
Highland Forest 124 3 (28x50) .47ac
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation [] Repair [] Septic Tank [] Nitrification Lines
 Conventional [] Other _____
[] Basement [] With Plumbing [] Without Plumbing
Water Supply: [] Well [] Public Water Supply Minimum Well Setback: 50 Ft.
Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 200 Ft.
Width of ditches 3 ft. Depth of ditches 18.24 inches
French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe W. JRS 07-15-04
Signature of Authorized Agent for Harnett County Date