

HTE 04-5-9030

IMPROVEMENT PERMIT

20424

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Regency Home
Property Location: SR# 1106
New Installation [X]
Repairs []
Septic Tank [X]
Nitrification Line [X]

Subdivision Cypress Woods Lot # 1

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (62x74) Lot Size: 6.81 ac

Basement with Plumbing: [] Garage: [X]

Water Supply: [X] Well [] Public [] Community []

Distance From Well: 1000 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: [X] Conventional [] Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 1 exact length of each ditch 300 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet

Date: 04-06-04

Signed: J. W. [Signature] Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

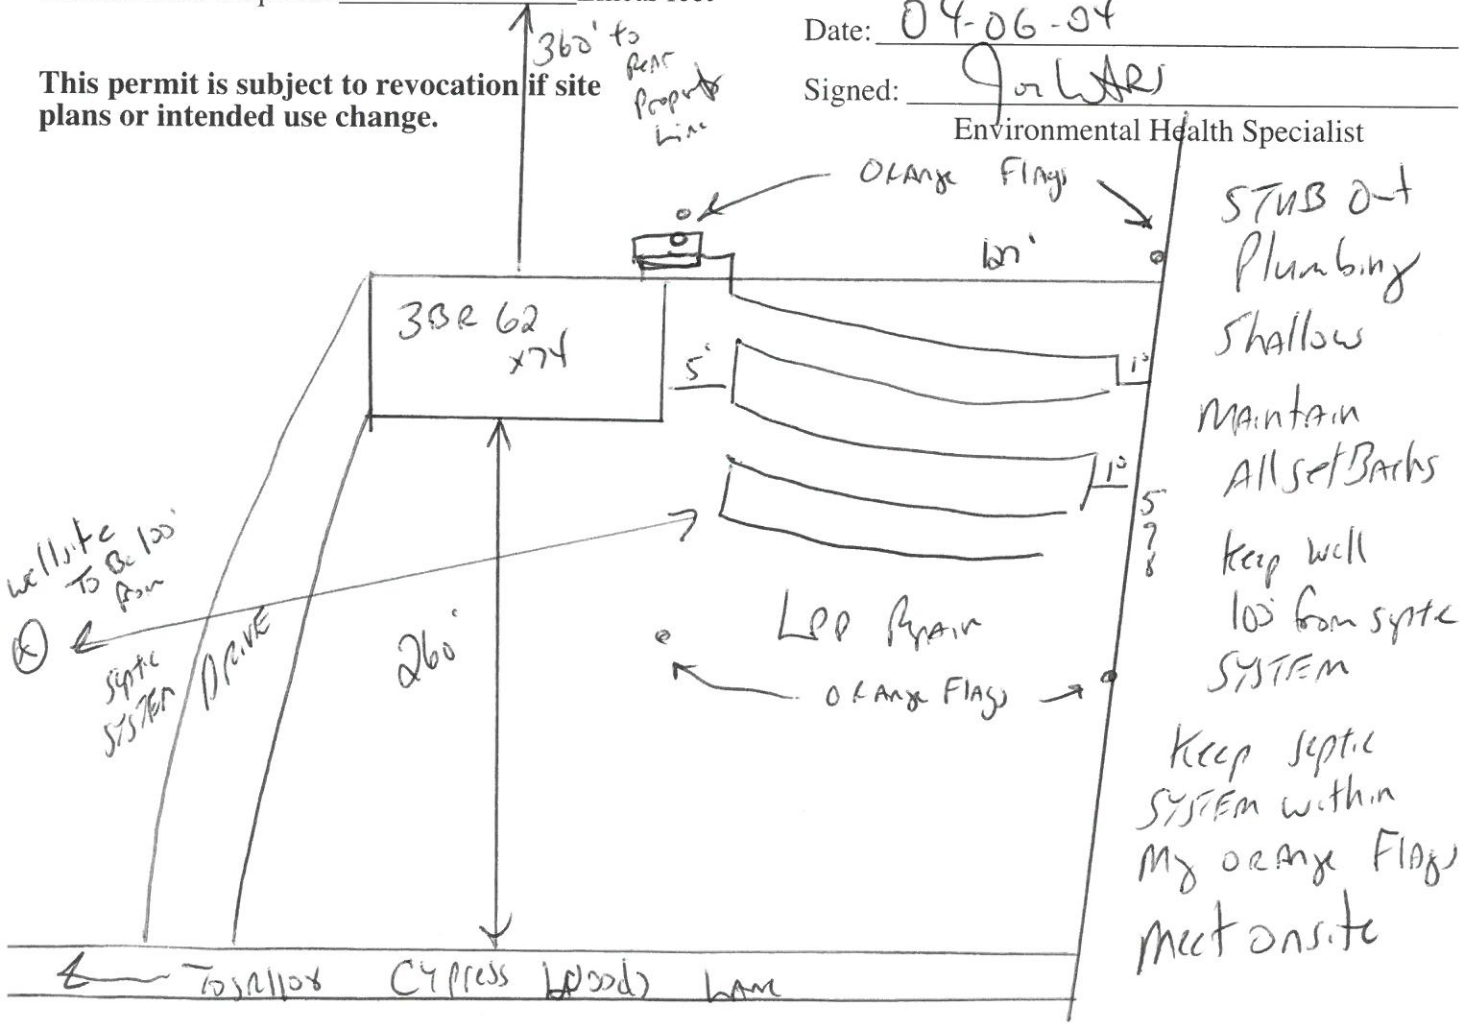

STUB OUT Plumbing Shallow Maintain All set Backs keep well 100' from sytce SYSTEM Keep septic SYSTEM within My orange Flag meet onsite

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20426. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Regency Homes
Name _____ Telephone # _____

Address _____

1106
Property Location SR# _____ Road Name _____

Cypress Woods 1 3 (62x74) 6.81 ac
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines
 Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: 100 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 300 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

J. West RS
Signature of Authorized Agent for Harnett County

4-6-04
Date