

IMPROVEMENT PERMIT

20571

HTE 04-5-9316

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) CAVINESS Land Dev.
Property Location: SR# 114
New Installation, Septic Tank, Repairs, Nitrification Line

Subdivision The Summit Lot # 71

Tax ID # Quadrant #

Number of Bedrooms Proposed: 3 (55 x 34) Lot Size: .38 AC

Basement with Plumbing: Garage: [checked]

Water Supply: Well, Public [checked], Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional [checked], Other

Size of tank: Septic Tank: 1000 gallons Pump Tank: gallons

Subsurface Drainage Field: No. of ditches 1, exact length of each ditch 200 ft., width of ditches 3 ft., depth of ditches 18-24 in.


French Drain Required: Linear feet

Date: 05-05-04

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature] Environmental Health Specialist

Silver Thorpe Drive 75'

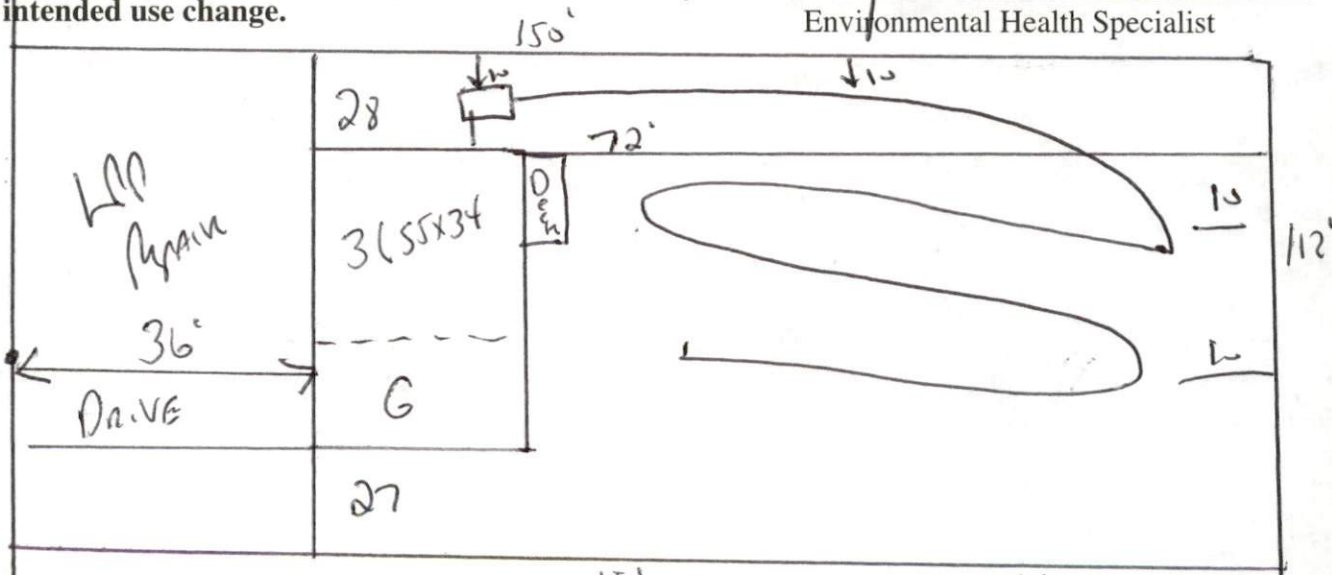

STUB out Plumbing shallow where shown
Maintain all setbacks

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20571. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Caviness Land  
Name \_\_\_\_\_ Telephone # \_\_\_\_\_

Address \_\_\_\_\_

1141

Property Location SR# \_\_\_\_\_ Road Name \_\_\_\_\_  
The Summit 71 3(55x34) .38 Ac  
Subdivision Lot # # Bedrooms Proposed Lot Size

**TYPE OF SYSTEM**

New Installation [ ] Repair [ ] Septic Tank [ ] Nitrification Lines  
 Conventional [ ] Other \_\_\_\_\_  
[ ] Basement [ ] With Plumbing [ ] Without Plumbing

Water Supply: [ ] Well [ ] Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber \_\_\_\_\_ gal

**NITRIFICATION FIELD SPECIFICATIONS**

Number of fields 1 # of lines per field 1 Length of lines 200 Ft.

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe West RS 05-05-04  
Signature of Authorized Agent for Harnett County Date