

HTE 04-5-9323

HARRI T COUNTY HEALTH DEPARTM

IMPROVEMENT PERMIT

20564

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Dennis Norris Builders New Installation Septic Tank
Property Location: SR# 1115 Repairs Nitrification Line

Subdivision Peach Tree Lot # 144

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (44x41) Lot Size: 0.498 AC

Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 240 ft. width of ditches 3 ft. depth of ditches 18.24 in.


French Drain Required: _____ Linear feet

Date: 04-29-04

Signed: Joe Whites
Environmental Health Specialist 40

This permit is subject to revocation if site plans or intended use change.

*Keep Drain Lines 20' from Property Lines with Easement along it
Maintain set Backs
Stub out Plumbing shallow 218'*

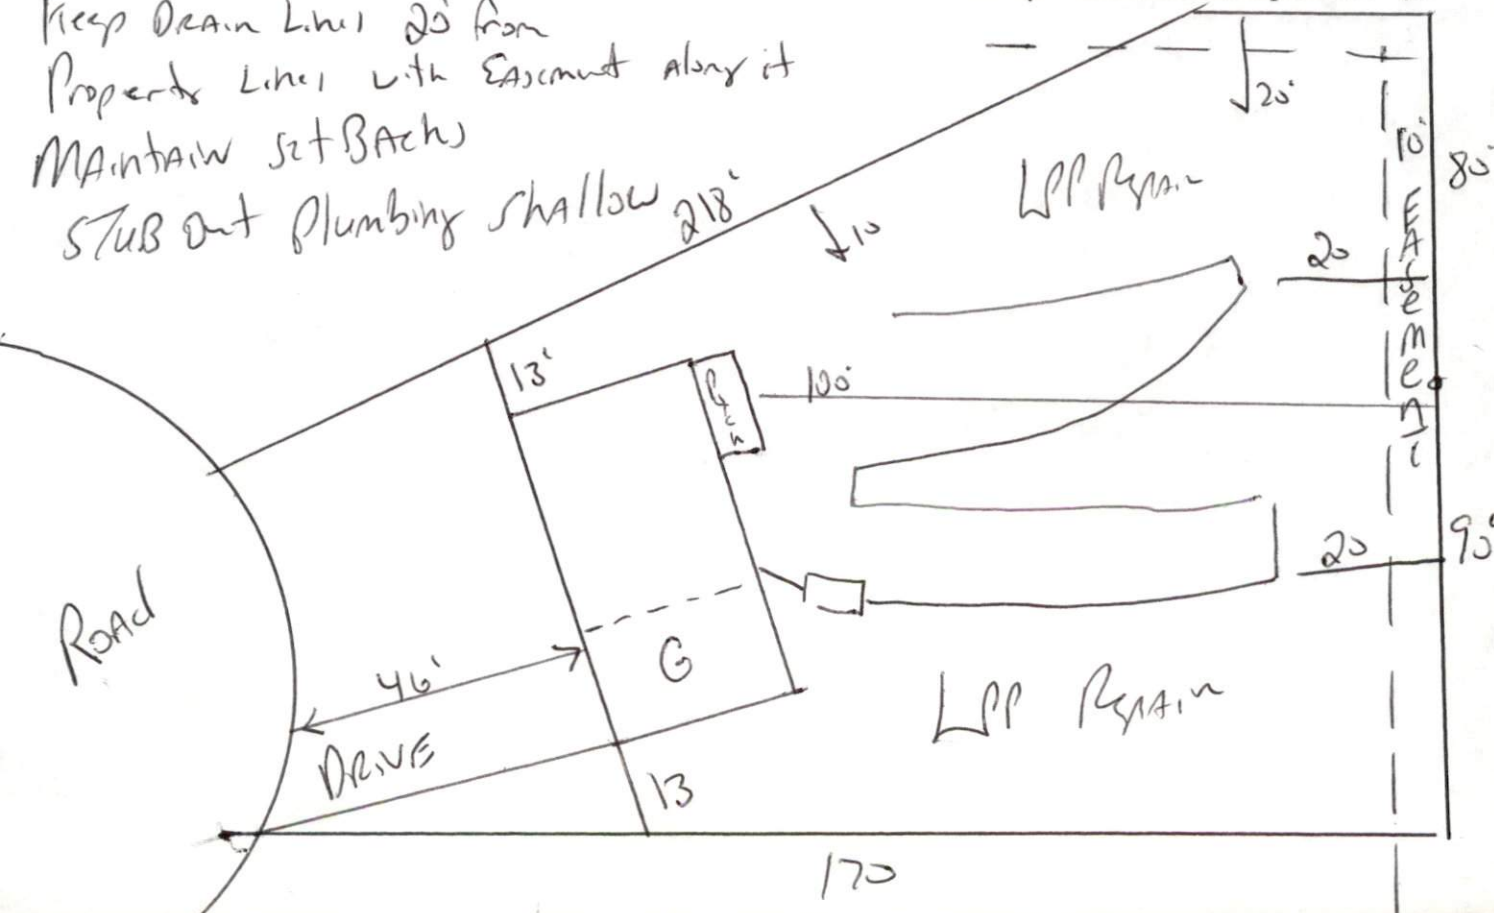

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20564. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Dennis Norris Bulder

Name

Telephone #

Address

1115

Property Location SR#

Peach Tree

Road Name

144

3(44x41)

.498R

Subdivision

Lot #

Bedrooms Proposed

Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines ~~240~~ 240 Ft.

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe West RS

Signature of Authorized Agent for Harnett County

4-29-04

Date