


**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: Applicant: Date Evaluated: 2-10-72
 Address: Design Flow (.1949): Property Size:
 Proposed Facility: DUPLEX
 Location of Site: 222 Property Recorded:
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	LS 02	0-18	G S	VFA NS/MP					
		18-36	SBK SCL	FR SS/SP					PS .45
		36-48	G SL	VFA NS/MP					
2		0-12	G S	VFA NS/MP					
		12-42	SBK SCL	FR SS/SP	1072 7/20 37"				PS .45
3		0-20	G S	VFA NS/ND					
		20-44	SBK SCL	FR SS/SP					PS .45
4		0-12	G S	VFA NS/ND					
		12-34	SBK SCL	FR SS/SP	1072 7/20 35"				PS .45

Description	Initial System	Repair System	Other Factors (.1946): Site Classification (.1948): PS Evaluated By: 07 Others Present: -
Available Space (.1945)			
System Type(s)	95 7/20 20		
Site LTAR	.45	.45	

1000 gal 2-70-e 24"
 1000 gal 2-70-e 24"

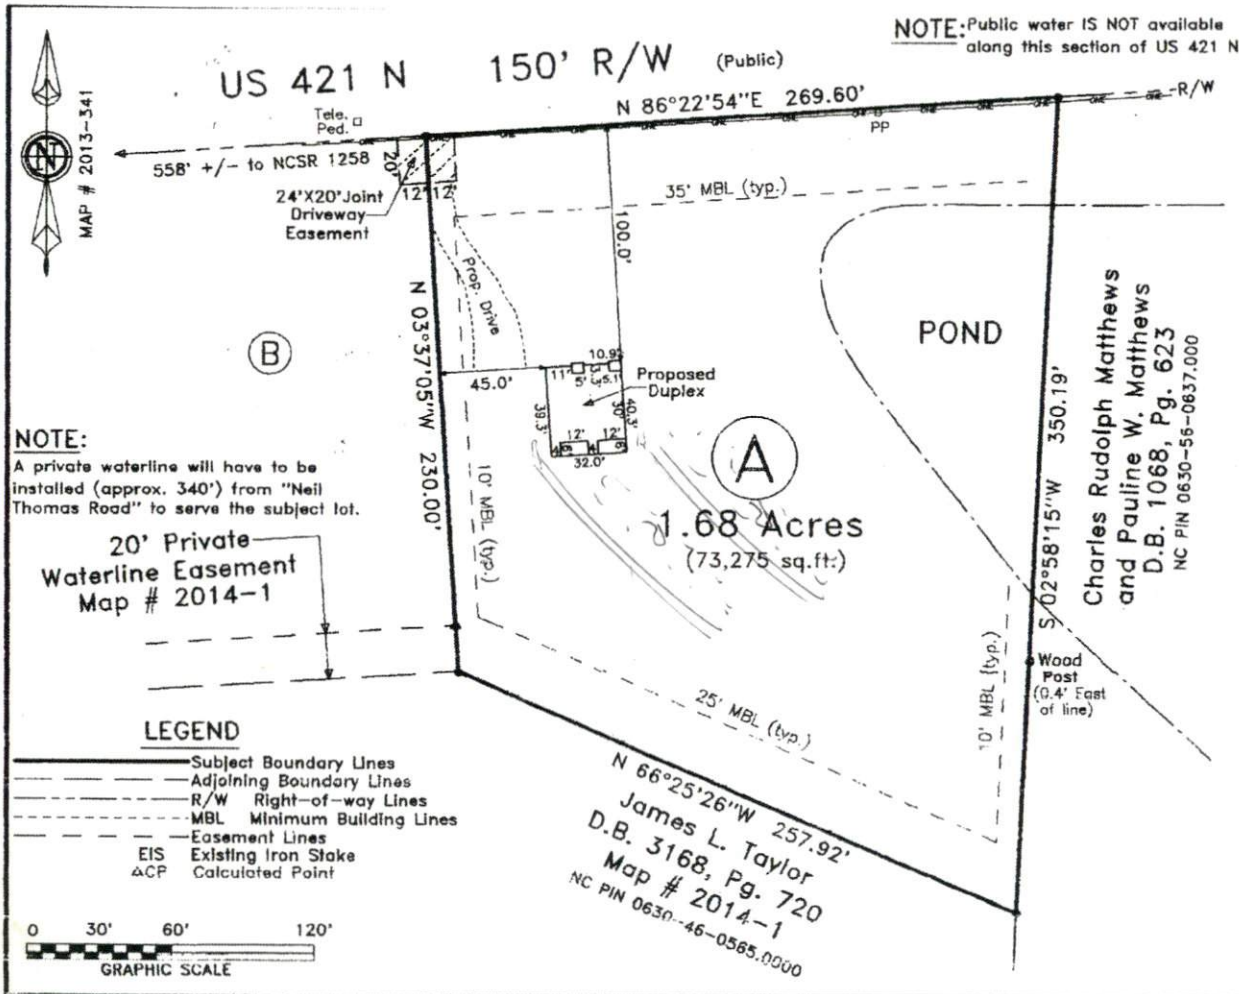

SITE PLAN APPROVAL

DISTRICT R130 USE Duplex
 #BEDROOMS 4 total (2 each)

Date 1/01/14 Zoning Administrator [Signature]



Lot A, Map # 2014-1
 Portion of: Deed Bk. 3168, Pg. 720

Survey for:
James L. Taylor

Upper Little River Twp. Harnett Co.
 Scale: 1" = 60' Date: 1-6-2014

Surveyed & Mapped By:
STREAMLINE LAND SURVEYING, INC.
 870 NC 55 W, Coats, N.C. 27521
 910-897-7715 910-897-7284 (FAX)

~PRELIMINARY PLOT PLAN~
 - Not an actual survey -
 This plan represents proposed improvements to a lot of record. This plan is subject to review and approval by County Planning and Inspections Dept.

NOT FOR RECORDATION

M.G.G.

DATA\0630\1309301A 140106TA