

HTE# 08-5-20908

Harris County Department of Public Health

20805

PERMIT # 25179

Operation Permit

☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: 401NName: (owner) ROBERT NAYLOR

SUBDIVISION _____

LOT # _____

System Installer: WAYNE CANNADY

Registration # _____


Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 140 PERSON DAYCAREType of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 100 feetSystem Type: IIIb

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

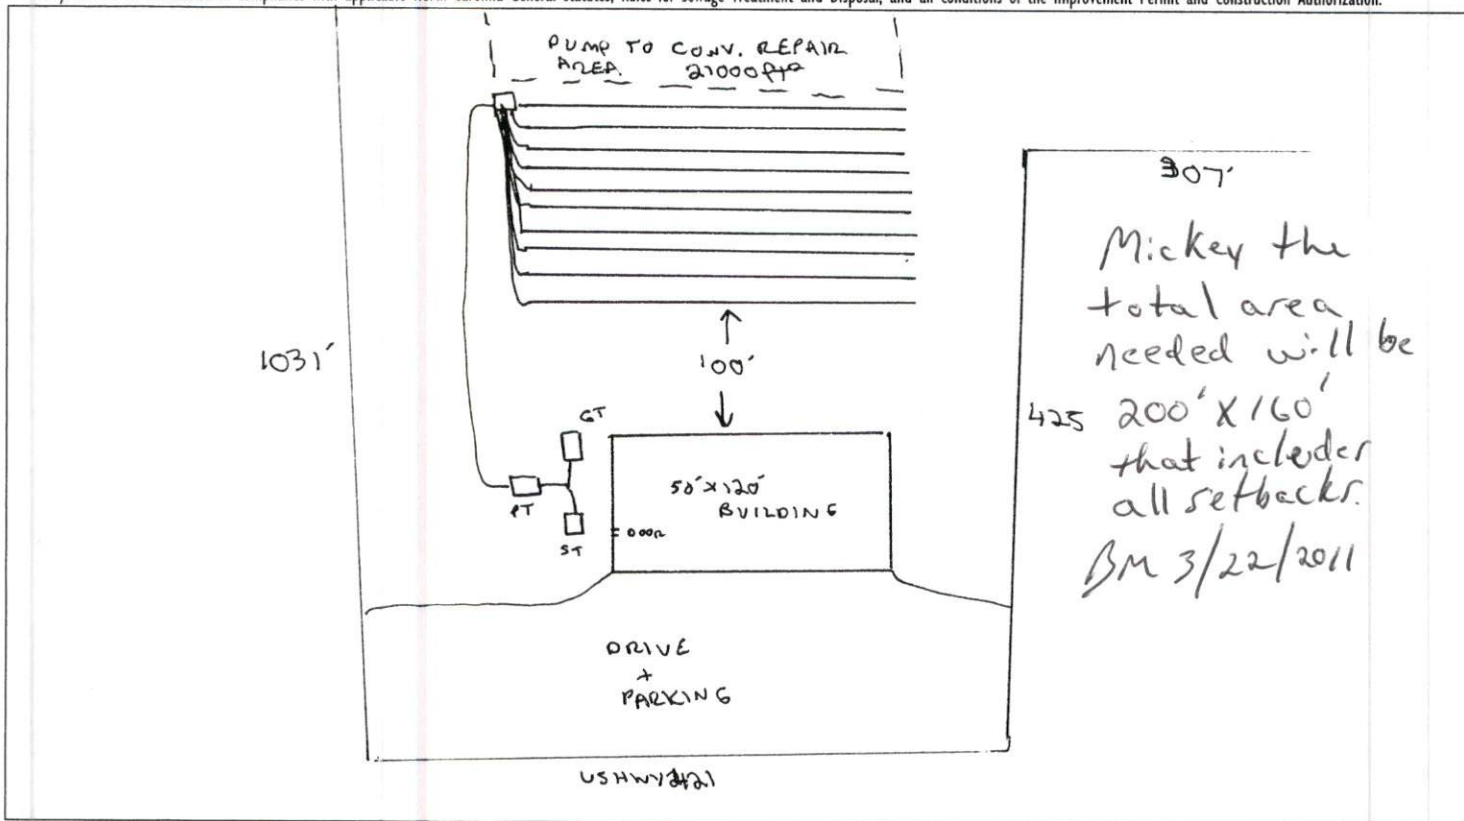

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: 2200 gal GREASE TANK. Pump & Alarm Shall To be Checked ✓ on 9/21/09

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other PUMP TO CONVENTIONALSeptic Tank: 3000 gallons Pump Tank: 3400 gallonsSubsurface No. of exact length width of
Drainage Field ditches 10 of each ditch 180 feet ditches 3 feetdepth of
ditches 18-36 inchesFrench Drain Required: Linear feet

Authorized State Agent _____

REMS

Date 9/21/09