

PROPOSED TELECOMMUNICATIONS POLE

SITE NAME:

DUNN OPERATIONS CENTER



SITE ADDRESS:

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)



401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 OFFICE: (800) 452-2777



IF YOU DIG IN NORTH CAROLINA... CALL US FIRST! 1-800-632-4949

NORTH CAROLINA ONE CALL IT'S THE LAW

THE UTILITIES SHOWN HEREON ARE FOR THE CONTRACTORS CONVENIENCE ONLY THERE MAY BE OTHER UTILITIES NOT SHOWN ON THESE PLANS. THE ENGINEER/ SURVEYOR ASSUMES NO RESPONSIBILITY FOR THE LOCATIONS SHOWN AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL UTILITIES WITHIN THE LIMITS OF THE WORK. ALL DAMAGE MADE TO EXISTING UTILITIES BY THE CONTRACTOR SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

UTILITY STATEMENT

INDEX OF SHEETS

SHEET	DESCRIPTION	REV
T1	TITLE SHEET	5
N1	PROJECT NOTES	5
C1	SITE PLAN	5
C2	COMPOUND DETAIL	5
С3	POLE ELEVATION	5
C4	POLE FOUNDATION DETAIL & NOTES	5
C5	EQUIPMENT ENCLOSURE FOUNDATION DETAILS	5
C6	ANTENNA MOUNTING DETAILS	5
C7	TELECOMMUNICATIONS CONDUIT DETAILS	5
C8	EQUIPMENT ENCLOSURE DETAIL	5
E1	ELECTRICAL NOTES	5
E2	POWER ROUTING PLAN	5
E3	ONE-LINE DIAGRAM, PANEL SCH & NOTES	5
E4	POLE GROUNDING AND ROUTING PLAN	5
E5	GROUNDING AND CABLE ELEVATION	5
E6	GROUNDING DETAILS I	5
E7	GROUNDING DETAILS II	5





TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403

5	11-25-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
3	10-24-24	CONSTRUCTION
2	07-16-24	PRELIMINARY CONSTRUCTION
- 1	06-25-24	PRELIMINARY CONSTRUCTION
0	05-15-24	PRELIMINARY CONSTRUCTION
REV	DATE	ISSUED FOR:

DRAWN BY: CHECKED BY:





November 25, 2024

N 35° 19' 14.3" (35.319861)* (NAD '83) W 78° 33' 51.1" (-78.563694)* (NAD '83) LATITUDE GROUND ELEVATION (AMSL) = $232'\pm*$

*LATITUDE, LONGITUDE, AND GROUND ELEVATION INFORMATION PER GOOGLE EARTH

POLE COORDINATES

POLE OWNER:

(800) 452-2777

DUKE ENERGY 401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 LISA DUNLAP

PROPERTY OWNER:

CITY, STA CONTACT PHONE

DUKE ENERGY PROGRESS LLC 526 CHURCH ST CHARLOTTE, NC 28202 UNKNOWN UNKNOWN SITE APPLICANT: DUKE ENERGY 401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 LISA DUNLAP

180± S.F.

(800) 452-2777

AREA OF CONSTRUCTION: PRESENT OCCUPANCY TYPE: PROPOSED OCCUPANCY TYPE:

MICROWAVE POLE 021527 0273 HARNETT COUNTY

ELECTRICAL SUBSTATION

JURISDICTION: **UTILITIES:**

PARCEL ID:

POWER COMPANY CONTACT: PHONE: POLE # NEAR SITE: TELEPHONE COMPANY

DUKE ENERGY CUSTOMER SERVICE (800) 452-2777 LINKNOWN

PROJECT SUMMARY

AS ADOPTED BY THE LOCAL GOVERNING AUTHORITIES. NOTHING IN THESE PLANS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THE LATEST EDITIONS OF THE FOLLOWING: 4. NATIONAL ELECTRIC CODE 2018 NORTH CAROLINA BUILDING CODE (2015 IBC W/ AMENDMENTS) (2020 EDITION)

ACCORDANCE WITH THE CURRENT EDITIONS OF THE FOLLOWING CODES

5. CITY/COUNTY ORDINANCES 6. LOCAL BUILDING CODE NORTH CAROLINA CODE COUNCIL ANSI/TIA-222-H

CODE COMPLIANCE

SURVEYOR:

NAME ADDRESS CITY, STATE, ZIP CONTACT

CIVIL ENGINEER:

(919) 661-6351

STRUCTURAL ENGINEER:

TEP ENGINEERING, PLLC 326 TRYON ROAD RALEIGH, NC 27603 AARON T. RUCKER, P.E. (919) 661-6351

ELECTRICAL ENGINEER:

TEP ENGINEERING, PLLC 326 TRYON ROAD RALEIGH, NC 27603 MARK S. QUAKENBUSH, P.E. (919) 661-6351 GEOTECHNICAL ENGINEER:

TEP ENGINEERING, PLLC 326 TRYON ROAD RALEIGH, NC 27603 JOHN D. LONGEST, P.E. (919) 661-6351

POLE MANUFACTURER:

PROJECT TEAM

ADDIE WEBB LN

LOCATION MAP

FROM RALEIGH, NC: TAKE PREFERRED ROUTE TO I-440 E TOWARD RALEIGH TAKE EXIT 14 TOWARD US-64 E/US-264 E/WILSON/ROCKY MT/GREENVILLE/I-495 N. CONTINUE ONTO I-87/US-264 E/US-64 E CÓNTINUE ON Í-87. CONTINUE ONTO US-264 E/UŚ-64 E, TAKE EXIT 436 FOR U.S. 264 E TOWARD NC-97/WILSON/GREENVILLE. TAKE EXIT 26B FOR US-264 E TOWARD WILSON. MERGE ONTO US-264 ALT E. TURN LEFT ONTO AIRPORT BLVD NW. CONTINUE ONTO LAKE WILSON RD AND TURN RIGHT ONTO LONDON CHURCH RD. TURN LEFT ONTO UPCHURCH RD. TURN RIGHT ONTO ELM CITY RD AND THE DESTINATION WILL BE ON THE RIGHT.

DRIVING DIRECTIONS

丁-1

GENERAL NOTES:

- ALL REFERENCES TO OWNER IN THESE DOCUMENTS SHALL BE CONSIDERED DUKE ENERGY OR ITS DESIGNATED REPRESENTATIVE
- 2. ALL WORK PRESENTED ON THESE DRAWINGS MUST BE COMPLETED BY THE CONTRACTOR UNLESS NOTED OTHERWISE. THE CONTRACTOR MUST HAVE CONSIDERABLE EXPERIENCE IN PERFORMANCE OF WORK SIMILAR TO THAT DESCRIBED HEREIN. BY ACCEPTANCE OF THIS ASSIGNMENT, THE CONTRACTOR IS ATTESTING THAT HE DOES HAVE SUFFICIENT EXPERIENCE AND ABILITY, THAT HE IS KNOWLEDGABLE OF THE WORK TO BE PERFORMED AND THAT HE IS PROPERLY LICENSED AND PROPERLY REGISTERED TO DO THIS WORK IN THE STATE OF NORTH CAROLINA.
- 3. STRUCTURE IS DESIGNED IN ACCORDANCE WITH ANSI/TIA-222-H STRUCTURAL STANDARD FOR ANTENNA SUPPORTING STRUCTURES, ANTENNAS, AND SMALL WIND TURBINE SUPPORT STRUCTURES AND THE 2018 NORTH CAROLINA STATE BUILDING CODE.
- 4. WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE 2018 NC BUILDING CODE (2015 IBC W/ AMENDMENTS).
- 5. UNLESS SHOWN OR NOTED OTHERWISE ON THE CONTRACT DRAWINGS, OR IN THE SPECIFICATIONS, THE FOLLOWING NOTES SHALL APPLY TO THE MATERIALS LISTED HEREIN, AND TO THE PROCEDURES TO BE USED ON THIS PROJECT.
- 6. ALL HARDWARE ASSEMBLY MANUFACTURER'S INSTRUCTIONS SHALL BE FOLLOWED EXACTLY AND SHALL SUPERSEDE ANY CONFLICTING NOTES ENCLOSED HEREIN.
- 7. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURE AND SEQUENCE, TO INSURE THE SAFETY OF THE STRUCTURE AND ITS COMPONENT PARTS DURING ERECTION AND/OR FIELD MODIFICATIONS. THIS INCLUDES, BUT IS NOT LIMITED TO, THE ADDITION OF TEMPORARY BRACING, GUYS OR TIE DOWNS THAT MAY BE NECESSARY. SUCH MATERIAL SHALL BE REMOVED AND SHALL REMAIN THE PROPERTY OF THE CONTRACTOR AFTER THE COMPLETION OF THE PROJECT.
- ALL DIMENSIONS, ELEVATIONS, AND EXISTING CONDITIONS SHOWN ON THE DRAWINGS SHALL BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO BEGINNING ANY MATERIALS ORDERING, FABRICATION OR CONSTRUCTION WORK ON THIS PROJECT. CONTRACTOR SHALL NOT SCALE CONTRACT DRAWINGS IN LIEU OF FIELD VERIFICATIONS. ANY DISCREPANCIES SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE OWNER AND THE OWNER'S ENGINEER. THE DISCREPANCIES MUST BE RESOLVED BEFORE THE CONTRACTOR IS TO PROCEED WITH THE WORK. THE CONTRACT DOCUMENTS DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES. OBSERVATION VISITS TO THE SITE BY THE OWNER AND/OR THE ENGINEER SHALL NOT INCLUDE INSPECTION OF THE PROTECTIVE MEASURES OR THE PROCEDURES.
- 9. ALL MATERIALS AND EQUIPMENT FURNISHED SHALL BE NEW AND OF GOOD QUALITY, FREE FROM FAULTS AND DEFECTS AND IN CONFORMANCE WITH THE CONTRACT DOCUMENTS. ANY AND ALL SUBSTITUTIONS MUST BE PROPERLY APPROVED AND AUTHORIZED IN WRITING BY THE OWNER AND ENGINEER PRIOR TO INSTALLATION. THE CONTRACTOR SHALL FURNISH SATISFACTORY EVIDENCE AS TO THE KIND AND QUALITY OF THE MATERIALS AND EQUIPMENT BEING SUBSTITUTED.
- 10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR INITIATING, MAINTAINING, AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK. THE CONTRACTOR IS RESPONSIBLE FOR INSURING THAT THIS PROJECT AND RELATED WORK COMPLIES WITH ALL APPLICABLE LOCAL, STATE, AND FEDERAL SAFETY CODES AND REGULATIONS GOVERNING THIS WORK
- 11. ACCESS TO THE PROPOSED WORK SITE MAY BE RESTRICTED. THE CONTRACTOR SHALL COORDINATE INTENDED CONSTRUCTION ACTIVITY, INCLUDING WORK SCHEDULE AND MATERIALS ACCESS, WITH THE RESIDENT LEASING AGENT FOR APPROVAL.
- 12. BILL OF MATERIALS AND PART NUMBERS LISTED ON CONSTRUCTION DRAWINGS ARE INTENDED TO AID CONTRACTOR. CONTRACTOR SHALL VERIFY PARTS AND QUANTITIES WITH MANUFACTURER PRIOR TO BIDDING AND/OR ORDERING MATERIALS.
- 13. ALL PERMITS THAT MUST BE OBTAINED ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR WILL BE RESPONSIBLE FOR ABIDING BY ALL CONDITIONS AND REQUIREMENTS OF THE PERMITS.
- 14. 24 HOURS PRIOR TO THE BEGINNING OF ANY CONSTRUCTION, THE CONTRACTOR MUST NOTIFY THE APPLICABLE JURISDICTIONAL (STATE, COUNTY OR CITY) ENGINEER.
- 15. THE CONTRACTOR SHALL REWORK (DRY, SCARIFY, ETC.) ALL MATERIAL NOT SUITABLE FOR SUBGRADE IN ITS PRESENT STATE. AFTER REWORKING, IF THE MATERIAL REMAINS UNSUITABLE, THE CONTRACTOR SHALL UNDERCUT THIS MATERIAL AND REPLACE WITH APPROVED MATERIAL ALL SUBGRADES SHALL BE PROOFROLLED WITH A FULLY LOADED TANDEM AXLE DUMP TRUCK PRIOR TO PAVING. ANY SOFTER MATERIAL SHALL BE REWORKED OR REPLACED.
- 16. THE CONTRACTOR IS REQUIRED TO MAINTAIN ALL PIPES, DITCHES, AND OTHER DRAINAGE STRUCTURES FREE FROM OBSTRUCTION UNTIL WORK IS ACCEPTED BY THE OWNER. THE CONTRACTOR IS RESPONSIBLE FOR ANY DAMAGES CAUSED BY FAILURE TO MAINTAIN DRAINAGE STRUCTURE IN OPERABLE CONDITION.
- 17. ALL MATERIALS AND WORKMANSHIP SHALL BE WARRANTED FOR ONE YEAR FROM ACCEPTANCE DATE.
- 18. ALL BUILDING DIMENSIONS SHALL BE VERIFIED WITH THE PLANS (LATEST REVISION) PRIOR TO COMMENCING CONSTRUCTION. NOTIFY THE ENGINEER IMMEDIATELY IF ANY DESCREPANCEIES ARE DISCOVERED. THE OWNER SHALL HAVE A SET OF APPROVED PLANS AVAILABLE AT THE SITE AT ALL TIMES WHILE WORK IS BEING PERFORMED. A DESIGNATED RESPONSIBLE EMPLOYEE SHALL BE AVAILABLE FOR CONTACT BY GOVERNING AGENCY INSPECTORS.

STRUCTURAL STEEL NOTES:

- THE FABRICATION AND ERECTION OF STRUCTURAL STEEL SHALL CONFORM TO THE AISC SPECIFICATIONS AND MANUAL OF STEEL CONSTRUCTION, LOAD AND RESISTANCE FACTOR DESIGN, 13TH EDITION.
- 2. UNLESS OTHERWISE NOTED, ALL STRUCTURAL ELEMENTS SHALL CONFORM TO THE FOLLOWING REQUIREMENTS:
 - STRUCTURAL STEEL, ASTM DESIGNATION A36 OR A992.
 - ALL BOLTS, ASTM A325 TYPE I GALVANIZED HIGH STRENGTH BOLTS.
 - ALL NUTS. ASTM A563 CARBON AND ALLOY STEEL NUTS.
 - D. ALL WASHERS, ASTM F436 HARDENED STEEL WASHERS.
- 3. ALL CONNECTIONS NOT FULLY DETAILED ON THESE PLANS SHALL BE DETAILED BY THE STEEL FABRICATOR IN ACCORDANCE WITH AISC SPECIFICATIONS AND MANUAL OF STEEL CONSTRUCTION, LOAD AND, RESISTANCE FACTOR DESIGN, 13TH EDITION.
- 4. HOLES SHALL NOT BE FLAME CUT THRU STEEL UNLESS APPROVED BY THE ENGINEER.
- 5. HOT-DIP GALVANIZE ALL ITEMS UNLESS OTHERWISE NOTED, AFTER FABRICATION WHERE PRACTICABLE. GALVANIZING: ASTM A123, ASTM, A153/A153M OR ASTM A653/A653M, G90, AS APPLICABLE.
- 6. REPAIR DAMAGED SURFACES WITH GALVANIZING REPAIR METHOD AND PAINT CONFORMING TO ASTM A780 OR BY APPLICATION OF STICK OR THICK PASTED MATERIAL SPECIFICALLY DESIGNED FOR REPAIR OF GALVANIZING, CLEAN AREAS TO BE REPAIRED AND REMOVE SLAG FROM WELDS. HEAT SURFACES TO WHICH STICK OR PASTE MATERIAL IS APPLIED, WITH A TORCH TO A TEMPERATURE SUFFICIENT TO MELT THE METALLICS IN STICK OR PASTE; SPREAD MOLTEN MATERIAL UNIFORMLY OVER SURFACES TO BE COATED AND WIPE OFF ANY
- 7. A NUT LOCKING DEVICE SHALL BE INSTALLED ON ALL PROPOSED AND/OR REPLACED BOLTS.
- 8. ALL PROPOSED AND/OR REPLACED BOLTS SHALL BE OF SUFFICIENT LENGTH TO EXCLUDE THE THREADS FROM THE SHEAR PLANE.
- 9. ALL PROPOSED AND/OR REPLACED BOLTS SHALL BE OF SUFFICIENT LENGTH SUCH THAT THE END OF THE BOLT BE AT LEAST FLUSH WITH THE FACE OF THE NUT. IT IS NOT PERMITTED FOR THE BOLT END TO BE BELOW THE FACE OF THE NUT AFTER TIGHTENING IS
- 10. ALL ASSEMBLY AND ANCHOR BOLTS ARE TO BE TIGHTENED TO A "SNUG TIGHT" CONDITION AS DEFINED IN SECTION 8.1 OF THE AISC, "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS", DATED JUNE 30, 2004.
- 11. FLAT WASHERS ARE TO BE INSTALLED WITH BOLTS OVER SLOTTED HOLES.
- 12. DO NOT OVER TORQUE ASSEMBLY BOLTS. GALVANIZING ON BOLTS, NUTS, AND STEEL PARTS MAY ACT AS A LUBRICANT, THUS OVER TIGHTENING MAY OCCUR AND MAY CAUSE BOLTS TO CRACK AND SNAP OFF.
- 13. PAL NUTS ARE TO BE INSTALLED AFTER NUTS ARE TIGHT AND WITH EDGE LIP OUT. PAL NUTS ARE NOT REQUIRED WHEN SELF-LOCKING NUTS ARE PROVIDED.
- 14. GALVANIZED ASTM A325 BOLTS SHALL NOT BE REUSED.
- 15. WELDING SHALL BE PERFORMED IN ACCORDANCE WITH AMERICAN WELDING SOCIETY (AWS) D1.1-2010 STRUCTURAL WELDING CODE - STEEL.

FIBER NOTES:

FOR VERTICAL RUNS: ON TOWERS OR POLES, ALWAYS UNREEL THE SPOOL FROM THE TOP DOWN. ENSURE NO STRAIN IS PLACED ON THE FIRST 3 FEET OF THE CABLE, AND THAT THE CABLE IS SUPPORTED EVERY THREE FEET VERTICALLY. NEVER ALLOW THE CABLE TO EXPERIENCE THE STRAIN OF THE CABLE SPOOL WEIGHT. ANY BENDS SHALL BE SUPPORTED DIRECTLY ABOVE AND BELOW THE BEND. THE BOTTOM BEND SHALL HAVE A DRIP LOOP WITH A MINIMUM ONE FOOT BEND RADIUS AT 120°. IT IS RECOMMENDED THE FIBER BE TESTED BEFORE AND AFTER INSTALLATION FOR NO GREATER THAN .02 DB LOSS.



RALEIGH, NC 27601 OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

PLANS PREPARED BY:



TEP ENGINEERING. PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



5 11-25-24 CONSTRUCTION 4 10-30-24 CONSTRUCTION 3 10-24-24 CONSTRUCTION 2 07-16-24 PRELIMINARY CONSTRUCTION	REV	DATE	ISSUED FOR:
4 10-30-24 CONSTRUCTION	2	07-16-24	PRELIMINARY CONSTRUCTION
3311311331131	3	10-24-24	CONSTRUCTION
5 11-25-24 CONSTRUCTION	4	10-30-24	CONSTRUCTION
	5	11-25-24	CONSTRUCTION


DRAWN BY: R.IW CHECKED BY:


SHEET TITLE:


PROJECT NOTES

SHEET NUMBER:

REVISION:

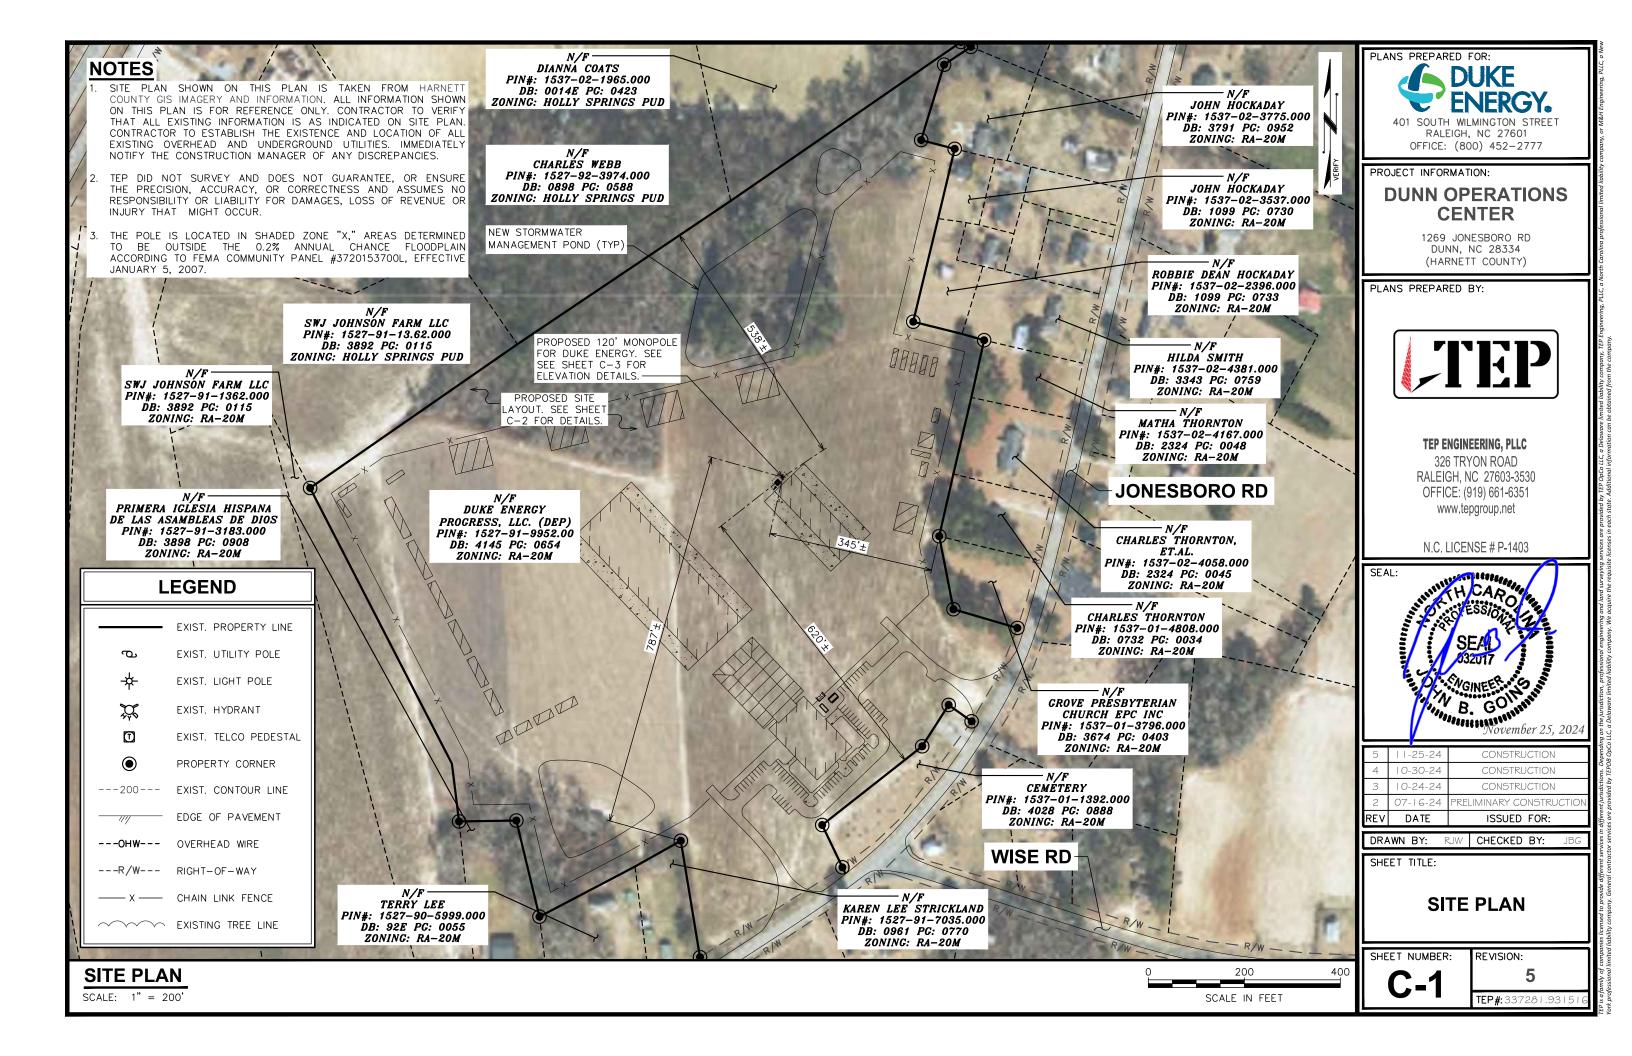

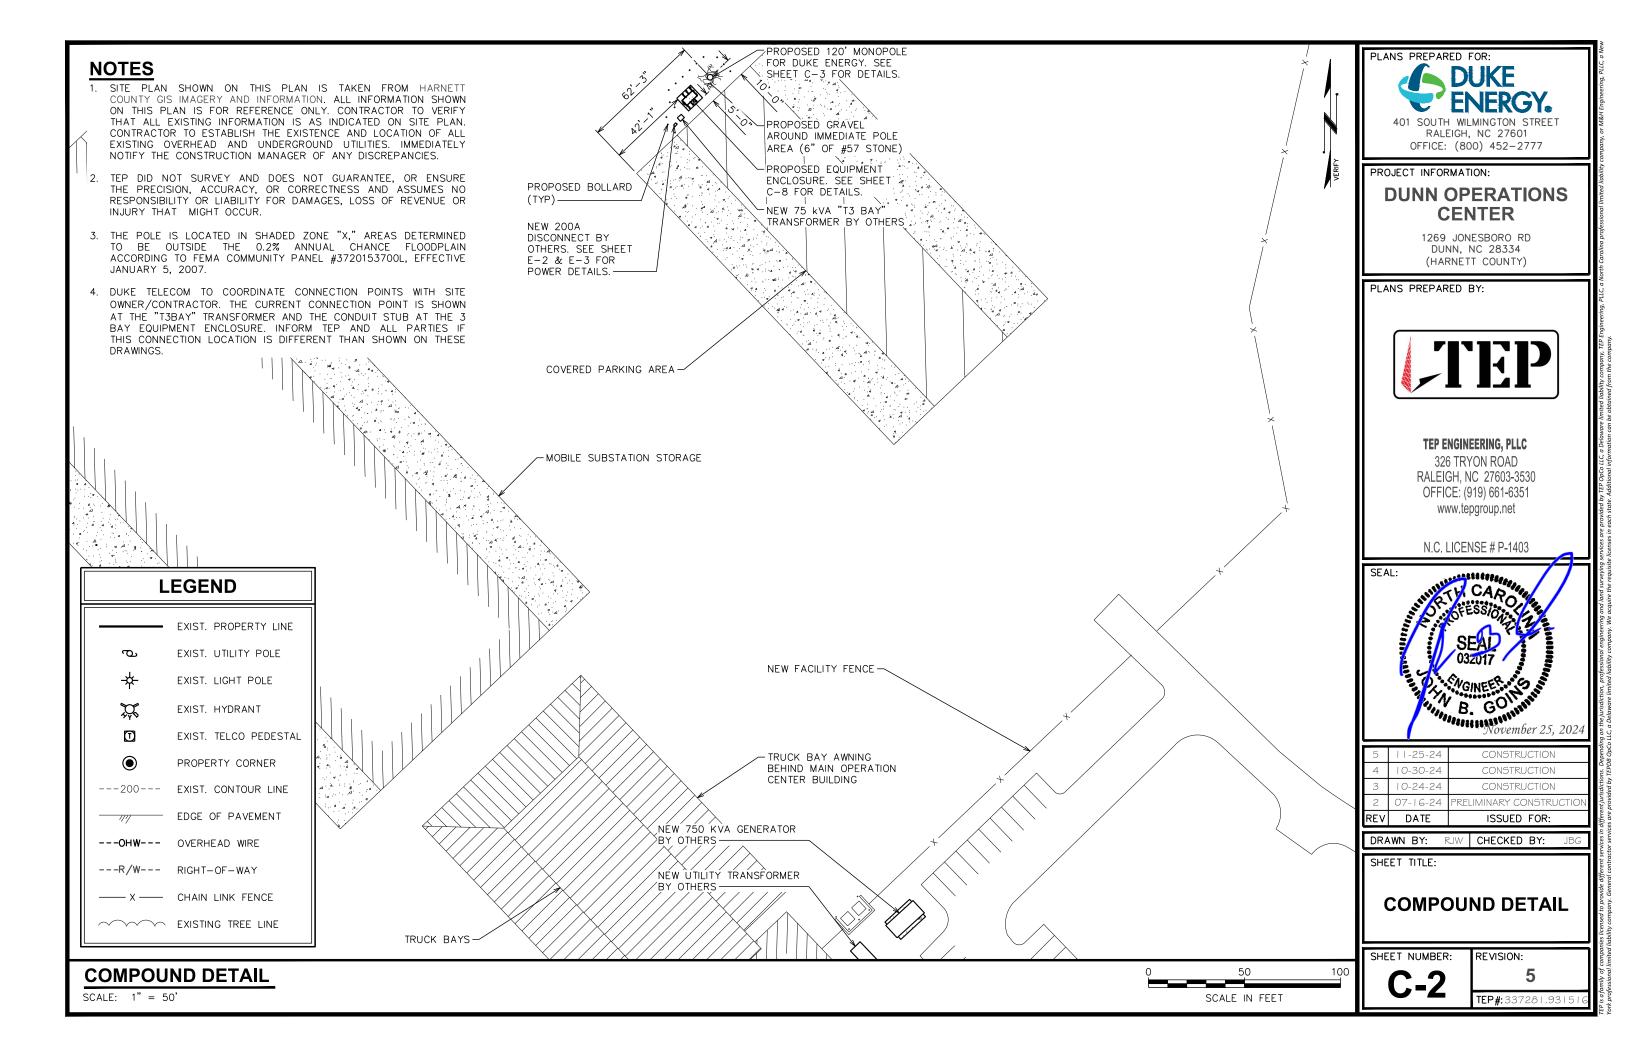

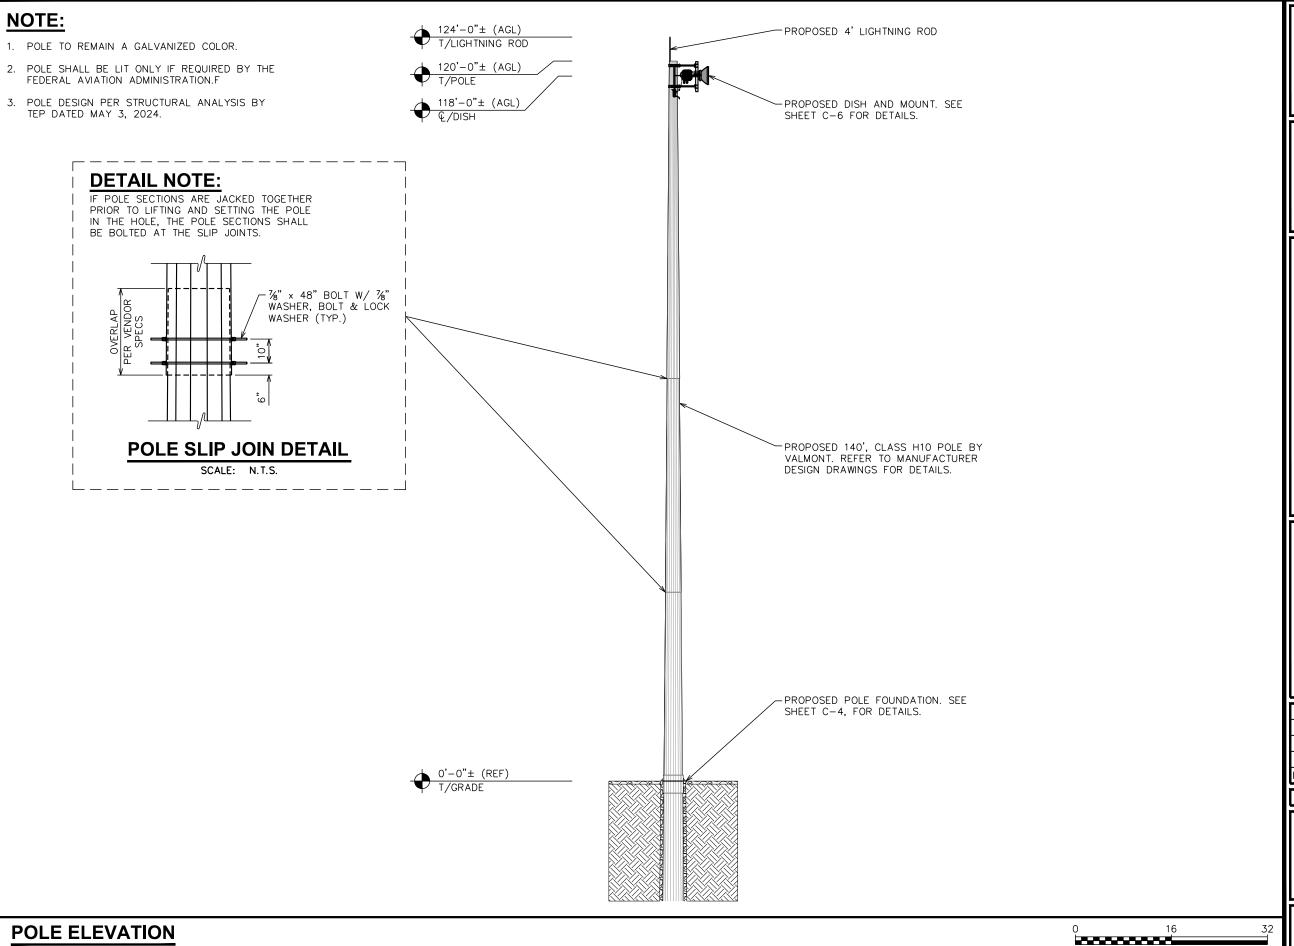

SCALE: $\frac{1}{6}$ = 1'-0"

PLANS PREPARED FOR:

DUKE
ENERGY.

401 SOUTH WILMINGTON STREET
RALEIGH, NC 27601
OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



REV.	DATE	ISSUED FOR:
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION
_		

DRAWN BY: RJW CHECKED BY: JBG

SHEET TITLE:

POLE ELEVATION

SHEET NUMBER:

REVISION:

TEP#: 337281.931510

SCALE IN FEET

REFERENCED DOCUMENTS DOCUMENT **REMARKS** DATE GEOTECHNICAL 03-11-24 REPORT PROJECT NO.: 337281.931518 POLE DESIGN VALMONT INDUSTRIES 06-22-22 DRAWINGS STRUCTURAL 05-03-24 ANALYSIS PROJECT NO.: 337281.931523

CONTRACTOR SHALL FIELD VERIFY ALL: DIMENSIONS, QUANTITIES, PART NUMBERS AND COAX/ANTENNA PLACEMENTS PRIOR TO: BIDDING ORDERING MATERIALS, AND CONSTRUCTION.

APPLIED LOADS			
AXIAL	13901 LBS		
MOMENT 1099036 LB-FT			
SHEAR 15015 LBS			
DESIGN REACTIONS TAKEN FROM THE STRUCTURAL ANALYSIS LISTED IN THE REFERENCED DOCUMENTS CHART ABOVE.			

DESIGN NOTE:

REFER TO VALMONT INDUSTRIES DRAWINGS FOR FINAL POLE AND FOUNDATION CONSTRUCTION, AND ASSEMBLY DETAILS. ANY INFORMATION SHOWN IN THIS DRAWING SHALL BE SUPERSEDED BY MANUFACTURER DESIGN DOCUMENTS.

FOUNDATION CONSTRUCTION:

THE FOUNDATION DESIGN IS BASED ON THE GEOTECHNICAL REPORT REFERENCED ABOVE. CONTRACTOR SHALL CONSULT THE GEOTECHNICAL REPORT PRIOR TO BIDDING AND CONSTRUCTION.

FOUNDATION DESIGN

TOP OD	BASE OD	EMBEDMENT DEPTH	OVERALL POLE LENGTH
37.27"	41.00"	20'	140.00'

NOTE:

BEARING PLATE DETAILS ARE SPECIFIED IN THE POLE MFG'S DRAWINGS. VERIFY PRIOR TO CONSTRUCTION.

BACKFILL NOTES:

- 1. HOLE SHALL BE EXCAVATED BY AN AUGER OF SUFFICIENT SIZE TO ALLOW A MINIMUM OF 6" BETWEEN THE SIDES OF THE HOLE AND THE POLE SO THAT PROPER TAMPING/RODDING OF THE GRAVEL BACKFILL CAN BE PERFORMED FROM THE BOTTOM OF THE HOLD TO THE GROUND SURFACE.
- 2. IF THE HOLE IS DRILLED DEEPER THAN REQUIRED. THE EXTRA DEPTH IS TO BE BACKFILLED WITH #57 STONE AND TAMPED BEFORE THE POLE IS SET. IF THE BOTTOM OF THE HOLE IS SOFT OR IF WATER IS IN THE HOLE, #57 STONE SHALL BE USED TO FILL THE OVER-EXCAVATION.
- 3. THE #57 STONE BACKFILL SHALL BE PLACED IN EVEN LIFTS WITH A MAXIMUM DEPTH OF 6" PER LIFT. THE STONE BACKFILL SHALL BE COMPACTED BY MECHANICALLY OR MANUALLY RODDING EACH LIFT AFTER PLACEMENT IN THE HOLE. THE MAXIMUM UNIFORM DENSITY FROM THE BOTTOM OF THE HOLE TO THE NATURAL GROUND SURFACE SHALL BE ATTAINED.
- 4. AFTER COMPLETION OF BACKFILLING, THE BACKFILL SHALL BE BANKED AROUND THE POLE TO AN ELEVATION OF 6" ABOVE THE EXISTING GRADE.

GROUND SLEEVE FINISHED STONE COMPACTED #57 WASHED STONE BACKFILL -6" MIN. 6" MIN. POLE DIA SEE CHART

SEE NOTE 1

PLANS PREPARED FOR: DUKE ENERGY. 401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



REV	DATE	ISSUED FOR:
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY: JB

SHEET TITLE:

TOWER FOUNDATION DETAIL & NOTES

SHEET NUMBER:

REVISION: **5**

TEP#:337281.931510

POLE FOUNDATION DETAIL

SCALE: N.T.S.

5

FOUNDATION NOTES:

- 1. FOUNDATION INSTALLATION TOLERANCES:
 - *SLAB TOLERANCE FOR BOTH LENGTH AND WIDTH: $\pm \frac{1}{2}$ "
 - *MEASURED DIAGONAL LENGTHS SHALL BE WITHIN 1/2" OF EACH OTHER *VARIATION FROM LEVEL:
 - A. IN ANY 10' OF LENGTH: 1/8" MAX
 - B. FOR THE ENTIRE LENGTH 1/2" MAX
 - *VARIATION FROM FLAT:
 - A. IN ANY 10' OF LENGTH: 1/8" MAX B. FOR THE ENTIRE LENGTH 1/8" MAX
- 2. USE SHIMS AS REQUIRED TO ASSURE CABINET IS BEARING AT PERIMETER. SEAL PERIMETER WITH CAULK OR GROUT AS DESIRED.
- THE MATERIAL USED FOR STRUCTURAL FILL SHALL CONFORM WITH ASTM C33 SIZE NO. 57 AND BE PLACED IN LOOSE LIFTS NOT EXCEEDING 8 INCHES. STRUCTURAL FILL SHALL BE MOISTURE CONDITIONED AS NECESSARY TO BRING MOISTURE CONTENT TO WITHIN 3% OF OPTIMUM AND COMPACTED TO 98% OF MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D698 OR 85% OF RELATED DENSITY AS DETERMINED BY ASTM D4254.
- 4. A MINIMUM OF 1'-0" SHOULD BE EXCAVATED AROUND FOUNDATION PERIMETER.

GENERAL STRUCTURAL NOTES:

SPECIFICATIONS / CODES:

SECTION


SCALE: $\frac{1}{2}$ " = 1'-0"


- 1. ALL CONCRETE WORK SHALL BE PERFORMED IN ACCORDANCE WITH LATEST EDITION OF THE ACI CODE.
- 2. STEEL WORK SHALL BE PERFORMED IN ACCORDANCE WITH AISC STEEL CONSTRUCTION MANUAL, 15th EDITION.
- ALL WELDING SHALL BE PERFORMED IN ACCORDANCE WITH AMERICAN WELDING SOCIETY (AWS) D1.1-15 "STRUCTURAL WELDING CODE-STEEL.
- 4. REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE CONCRETE REINFORCING STEEL INSTITUTE (CRSI). "MANUAL OF STANDARD PRACTICE".

NOTES:

- 1. SURFACE OF FINISHED SLAB SHALL BE LEVEL AND FLAT WITHIN 1/4"
- 2. CONTRACTOR TO VERIFY WITH MANUFACTURER ACTUAL DIMENSIONS AND BOLT LAYOUT OF CABINET PRIOR TO LAYING FOUNDATION
- 3. CONTRACTOR SHALL VERIFY DESIGN WITH ACTUAL SITE CONDITIONS. CONTRACTOR TO NOTIFY ENGINEER OF ANY DISCREPANCIES.
- 4. SLAB FOUNDATION DESIGNED ASSUMING ALLOWABLE SOIL BEARING PRESSURE OF 2000
- 5. CONCRETE STRENGTH SHALL BE A MINIMUM OF 4000 PSI.
- 6. FOOTING TO EXTEND TO A MINIMUM OF 24" BELOW UNDISTURBED SOIL OR 6" BELOW FROST

9'-0" (VERIFY CABINET DIMENSION)

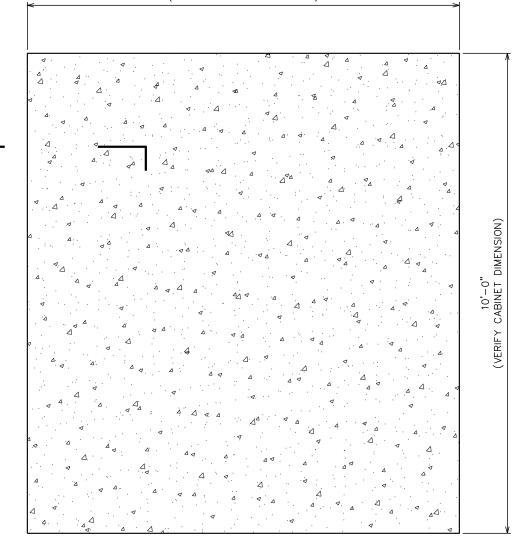

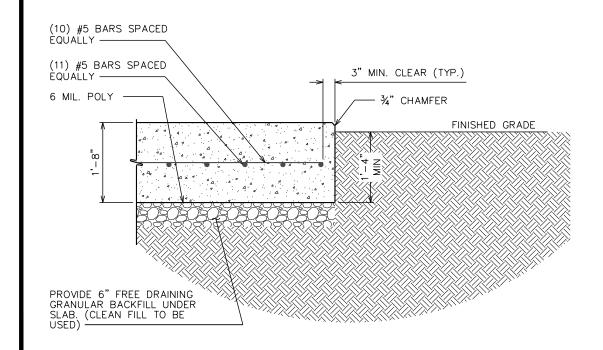

SCALE IN FEET

FOUNDATION PLAN

SCALE: $\frac{1}{2}$ " = 1'-0"

SCALE IN FEET

401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING. PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



REV	DATE	ISSUED FOR:
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION


RJW CHECKED BY: DRAWN BY:

SHEET TITLE:

EQUIPMENT ENCLOSURE FOUNDATION DETAILS

SHEET NUMBER:

REVISION:

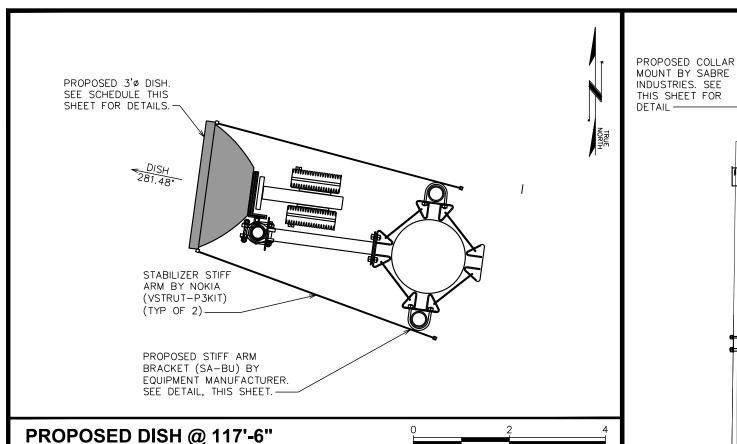

THIS SHEET FOR DETAIL

PROPOSED DISH

117'-6"

© MOUNT & DISH

PROPOSED 4.5" o x 5'-0"

MOUNT PIPE BY EQUIPMENT

MANUFACTURER

PROPOSED PIPE MOUNT.

SEE THIS SHEET FOR

DETAILS.

PLANS PREPARED FOR:

DUKE
ENERGY.

401 SOUTH WILMINGTON STREET

01 SOUTH WILMINGTON STREE RALEIGH, NC 27601 OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING. PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



5	11-25-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
3	10-24-24	CONSTRUCTION
2	07-16-24	PRELIMINARY CONSTRUCTION
REV	DATE	ISSUED FOR:

DRAWN BY: RJW CHECKED BY: JBG

SHEET TITLE:

ANTENNA MOUNTING DETAILS


SHEET NUMBER:


REVISION: 5

TEP#: 337281.9315

NOTE:

POLE DIAMETER AT 118'-0": ~17"ø

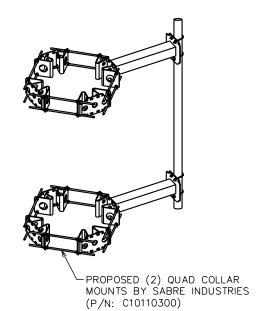



SCALE IN FEET

STIFF ARM BRACKET FOR 11/4"-31/2" PIPE

PROPOSED ANTENNA/CABLE SCHEDULE

TECHNOLOGY	MANUFACTURER (MODEL #)	MOUNTING HEIGHT	AZIMUTH	CABLE SIZE (mm)	CABLE LENGTH
DISH	COMMSCOPE (VHLPX3-11W/A)	↓	281.48°	(2) 11.6ø	*150'±
_	NOKIA (UBT-T)	1 2 9 110 0	201.40	(2) 11.02	150 1

^{*}CONTRACTOR SHALL FIELD VERIFY COAX LENGTH PRIOR TO CONSTRUCTION.

PROPOSED PIPE MOUNT

SCALE: N.T.S.

PROP. STIFF ARM BRACKET


SCALE: N.T.S.

PROPOSED ANTENNA/COAX SCHEDULE

PROPOSED COLLAR MOUNT PROFILE


SCALE: N.T.S.


SCALE: N.T.S.

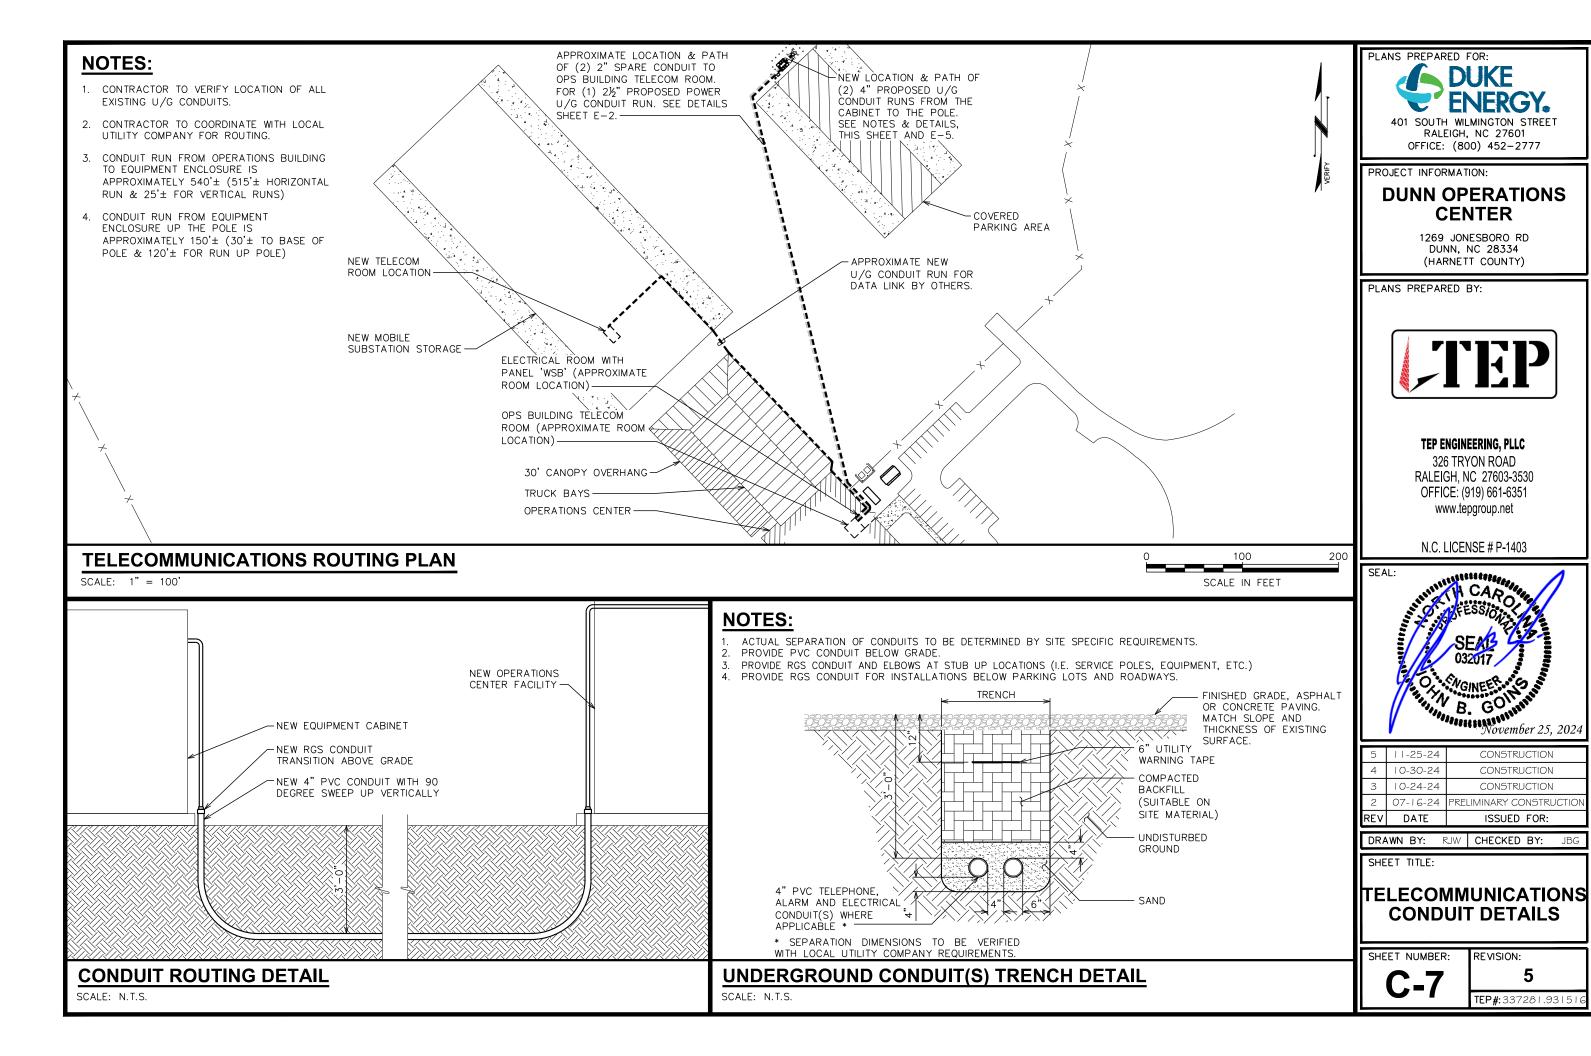





EQUIPMENT ENCLOSURE CABINET: (DDB UNLIMITED INC. P/N: 30D-90DDX)

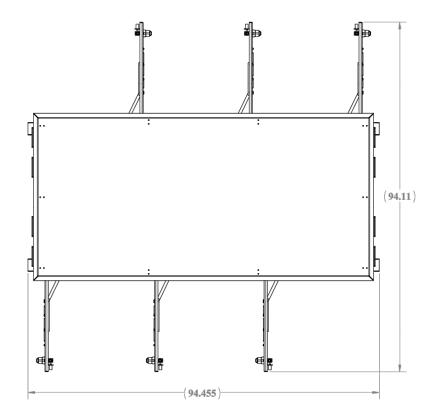

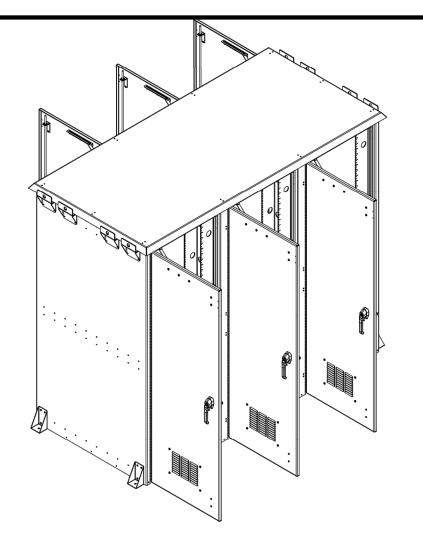

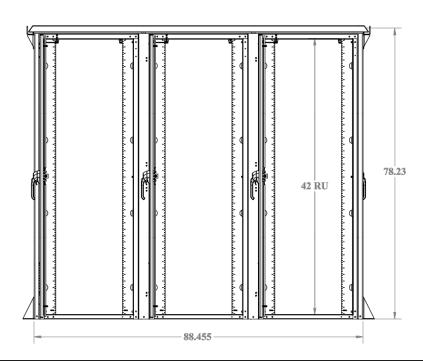

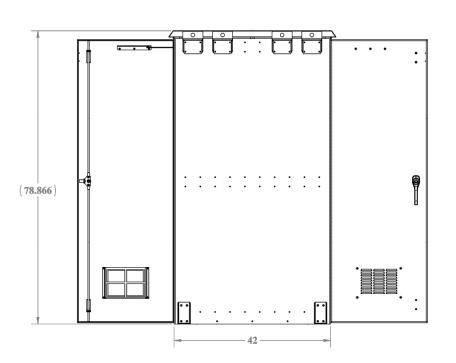

EQUIPMENT ENCLOSURE DETAIL

SCALE: N.T.S.



PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



5 11-25-24 CONSTRUCTION 4 10-30-24 CONSTRUCTION 3 10-24-24 CONSTRUCTION 2 07-16-24 PRELIMINARY CONSTRUCTION	RFV	DATE	ISSUED FOR:
4 10-30-24 CONSTRUCTION	2	07-16-24	PRELIMINARY CONSTRUCTION
	3	10-24-24	CONSTRUCTION
5 11-25-24 CONSTRUCTION	4	10-30-24	CONSTRUCTION
	5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY: JBG

SHEET TITLE:

EQUIPMENT ENCLOSURE DETAIL

SHEET NUMBER:

......

C-8

SCOPE:

PROVIDE LABOR, MATERIALS, INSPECTION, AND TESTING TO PROVIDE CODE COMPLIANCE FOR ELECTRIC, TELEPHONE, AND GROUNDING/LIGHTNING SYSTEMS.

CODES:

- 1. THE INSTALLATION SHALL COMPLY WITH APPLICABLE LAWS AND CODES. THESE INCLUDE BUT ARE NOT LIMITED TO THE LATEST ADOPTED EDITIONS OF:
 - A. THE NATIONAL ELECTRICAL SAFETY CODE
- D. LOCAL AND STATE AMENDMENTS
- B. THE NATIONAL ELECTRIC CODE NFPA-70
- E. THE INTERNATIONAL ELECTRIC CODE -
- IEC (WHERE APPLICABLE) C. REGULATIONS OF THE SERVING UTILITY COMPANY
- PERMITS REQUIRED SHALL BE OBTAINED BY THE CONTRACTOR.
- 3. AFTER COMPLETION AND FINAL INSPECTION OF THE WORK, THE OWNER SHALL BE FURNISHED A CERTIFICATE OF COMPLETION AND APPROVAL.

1. UPON COMPLETION OF THE INSTALLATION, OPERATE AND ADJUST THE EQUIPMENT AND SYSTEMS TO MEET SPECIFIED PERFORMANCE REQUIREMENTS. THE TESTING SHALL BE DONE BY QUALIFIED PERSONNEL.

- 1. IN ADDITION TO THE GUARANTEE OF THE EQUIPMENT BY THE MANUFACTURER, EACH PIECE OF EQUIPMENT SPECIFIED HEREIN SHALL ALSO BE GUARANTEED FOR DEFECTS OF MATERIAL OR WORKMANSHIP OCCURRING DURING A PERIOD OF ONE (1) YEAR FROM FINAL ACCEPTANCE OF THE WORK BY THE OWNER AND WITHOUT EXPENSE TO THE OWNER
- 2. THE WARRANTEE CERTIFICATES & GUARANTEES FURNISHED BY THE MANUFACTURERS SHALL BE TURNED OVER TO THE OWNER.

UTILITY CO-ORDINATION:

CONTRACTOR SHALL COORDINATE WORK WITH THE POWER AND TELEPHONE COMPANIES AND SHALL COMPLY WITH THE SERVICE REQUIREMENTS OF EACH UTILITY COMPANY.

EXAMINATION OF SITE:

1. PRIOR TO BEGINNING WORK, THE CONTRACTOR SHALL VISIT THE SITE OF THE JOB AND SHALL FAMILIARIZE HIMSELF WITH THE CONDITIONS AFFECTING THE PROPOSED ELECTRICAL INSTALLATION AND SHALL MAKE PROVISIONS AS TO THE COST THEREOF. FAILURE TO COMPLY WITH THE INTENT OF THIS SECTION WILL IN NO WAY RELIEVE THE CONTRACTOR OF PERFORMING THE WORK NECESSARY FOR A COMPLETE AND WORKING SYSTEM OR SYSTEMS.

CUTTING, PATCHING AND EXCAVATION:

- COORDINATION OF SLEEVES, CHASES, ETC., BETWEEN SUBCONTRACTORS WILL BE REQUIRED PRIOR TO THE CONSTRUCTION OF ANY PORTION OF THE WORK. CUTTING AND PATCHING OF WALLS, PARTITIONS, FLOORS, AND CHASES IN CONCRETE, WOOD, STEEL OR MASONRY SHALL BE DONE AS PROVIDED ON THE DRAWINGS.
- 2. NECESSARY EXCAVATIONS AND BACKFILLING INCIDENTAL TO THE ELECTRICAL WORK SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR UNLESS SPECIFICALLY NOTED OTHERWISE ON THE DRAWING.
- 3. SEAL PENETRATIONS THROUGH RATED WALLS, FLOORS, ETC., WITH APPROVED METHOD AS LISTED BY UL.

RACEWAYS / CONDUITS GENERAL:

- CONDUCTORS SHALL BE INSTALLED IN LISTED RACEWAYS. CONDUIT SHALL BE RIGID STEEL, EMT, SCH40 PVC, OR SCH80PVC AS INDICATED ON THE DRAWINGS. THE RACEWAY SYSTEM SHALL BE COMPLETE COMPLETE BEFORE INSTALLING CONDUCTORS.
- 2. EXTERIOR RACEWAYS AND GROUNDING SLEEVES SHALL BE SEALED AT POINTS OF ENTRANCE AND EXIT. THE RACEWAY SYSTEM SHALL BE BONDED PER NEC.

EXTERIOR CONDUIT:

- 1. EXPOSED CONDUIT SHALL BE NEATLY INSTALLED AND RUN PARALLEL OR PERPENDICULAR TO STRUCTURAL ELEMENTS. SUPPORTS AND MOUNTING HARDWARE SHALL BE HOT DIPPED GALVANIZED STEEL.
- 2. WHERE INSTALLED ON EXTERIOR STRUCTURES OR EXPOSED TO DAMAGE, THE CONDUIT SHALL BE RIGID STEEL.
- 3. UNDERGROUND CONDUITS SHALL BE RIGID STEEL, SCH40 PVC, OR SCH80 PVC AS INDICATED ON THE DRAWINGS.
- 4. BURIAL DEPTH OF CONDUITS SHALL BE AS REQUIRED BY CODE FOR EACH SPECIFIC CONDUIT TYPE AND APPLICATION, BUT SHALL NOT BE LESS THAN THE FROST DEPTH AT THE SITE.
- 5. CONDUIT ROUTES ARE SCHEMATIC. CONTRACTOR SHALL FIELD VERIFY ROUTES BEFORE BID. COORDINATE ROUTE WITH WIRELESS CARRIER AND/OR BUILDING OWNER.

INTERIOR CONDUIT:

- 1. CONCEALED CONDUIT IN WALLS OR INTERIOR SPACES ABOVE GRADE MAY BE EMT.
- 2. CONDUIT RUNS SHALL USE APPROVED COUPLINGS AND CONNECTORS. PROVIDE INSULATED BUSHING FOR ALL CONDUIT TERMINATIONS. CONDUIT RUNS IN A WET LOCATION SHALL HAVE WATERPROOF FITTINGS.
- PROVIDE SUPPORTS FOR CONDUITS IN ACCORDANCE WITH NEC REQUIREMENTS. CONDUITS SHALL BE SIZED AS REQUIRED BY NEC.

EQUIPMENT:

- 1. DISCONNECT SWITCHES SHALL BE SERVICE ENTRANCE RATED, HEAVY DUTY TYPE
- 2. CONTRACTOR SHALL VERIFY MAXIMUM AVAILABLE FAULT CURRENT AND COORDINATE INSTALLATION WITH THE LOCAL UTILITY BEFORE STARTING WORK. CONTRACTOR WILL VERIFY THAT EXISTING CIRCUIT BREAKERS ARE RATED FOR MORE THAN AVAILABLE FAULT CURRENT AND REPLACE AS NECESSARY.
- 3. NEW CIRCUIT BREAKERS SHALL BE RATED TO WITHSTAND THE MAXIMUM AVAILABLE FAULT CURRENT AS DETERMINED BY THE LOCAL UTILITY.

UL COMPLIANCE:

1. ELECTRICAL MATERIALS, DEVICES, CONDUCTORS, APPLIANCES, AND EQUIPMENT SHALL BE LABELED/LISTED BY UL OR ACCEPTED BY JURISDICTION (I.E., LOCAL COUNTY OR STATE) APPROVED THIRD PARTY TESTING AGENCY.

GROUNDING:

- 1. ELECTRICAL NEUTRALS, RACEWAYS AND NON-CURRENT CARRYING PARTS OF ELECTRICAL EQUIPMENT AND ASSOCIATED ENCLOSURES SHALL BE GROUNDED IN ACCORDANCE WITH NEC ARTICLE 250. THIS SHALL INCLUDE NEUTRAL CONDUCTORS, CONDUITS, SUPPORTS, CABINETS, BOXES, GROUND BUSSES, ETC. THE NEUTRAL CONDUCTOR FOR EACH SYSTEM SHALL BE GROUNDED AT A SINGLE POINT.
- 2. PROVIDE GROUND CONDUCTOR IN RACEWAYS PER NEC.
- 3. PROVIDE BONDING AND GROUND TO MEET NFPA 780 "LIGHTNING PROTECTION" AS A MINIMUM.
- 4. PROVIDE GROUNDING SYSTEM AS INDICATED ON THE DRAWINGS, AS REQUIRED BY THE NATIONAL ELECTRIC CODE, RADIO EQUIPMENT MANUFACTURERS, AND MOTOROLA R56 (AS APPLICABLE).

ABBREVIATIONS AND LEGEND

PNLBD - PANELBOARD AMPERE ABOVE FINISHED GRADE - AUTOMATIC TRANSFER SWITCH RGS - AMERICAN WIRE GAUGE AWG SW SWITCH

 BARE COPPER WIRE TOWER GROUND BAR TGB

- UNDERWRITERS LABORATORIES BELOW FINISHED GRADE UL BREAKER V

CONDUIT CIRCUIT DISCONNECT XMTR TRANSMITTER

EGR EXTERNAL GROUND RING - ELECTRIC METALLIC TUBING FSC FLEXIBLE STEEL CONDUIT

GEN GENERATOR

GPS GLOBAL POSITIONING SYSTEM

GRD GROUND

BCW

BFG

BKR

CKT

DISC

IGB ISOLATED GROUND BAR

IGR INTERIOR GROUND RING (HALO)

ΚW KILOWATTS

NATIONAL ELECTRIC CODE

- PERSONAL COMMUNICATION SYSTEM PCS

PHASE PANEL

- RIGID NON-METALLIC CONDUIT RIGID GALVANIZED STEEL CONDUIT

VOLTAGE W WATTS XFMR - TRANSFORMER

---E--- UNDERGROUND ELECTRICAL CONDUIT ----T--- UNDERGROUND TELEPHONE CONDUIT

KILOWATT-HOUR METER UNDERGROUND BONDING AND GROUNDING CONDUCTOR.

Ø GROUND ROD

EXOTHERMIC WELD

GROUND ROD WITH INSPECTION WELL

401 SOUTH WILMINGTON STREET RALEIGH, NC 27601

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

OFFICE: (800) 452-2777

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING. PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



REV	DATE	ISSUED FOR:
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION


DRAWN BY: RJW | CHECKED BY:

SHEET TITLE:

ELECTRICAL NOTES

REVISION:


SHEET NUMBER:

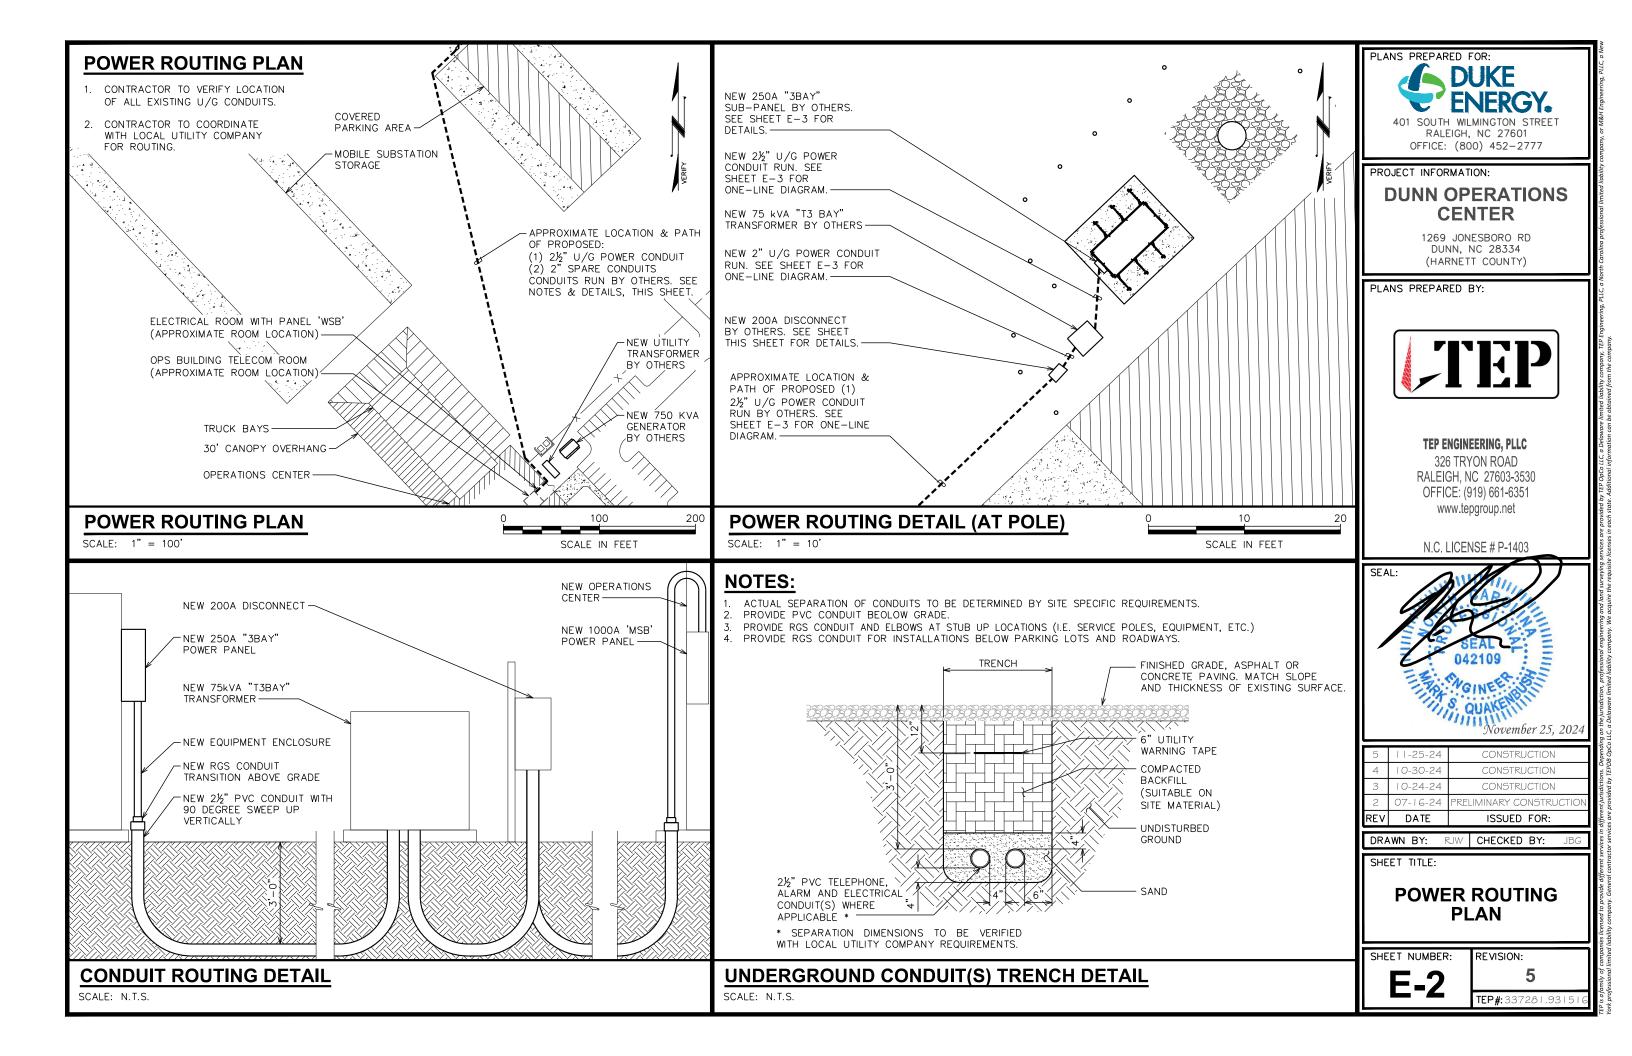

NOTES:

- TO CONTRACTOR TO VERIFY PANEL POWER USAGE PER BREAKER AS WELL AS NEW PANEL LOCATIONS FOR NEW EQUIPMENT.
- 2. CONTRACTOR TO VERIFY LOAD DOES NOT OVERLOAD SYSTEM.

PANEL 'MSB' 1000AMP, 277/280VAC, 3Ø/4W, AIC 42K														
LOAD SERVED		T AMPE		TRIP	CKT	PH	PHASE			TRIP	VOLT AMPERES (kW)			LOAD SERVED
	L1	L2	L3		#				#		L1	L2	L3	
	91.898				1	$ \mathcal{A} $	Α	-Д-	2		16.78			
MP1		90.44		400A	3	$ \mathcal{A} $	В	\bot	4	125A		16.6		3-BAY CAB XFMR
			97.24		5	$ \downarrow\downarrow $	С	\bot	6				0	
	80.177				7	\Box	Α		8		_			
MSH		79.24		400A	9		В	\downarrow	10	_		_		SPACE
			74.69		11	ГДТ	С		12				_	
	35.562				13		Α	-	14		_			
 WH		32.97		225A	15		В		16	_		-		SPACE
			32.194		17		С		18				_	
	_				19		Α	_ _	20		_			
PANEL HS		_		100A	21		В		22	_		_		SPACE
			_		23		С		24				_	
	_				25		Α	, ₋	26		_			
SPD		_		60A	27		В		28	_		_		SPACE
0.0			_	00/1	29		С	ĬŢ,	30				_	5
	_				31	$\int_{-\infty}^{\infty}$	Α	7 \	32		_			
SPACE		_		_	33		В		34	_		_		SPACE
3.7.02			_		35	$'$ \downarrow \uparrow	С	[]	36				_	31 7132
	_				37	f_{λ}^{\prime}	Α	\ \	38		_			
SPACE		_		_	39		В		40	_		_		SPACE
JI ACL			_		41	\mathcal{L}	С	1	42				_	31 ACL
VOLT (1750 (1772	00= 5	000.5-		<u> </u>	1 71	Т Т			T-Z		10 1	10.5		VOLT AV50 (111)
VOLT AMPS (kW)	207.64	202.65	204.12	?				_			16.78	16.6	0	VOLT AMPS (kW)
					L1	_	L2	\perp	L3	-				
					224.4	2 21	9.2	5 2	204.12	VOL	_T AMP	ERES ((kW)	
					810.1	8 79	91.5	2 7	'36.90	AMI	PS			
						81	0.18	8		MA:	X AMPS	5		
						10	12.7	' 3		MA	X AMPS	x125	%	

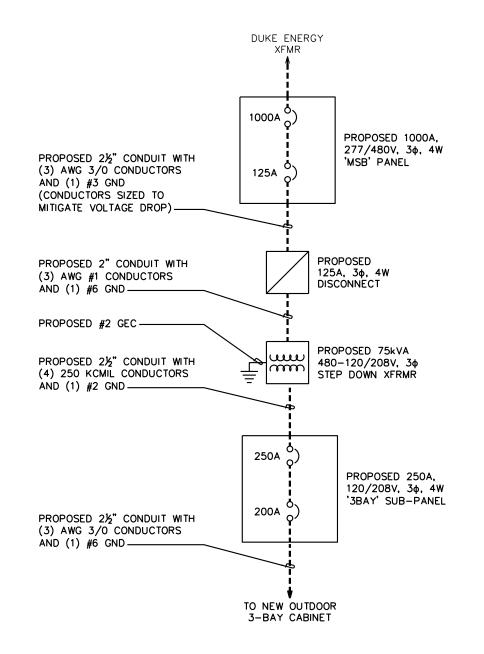

NOTES:

- I. UTILITY SERVICE SIZE UNKNOWN.
- 2. FOR COMPLETE INTERNAL WIRING AND ARRANGEMENT, REFER TO VENDOR PRINTS PROVIDED BY BUILDING MANAGER.
- 3. ELECTRICAL CONTRACTOR TO VERIFY LOAD DOES NOT EXCEED PANEL LIMITS, AND CONTACT ENGINEER OF RECORD FOR CORRECTIVE ACTION IF PANEL LIMITS ARE EXCEEDED.
- 4. ALL EXTERIOR ENCLOSURES TO BE NEMA 3 RATED.

PANEL SCHEDULE

SCALE: N.T.S.

ONE LINE DIAGRAM

SCALE: N.T.S.



PROJECT INFORMATION:

DUNN OPERATIONS CENTER

OFFICE: (800) 452-2777

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



DE.V	DATE	ISSUED FOR
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY: JBG

SHEET TITLE:

ONE-LINE DIAGRAM, PANEL SCHEDULE & NOTES

SHEET NUMBER:

E-3


REVISION: **5**

DRAWING NOTES:

- 1) EXOTHERMIC WELD FROM EXISTING GROUND SYSTEM (CONTRACTOR TO VERIFY LOCATION) TO GROUND BRACKET (TYP OF 2) ON POLE. SEE THIS SHEET FOR DETAILS.
- (2) EXOTHERMIC WELD (TYP)
- (3) POLE BOTTOM BUSS BAR
- (4) POLE BUSS BAR BONDING CONDUCTOR (TYP OF 2) TO EXISTING POLE GROUNDING BRACKETS
- 5 PROPOSED POLE
- (6) MECHANICAL GROUND LUG (TYP)
- (7) LPU (LIGHTNING PROTECTION UNIT)
- (8) GROUNDING BRACKET AT BOTTOM OF POLE (TYP OF 2). SEE DETAIL THIS SHEET.
- (9) MECHANICAL LUG CONNECTION TO EQUIPMENT ENCLOSURE
- (10) MECHANICAL LUG CONNECTION TO TRANSFORMER
- (11) MECHANICAL LUG CONNECTION TO DISCONNECT
- 12) MECHANICAL LUG CONNECTION TO SUB-PANEL

GROUNDING NOTES

- 1. CONTRACTOR SHALL VERIFY THAT GROUNDING ELECTRODES SHALL BE CONNECTED IN A RING USING 2/0 AWG OR 4/0 AWG (CONTRACTOR TO VERIFY EXISTING GROUND MAT SIZING) BARE TINNED COPPER WIRE, THE TOP OF THE GROUND RODS AND THE RING CONDUCTOR SHALL BE 30" BELOW FINISHED GRADE. GROUNDING ELECTRODES SHALL BE DRIVEN ON 10'-0" CENTERS. (MINIMUM; 15'-0" MAX, PROVIDE AND INSTALL AS REQUIRED PER PLAN BELOW).
- 2. GROUND RING CONNECTION CONDUCTORS SHALL BE OF EQUAL LENGTH, MATERIAL, AND BONDING TECHNIQUE.
- PROVIDE AND INSTALL GROUNDING CONNECTIONS SHOWN BELOW AS NEEDED PER EXISTING SITE GROUNDING SYSTEM.
 CONTRACTOR SHALL VERIFY ALL EXISTING SITE GROUNDING CONDITIONS BEFORE STARTING WORK OR PURCHASING
 EQUIPMENT.
- 4. BOND POLE GROUND BAR TO EXTERNAL GROUND RING WITH 2 RUNS OF 2/O OR 4/O AWG (CONTRACTOR TO VERIFY EXISTING GROUND MAT SIZING) BARE, TINNED, SOLID COPPER CONDUCTOR IN PVC. CONNECT BAR END WITH 2 HOLE LUG, AND EXOTHERMICALLY WELD THE OTHER END TO THE EXTERNAL GROUND ROD.
- 5. BONDING CONDUCTORS SHALL BE ROUTED THROUGH A 3/4" PVC CONDUIT SLEEVE RUN UNDER THE FOUNDATION. REFER TO THE GROUNDING PLAN BELOW.
- 6. ALL CONDUIT, GROUND GRID CONDUCTOR AND UNDERGROUND FEEDER CIRCUIT LOCATIONS ARE APPROXIMATE. HAND DIG TO A MINIMUM OF 36" PRIOR TO MACHINERY EXCAVATIONS WHERE THERE IS A POTENTIAL FOR IMPACTING EXISTING UNDERGROUND COMPONENTS.

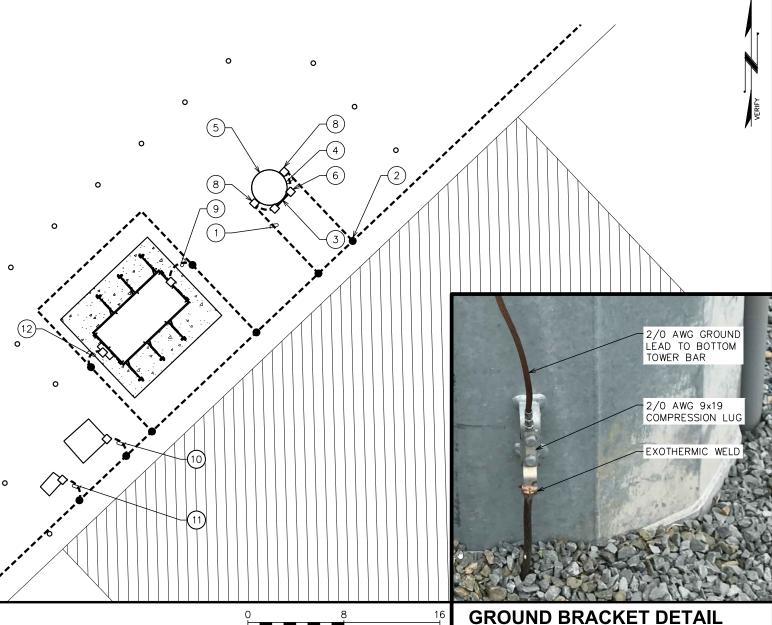

PLANS PREPARED FOR:

DUKE
ENERGY.

401 SOUTH WILMINGTON STREET
RALEIGH, NC 27601

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

OFFICE: (800) 452-2777

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



	REV	DATE	ISSUED FOR:
	2	07-16-24	PRELIMINARY CONSTRUCTION
	3	10-24-24	CONSTRUCTION
	4	10-30-24	CONSTRUCTION
ľ	5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY:

SHEET TITLE:

POLE GROUNDING AND ROUTING PLAN

SHEET NUMBE

REVISION:

TEP#:337281.93151


POLE GROUNDING PLAN

SCALE: 1/8" = 1'-0"

SCALE: N.T.S.



INSTALLATION PER INFINITY DUKE ENERGY NOKIA UBT INTERCONNECT INSTALLATION SCHEMATIC DRAWINGS, DATED 11/7/2024. CONTRACTOR TO REFER TO SUPPLIER FOR BOM AND INSTALLATION DETAILS.

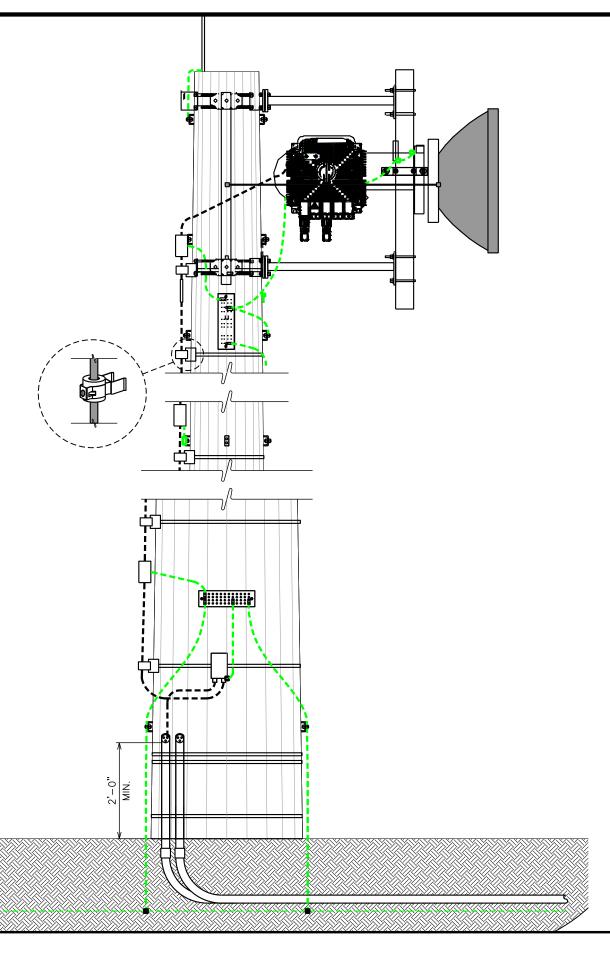

PLANS PREPARED FOR:

DUKE
ENERGY.

401 SOUTH WILMINGTON STREET RALEIGH, NC 27601 OFFICE: (800) 452-2777

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)


PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403



F	REV	DATE	ISSUED FOR:
	2	07-16-24	PRELIMINARY CONSTRUCTION
	3	10-24-24	CONSTRUCTION
	4	10-30-24	CONSTRUCTION
	5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY: JB

SHEET TITLE:

GROUNDING AND CABLE ELEVATION

SHEET NUMBER:


REVISION:

TEP#: 337281.9315

MONOPOLE ELEVATION


SCALE: N.T.S.

0) | is a family of co

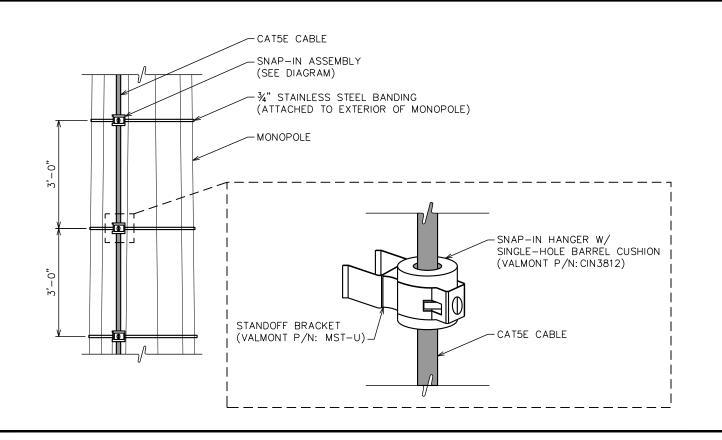

MONOPOLE GROUNDING

SCALE: N.T.S.

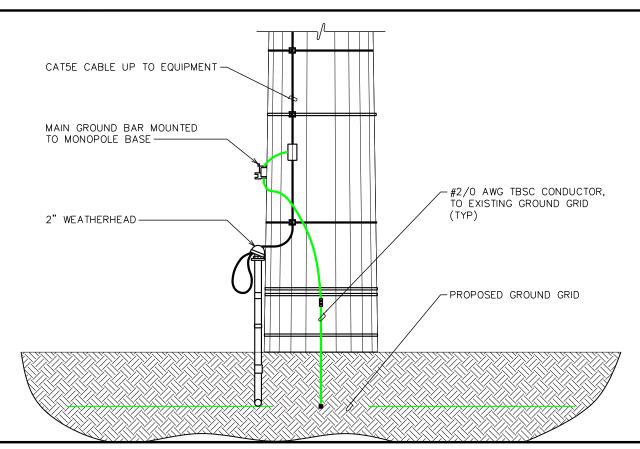

MONOPOLE BASE DETAIL (SIDE VIEW)

SCALE: N.T.S.

PLANS PREPARED FOR:

DUKE
ENERGY.

401 SOUTH WILMINGTON STREET
RALEIGH, NC 27601

PROJECT INFORMATION:

DUNN OPERATIONS CENTER

OFFICE: (800) 452-2777

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

PLANS PREPARED BY:



TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P 1403



4 10-30-24 CONSTRUCTION 3 10-24-24 CONSTRUCTION 2 07-16-24 PRELIMINARY CONSTRUCTION	DE.
	2
4 10-30-24 CONSTRUCTION	3
	4
5 11-25-24 CONSTRUCTION	5

DRAWN BY: RJW CHECKED BY: JBG

SHEET TITLE:


GROUNDING DETAILS I

E-6

REVISION:


TEP#:337281.93151

516

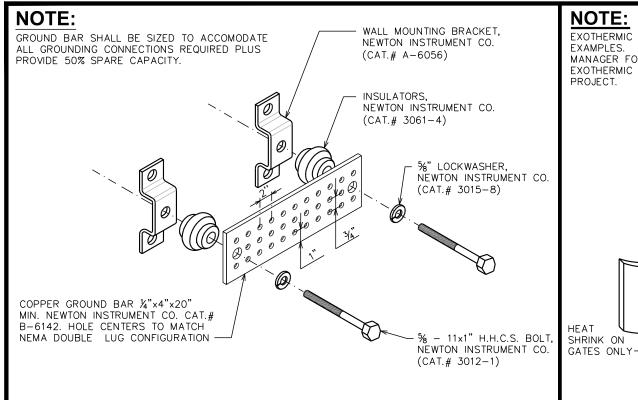


NOTE:


EXOTHERMIC WELD "TYPES" SHOWN ARE EXAMPLES. CONSULT WITH PROJECT MANAGER FOR SPECIFIC TYPES OF EXOTHERMIC WELDS TO BE USED FOR THIS

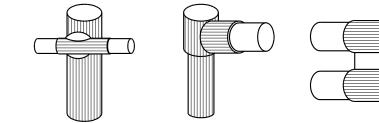






TYPE GR



TYPE GY

TYPE NC



TYPE VB (POLE GROUNDING TAB)

PLANS PREPARED BY:

PROJECT INFORMATION:

401 SOUTH WILMINGTON STREET

RALEIGH, NC 27601 OFFICE: (800) 452-2777

DUNN OPERATIONS

CENTER

1269 JONESBORO RD DUNN, NC 28334 (HARNETT COUNTY)

TEP ENGINEERING, PLLC

326 TRYON ROAD RALEIGH, NC 27603-3530 OFFICE: (919) 661-6351 www.tepgroup.net

N.C. LICENSE # P-1403


STANDARD GROUND BAR DETAIL


SCALE: N.T.S.

EXOTHERMIC WELD DETAILS


TYPE VBC

SCALE: N.T.S.

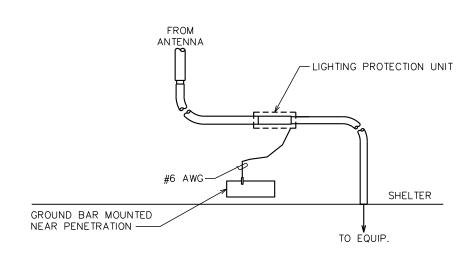

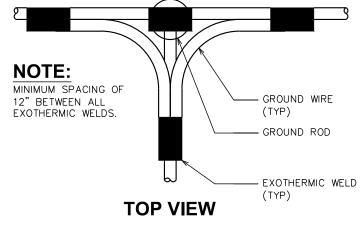


TYPE GT



SIDE VIEW

EXOTHERMIC WELD GROUNDING DETAIL



REV	DATE	ISSUED FOR:
2	07-16-24	PRELIMINARY CONSTRUCTION
3	10-24-24	CONSTRUCTION
4	10-30-24	CONSTRUCTION
5	11-25-24	CONSTRUCTION

DRAWN BY: RJW CHECKED BY:

SHEET TITLE:

GROUNDING DETAILS II

E-7

REVISION:

TEP#: 337281.93

POE CABLE GROUNDING DETAIL