

HTE# EH1910-0007

Harnett County Department of Public Health

25241

PERMIT # 30230

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 745 SHANTOWN RD

Name: (owner) HARNETT COUNTY SUBDIVISION _____ LOT # _____

System Installer: LARRY SHARPE Registration # _____


Basement with plumbing: Garage Number of Bedrooms EXT. OFFICE (200 sq ft)

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

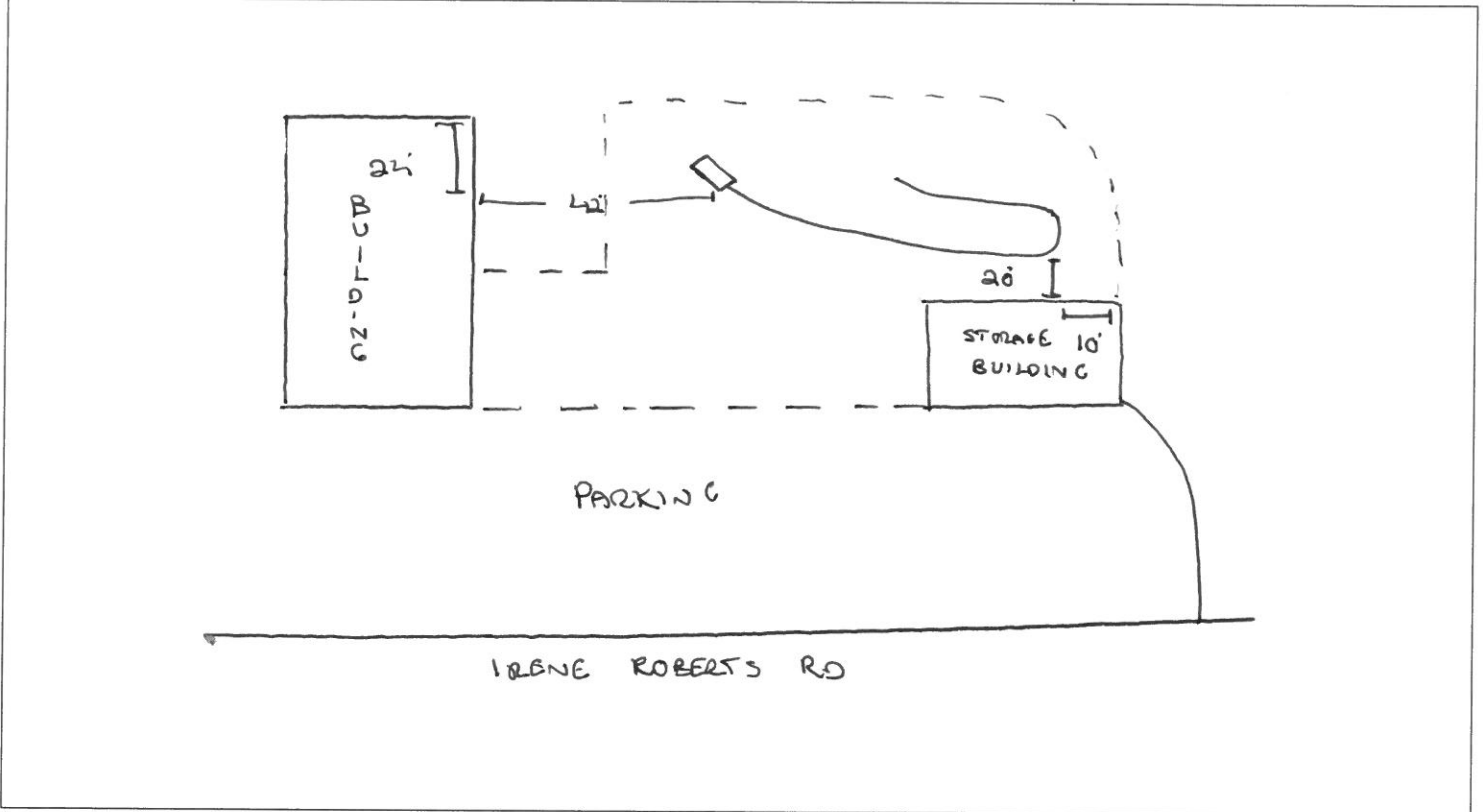

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other TREE CHIPS Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 1 exact length of each ditch 90 feet width of ditches 3 feet depth of ditches 20-30 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REAS

Date 11/1/18

Customer: 0369650001 / Larry Sharpes

		Scale
Gross:	42080 LBS	Out Manual Wt
Tare:	22220 LBS	In Manual Wt
Net:	19860 LBS	

Generator: NA / Not Applicable
 Dest: DEST: CUSTOMER / Customer
 Truck: LARRY SHAR

Comment:

Origin	Wastes & Sevices	Quantity Unit	Rate/Unit	Amount
NA / Not Applicable	DFMT116/Drain Fill Material	9.93 TON	\$25.00/TN	\$248.25
			Total Taxes:	\$17.38
			Total Amount:	\$265.63

Driver: _____

Deputy Weighmaster: Libby Cameron

This load of fire chips is from the Fuel Grade location and meets the No specification as stated in innovative wastewater system approval IWWS-2002-03R for fire chip Substitution for Rock Aggregate in Nitrification Fields.