

Harnett County Department of Public Health Improvement Permit

A building permit cannot be issued with only an Improvement Permit

PROPERTY LOCATION: 4195 McNeill Rd.

ISSUED TO: Cynthia McKoy SUBDIVISION Hunters Pointe LOT # 5

NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization Issuance: _____

Type of Structure: Existing 3-bedroom MH

Proposed Wastewater System Type: 25% Reduction System / Conventional

Projected Daily Flow: 360 GPD

Number of bedrooms: 3 Number of Occupants: 6 max

Basement Yes No

Pump Required: Yes No May be required based on final location and elevations of facilities

Type of Water Supply: Community Public Well Distance from well 50 feet Permit valid for: Five years No expiration

Permit conditions: _____

Authorized State Agent: [Signature] Date: 04/30/2019 04/10/2019 (AIC) SEE ATTACHED SITE SKETCH

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization (Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Cynthia McKoy PROPERTY LOCATION: 4195 McNeill Rd.

SUBDIVISION Hunters Pointe LOT # 5

Facility Type: Existing 3-bedroom MH New Expansion Repair

Basement? Yes No Basement Fixtures? Yes No

Type of Wastewater System** Not Applicable (Initial) Wastewater Flow: 360 GPD

(See note below, if applicable)

25% Reduction System Conventional (Repair)

Installation Requirements/Conditions

Septic Tank Size Ext. gallons Exact length of each trench 78 75 feet Trench Spacing: 9 Feet on Center

Pump Tank Size _____ gallons Trenches shall be installed on contour at a 21 18 inches Soil Cover: 10 inches

Maximum Trench Depth of: 22 inches (Maximum soil cover shall not exceed 36" above the trench bottom)

(Trench bottoms shall be level to +/- 1/4" in all directions)

Pump Requirements: _____ ft. TDH vs. _____ GPM Aggregate Depth: NA inches below pipe NA inches above pipe

Conditions: 50ft Well Setback; 300ft conv. permissible if available space; PVC tee/filter added req. NA inches total

**WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.**

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: [Signature] Date: AIC 04/10/2019 04/30/2019

ANDREW CURRIN Construction Authorization Expiration Date: AIC 04/10/2024 04/30/2024

HTE# EH1902-0011


Permit # N/A

Harnett County Department of Public Health Site Sketch

PROPERTY LOCATION: 4195 McNeill Rd (SL 1224)

ISSUED TO: Cynthia Deloris McKay SUBDIVISION Hunters Pointe LOT # 5

Authorized State Agent: Andrew Curran Date: 04/10/2019 (AIL)
130' 04/30/2019.

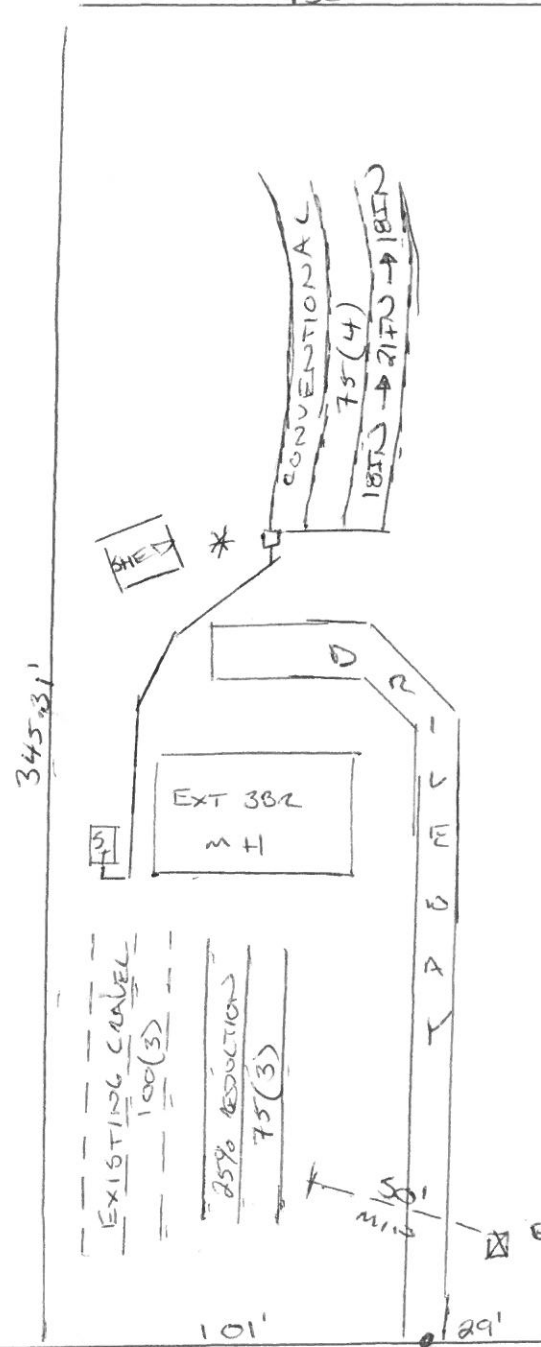

- * 50FT EXT well setback
- * EXT WATER AND POWER SHALL BE LOCATED PRIOR TO INSTALL
- * 10FT WATER LINE SETBACK [MAY REQUIRE RELOCATION]
- * D-BOX MAY REQ. REPLACEMENT
- * 300FT CONVENTIONAL IF AVAILABLE SPACE
- * TANK SHALL BE UNCOVERED, PUMPED AND INSPECTED W/ AFFLUENT FILTER AND
- EXISTING WELL PUC TEE ADDED

MCNEILL RD (SL 1224)