

# Harnett County Department of Public Health

163 Enrol DC

PERMIT # EH1904-0003

## Operation Permit

- New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 561425 Ashe Ave to SE NEW TOWN RD

Name: (owner) Kenneth Johnson SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: Thomas Cooper


Basement with plumbing:  Garage  Number of Bedrooms 2

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: 15% REDUCTION System Chamber Quaker 4 Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

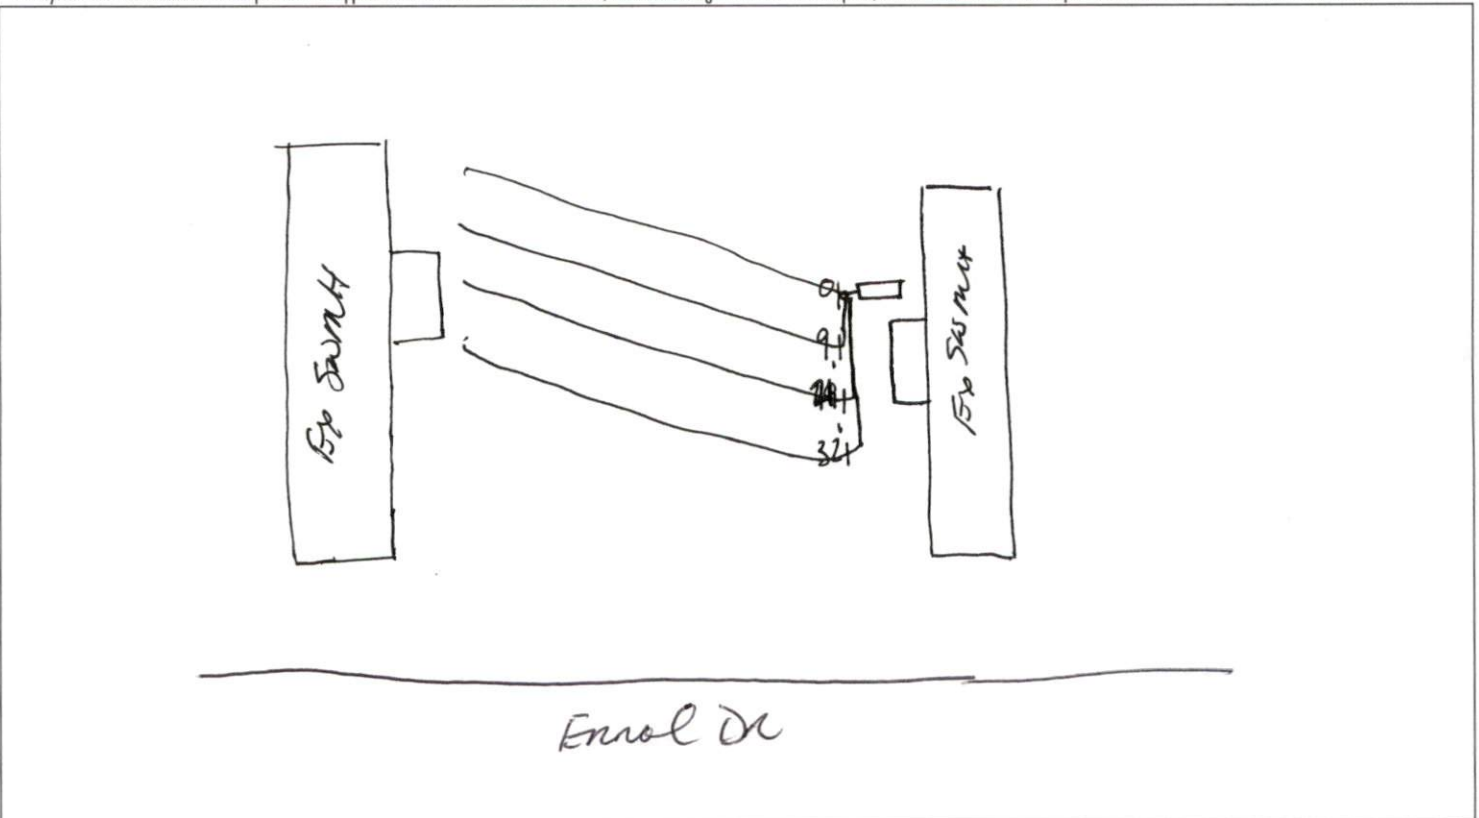

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

- \_\_\_\_\_ D-Box  
  \_\_\_\_\_ Pump  
  \_\_\_\_\_ Alarm  
  \_\_\_\_\_ H2O Line  
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  
  Other 15% REDUCTION  
 Septic Tank: 1000 gallons  
 Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 4 of each ditch 50' feet ditches 3 feet ditches 20'-18" inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Manhart <sup>PHS</sup> <sub>26MS</sub> Date 6-24-21