

HTE# EH 1912-0010

Harnett County Department of Public Health

25727

PERMIT # Repair

Operation Permit

- New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: SR 1709 Hodges Chapel CH RD

Name: (owner) DAVID CLIFTON SUBDIVISION _____ LOT # _____

System Installer: GRAD A Septic Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 50' feet

System Type: 25% Reduction System Type III G ELLAY Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

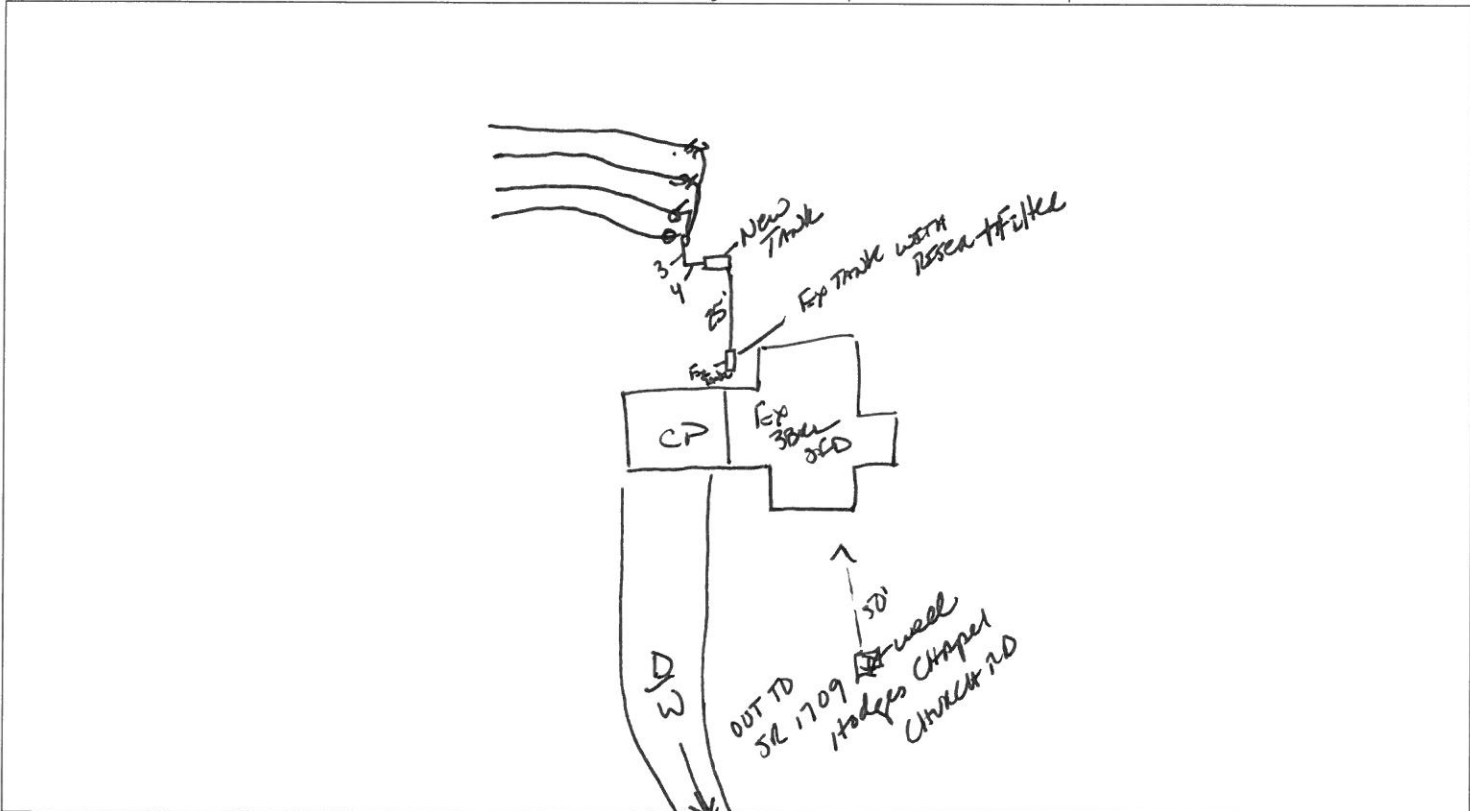

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other III G ELLAY Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 4 of each ditch 60 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Marchant for 2015 Date 12-27-19