

HTE# EHP12-0019

Harnett County Department of Public Health

25806

PERMIT # _____

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 936 Nursery Rd, Lillington

Name: (owner) Noelyne Langston SUBDIVISION _____ LOT # _____

System Installer: Larry Sharpe Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 50+ feet

System Type: fire chip conventional IIa Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

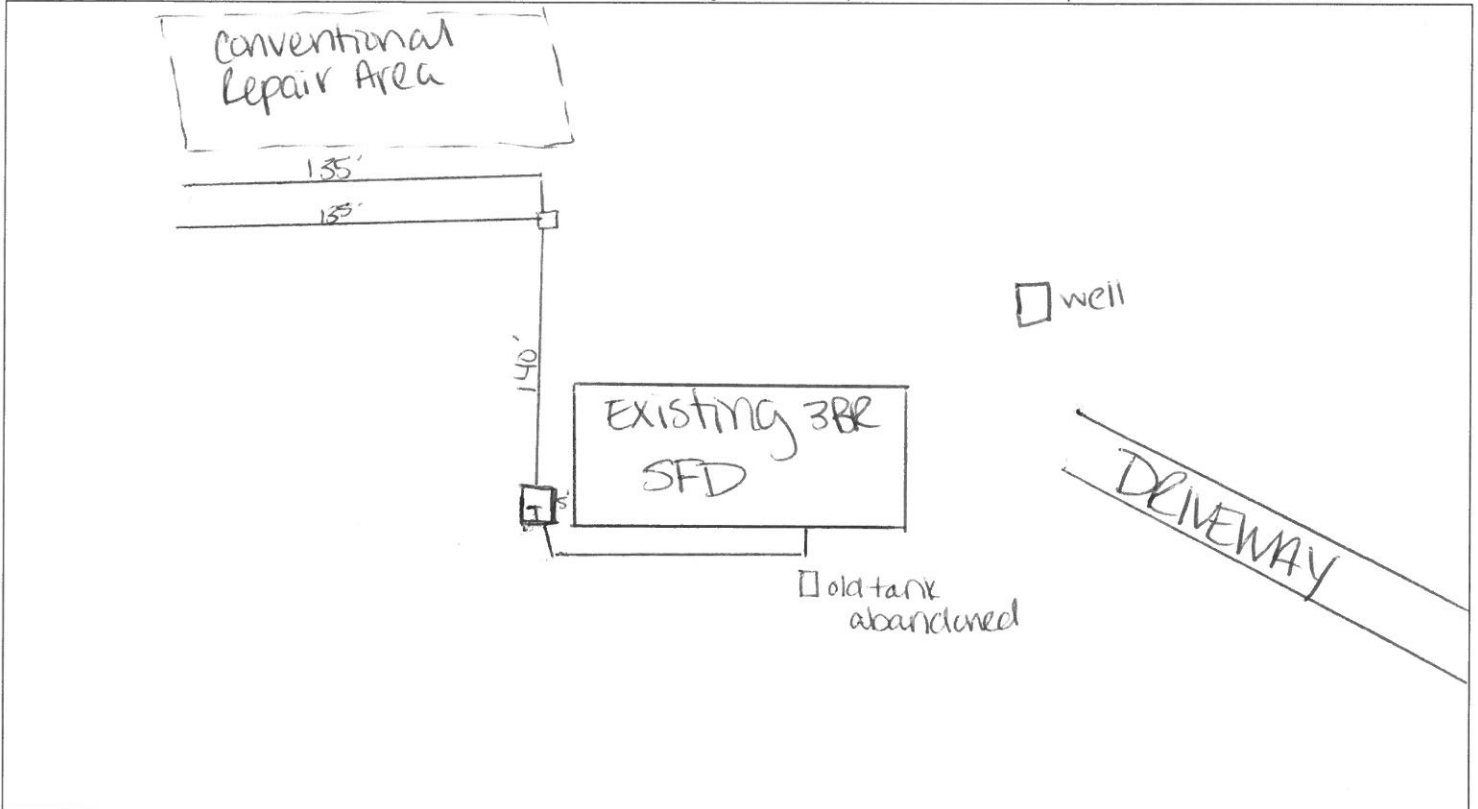

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of fire chip exact length width of depth of
Drainage Field ditches 2 of each ditch 135 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 1/6/2020

Central Carolina Holdings

Ticket: 1813054

Date: 1/2/2020

Time: 13:25:34 - 13:41:41

Customer: 0369650001 / Larry Sharpes

| | | |
|--------|-----------|---------------|
| | | Scale |
| Gross: | 43440 LBS | Out Manual Wt |
| Tare: | 22140 LBS | In Manual Wt |
| Net: | 21300 LBS | |

Generator: NA / Not Applicable

Dest: DEST: CUSTOMER / Customer

Truck: LARRY SHAR

Comment:

| Origin | Wastes & Services | Quantity | Unit | Rate/Unit | Amount |
|---------------------|-----------------------------|----------|------|---------------|----------|
| NA / Not Applicable | DFMT116/Drain Fill Material | 10.65 | TON | \$25.00/TN | \$266.25 |
| | | | | Total Taxes: | \$18.64 |
| | | | | Total Amount: | \$284.89 |

Driver: _____

Deputy Weighmaster: Libby Cameron

Libby Cameron

This load of tire chips is from the Fuel Grade location and meets the NC specification as stated in Innovative Wastewater system approval IWWS-2002-03R for the tire chip Substitution for Rock Aggregate in Nitrification Fields.