

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: Applicant: **Mike Dunn**
 Address: **Office/shower** Date Evaluated: **1-28-2020**
 Proposed Facility: **1616 Mokooy Town** Design Flow (.1949): **300 GPD** Property Size:
 Location of Site: **1616 Mokooy Town** Property Recorded:
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

5 Employees
↳ shower when entering + leaving
↳ wash clothes daily

| P R O F I L E # | .1940 Landscape Position/ Slope % | Horizon Depth (In.) | SOIL MORPHOLOGY .1941 | | OTHER PROFILE FACTORS | | | | Profile Class & LTAR | |
|--------------------------------------|--|---------------------------|--------------------------------|------------------------------------|------------------------------------|------------------------------|-------------------------|-------------------------|----------------------------|----------------|
| | | | .1941 Structure/ Texture | .1941 Consistence Mineralogy | .1942 Soil Wetness/ Color | .1943 Soil Depth (IN.) | .1956 Sapro Class | .1944 Restr Horiz | | |
| 1,2 | L CS | 0-18 | BK SCL | Fi | SEXP | SSSP | | | | |
| | | 18+ | | | | G14 | | | | UN |
| 3 | L CS | 0-20 | GR SL | VFR | SEXP | NSNP | | | | |
| | | 20-32 | BK SCL | Fi | SEXP | SSSP | 32" | | | UN → PS 0.4 |
| 4,5 | L CS | 0-12 | GR SL | VFR | SEXP | | | | | |
| | | 12-28 | BK SCL | Fi | SEXP | SSSP | PM@28 | 28" | | UN → PS 0.4 |

| | | | |
|-------------------------|----------------|----------------|--|
| Description | Initial System | Repair System | Other Factors (.1946): |
| Available Space (.1945) | | | Site Classification (.1948): Provisionally suitable |
| System Type(s) | 25% Red | 25% Red | Evaluated By: Brittany Adams |
| Site LTAR | 0.4 | 0.4 | Others Present: |


COMMENTS: _____

| LANDSCAPE POSITIONS | GROUP | TEXTURES | .1955 LTAR | CONSISTENCE MOIST | WET |
|---------------------|-------|---------------------|------------|--------------------------------|--|
| R-RIDGE | I | S-SAND | 1.2 - 0.8 | VFR-VERY FRIABLE FR-FRIABLE | NS-NON-STICKY SS-SLIGHTLY STICKY |
| S-SHOULDER SLOPE | | LS-LOAMY SAND | | | |
| L-LINEAR SLOPE | II | SL-SANDY LOAM | 0.8 - 0.6 | FI-FIRM VFI-VERY FIRM | S-STICKY VS-VERY STICKY |
| FS-FOOT SLOPE | | L-LOAM | | | |
| N-NOSE SLOPE | III | SI-SILT | 0.6 - 0.3 | EFI-EXTREMELY FIRM | NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC |
| H-HEAD SLOPE | | SIL-SILT LOAM | | | |
| CC-CONCLAVE SLOPE | | CL-CLAY LOAM | | | |
| CV-CONVEX SLOPE | | SCL-SANDY CLAY LOAM | | | |
| T-TERRACE | IV | SIC-SILTY CLAY | 0.4 - 0.1 | C-CLAY SC-SANDY CLAY | |
| FP-FLOOD PLAN | | | | | |

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, references or benchmark, and North)

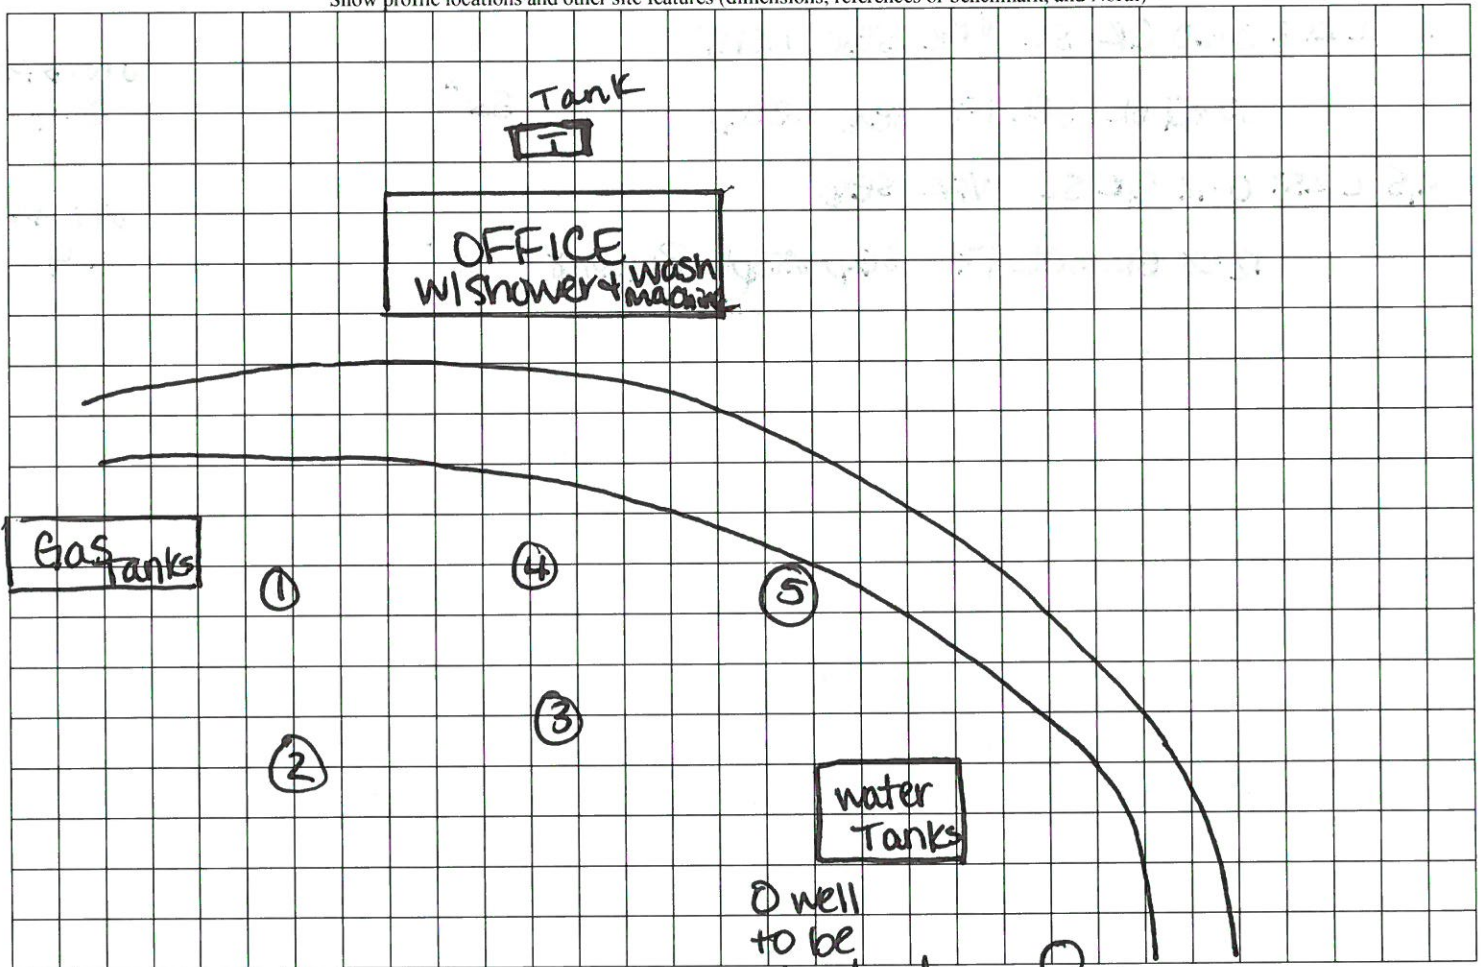

Handwritten notes at the bottom left of the grid.

Handwritten note: well to be abandoned (not used anymore)

Handwritten note: well