

HTE# EA2002-0004

Harnett County Department of Public Health

26017

PERMIT # NA

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 5291 COKESBOLT RD (521403)

Name: (owner) ROY HYKAL SUBDIVISION KINTWOOD ESTS LOT # 4

System Installer: JUNIOR CARDENAS Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 504 feet

System Type: 2590 REDUCTIONS SIS. ITC Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

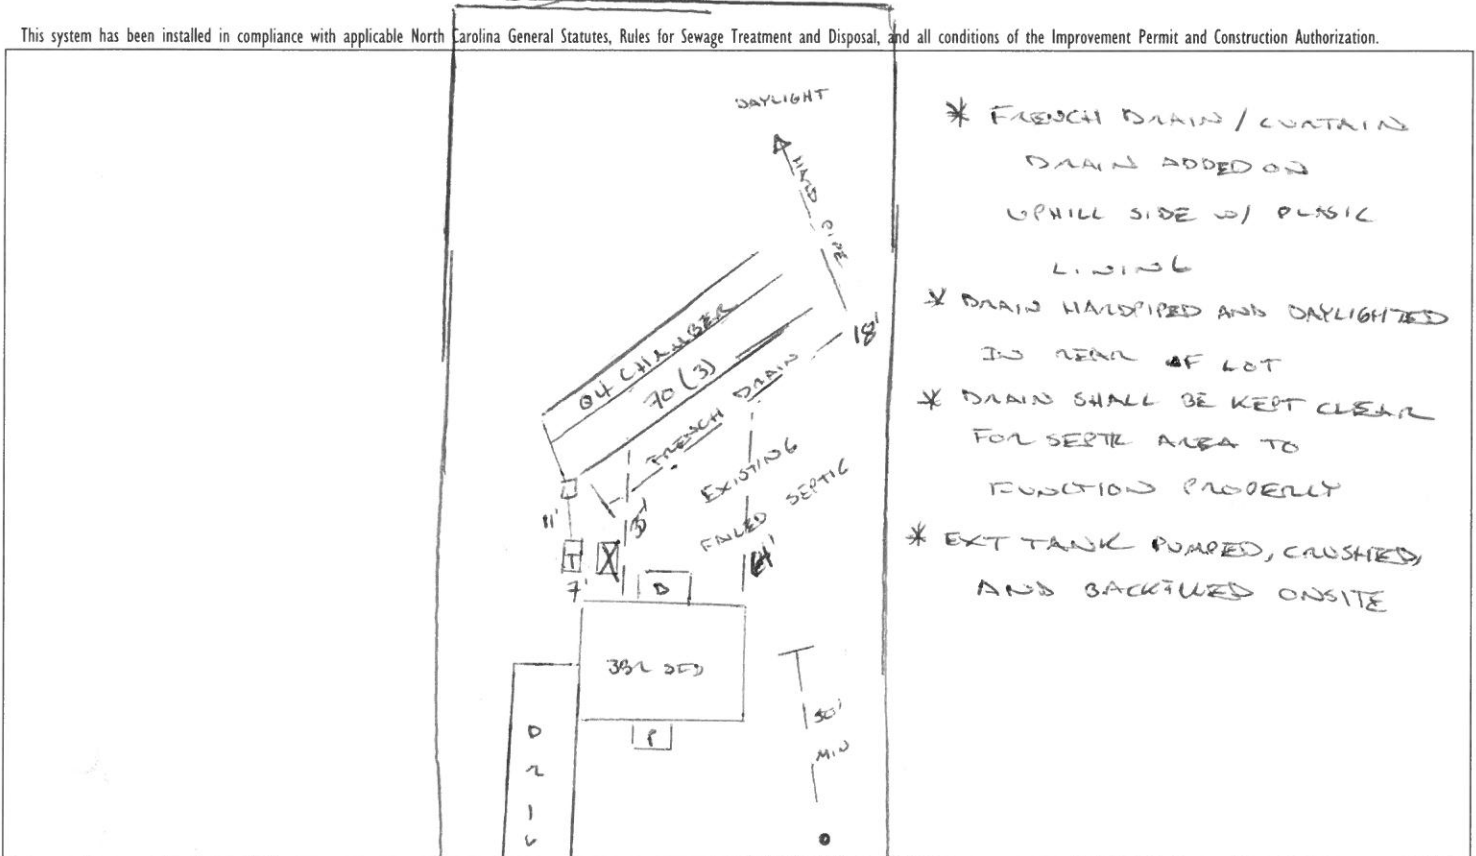

- * FRENCH DRAIN / CONTAIN DRAIN ADDED ON UPHILL SIDE w/ PLASTIC LINING
- * DRAIN HALOPIPED AND DAYLIGHTED IN REAR OF LOT
- * DRAIN SHALL BE KEPT CLEAR FOR SEPTIC AREA TO FUNCTION PROPERLY
- * EXT TANK PUMPED, CRUSHED AND BACKFILLED ON SITE

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961. COKESBOLT RD (521403)
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 04 chambers ITC Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 70 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent

Date 03/30/2020