

# Harnett County Department of Public Health

F

PERMIT # EH2003-0003

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 132 Irene Roberts RD

Name: (owner) Robert Tucker      SUBDIVISION \_\_\_\_\_      LOT # \_\_\_\_\_

System Installer: A+R Enterprises

Basement with plumbing:  Garage  Number of Bedrooms 7 People max 420 GALLONS/24 HRS

Type of Water Supply:  Community    Public    Well   Distance from well \_\_\_\_\_ feet


System Type: Pump to 25% REDUCTION SYSTEM      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Chamber 2004

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

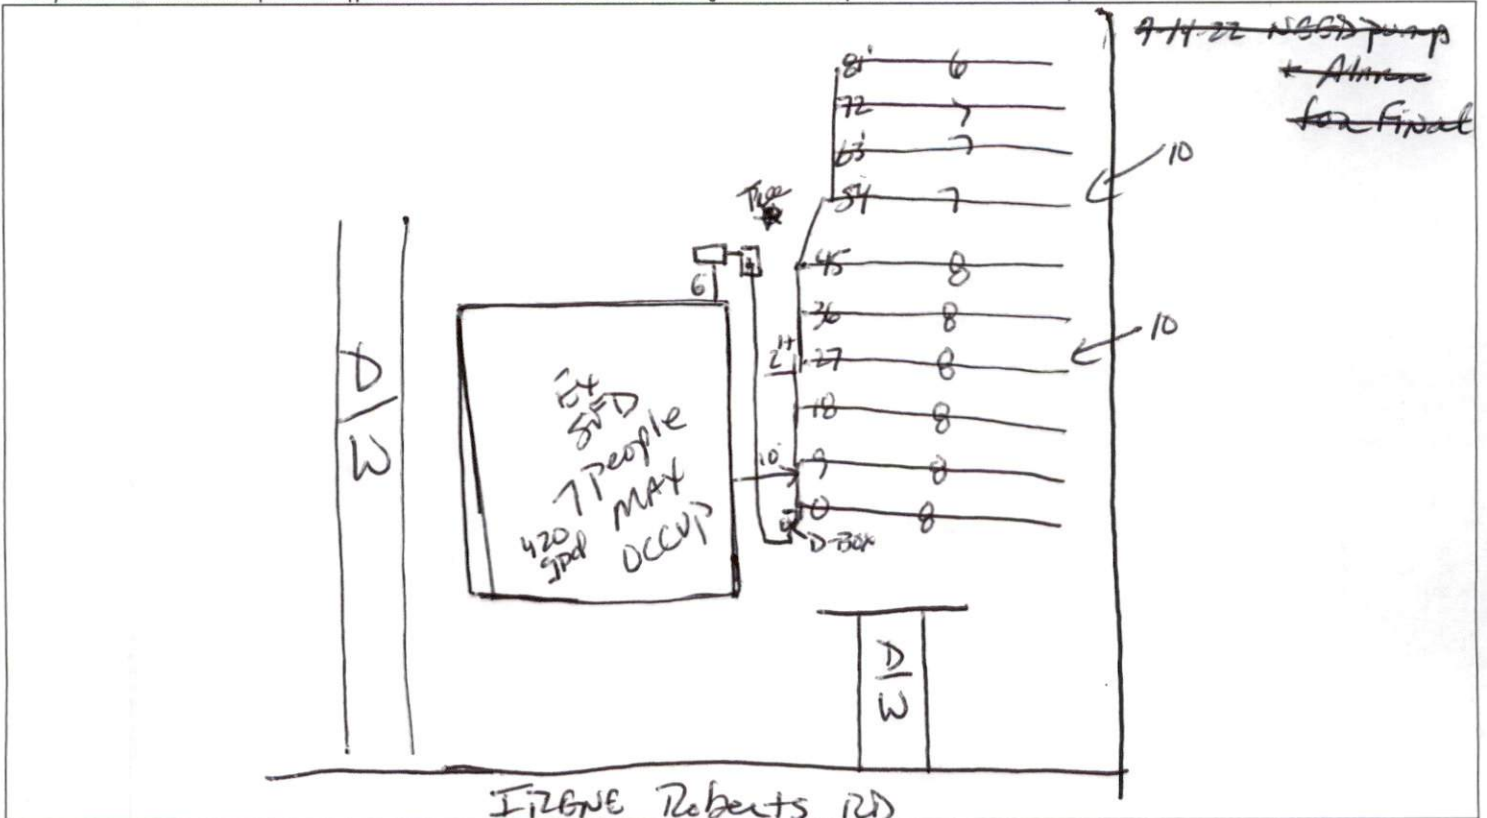

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box    \_\_\_\_\_ Pump    \_\_\_\_\_ Alarm    \_\_\_\_\_ H2O Line    \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 25% RED      Septic Tank: 1000 gallons      Pump Tank: 1000 gallons

Subsurface      No. of      exact length      width of      depth of

Drainage Field      ditches 1      of each ditch 320 feet      ditches 3 feet      ditches 22-18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 9-23-22