

# Harnett County Department of Public Health

PERMIT # EH 2006-0010

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 79 FRANCIS DR. (POPE RD. - S21753)

Name: (owner) JAMES JUREL      SUBDIVISION Fairview      LOT # 3

System Installer: KENNETH WELLS


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  
  Public  
  Well      Distance from well 50ft feet

System Type: 25% REDUCED SYS. ILLG      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

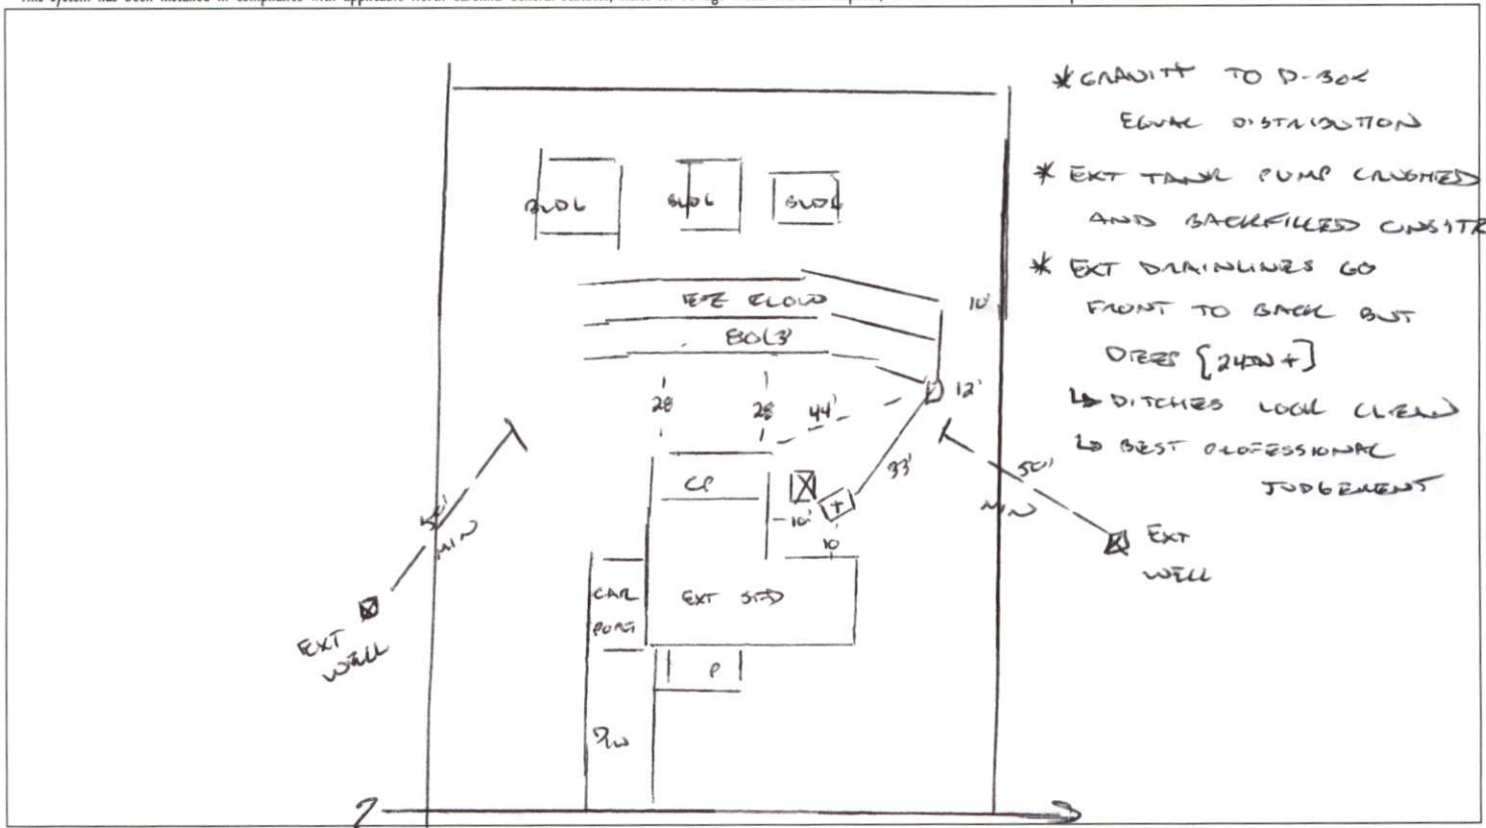

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box  
  \_\_\_\_\_ Pump  
  \_\_\_\_\_ Alarm  
  \_\_\_\_\_ H2O Line  
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  
  Other FR ELOW ILLG      Septic Tank: 1000 gallons      Pump Tank: \_\_\_\_\_ gallons

Subsurface      No. of      exact length      width of      depth of

Drainage Field      ditches 3      of each ditch 80 feet      ditches 3 feet      ditches 24 → 18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 06/02/2021