

HTE# EH 2006-0021

Harnett County Department of Public Health

No. 26687

PERMIT # NA

Operation Permit

SN 1437

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 220 RUTH CIR (BALLARD ROAD)

Name: (owner) NICK ROBERTS
CHRIS + ANNDA SMITH SUBDIVISION BALLARD WOODS LOT # 44

System Installer: EASTLAND SEPTIC - SHANE MEDWALD Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION S/S, IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

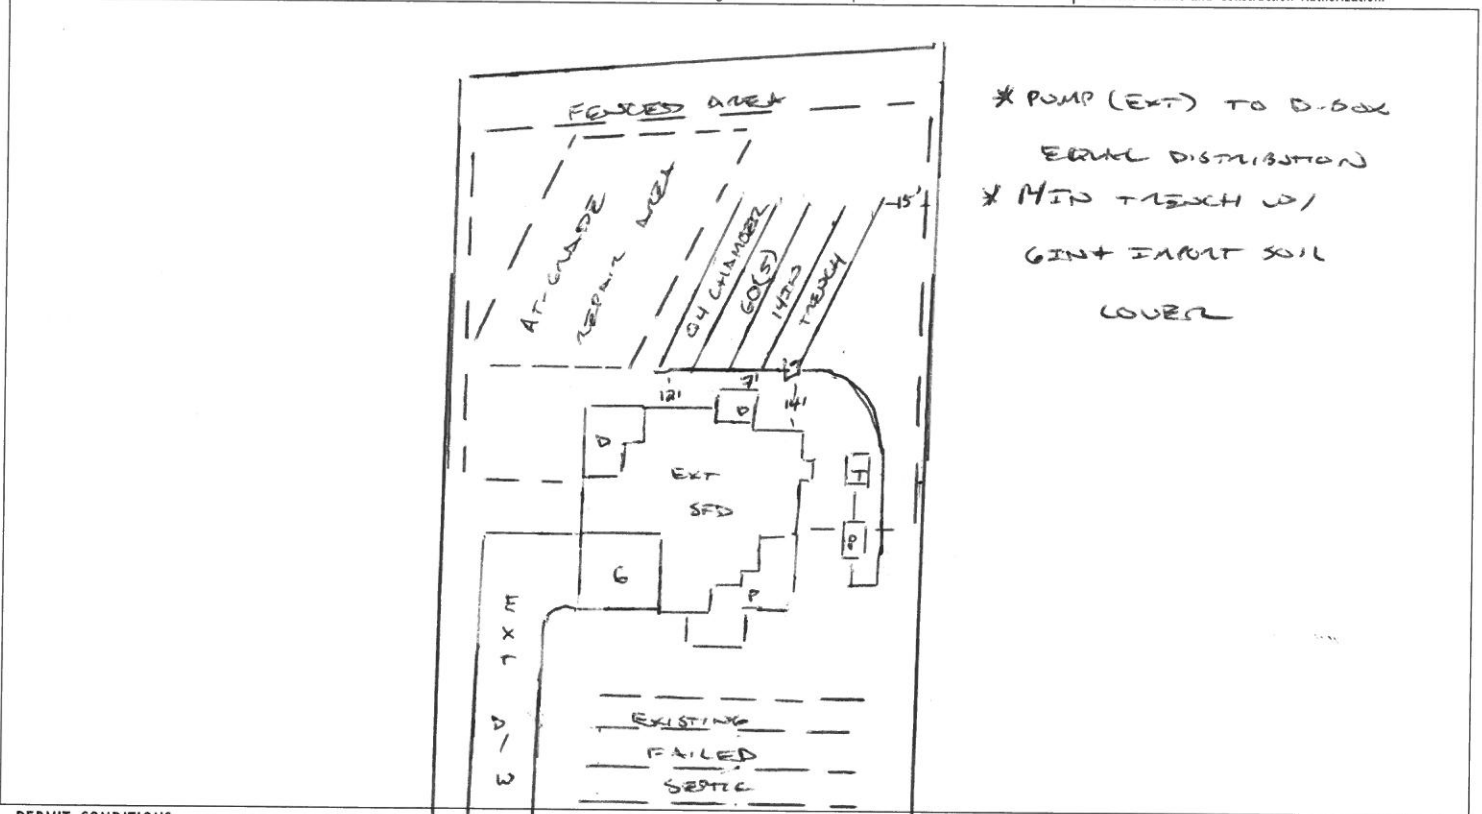

* PUMP (EXT) TO D-BOX
 EQUAL DISTRIBUTION
 * MID TRENCH W/
 GINT FAVOR SOIL
 LOWER

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961. WITH CIRCUIT
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 04 CHAMBER IIIg Septic Tank: 1000 (EXT) gallons Pump Tank: 1000 (EXT) gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 5 of each ditch 60 feet ditches 3 feet ditches 14 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 09/24/2020