

HTE# FH2008-0013

# Harnett County Department of Public Health

No. 26640

PERMIT # \_\_\_\_\_

## Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: Hwy 24 1107 NCR

Name: (owner) Josh Ford SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_


System Installer: Shawn Cox Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms \_\_\_\_\_  
Type of Water Supply:  Community  Public  Well Distance from well 50' feet

System Type: 25% REDUCED System Type G Class Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

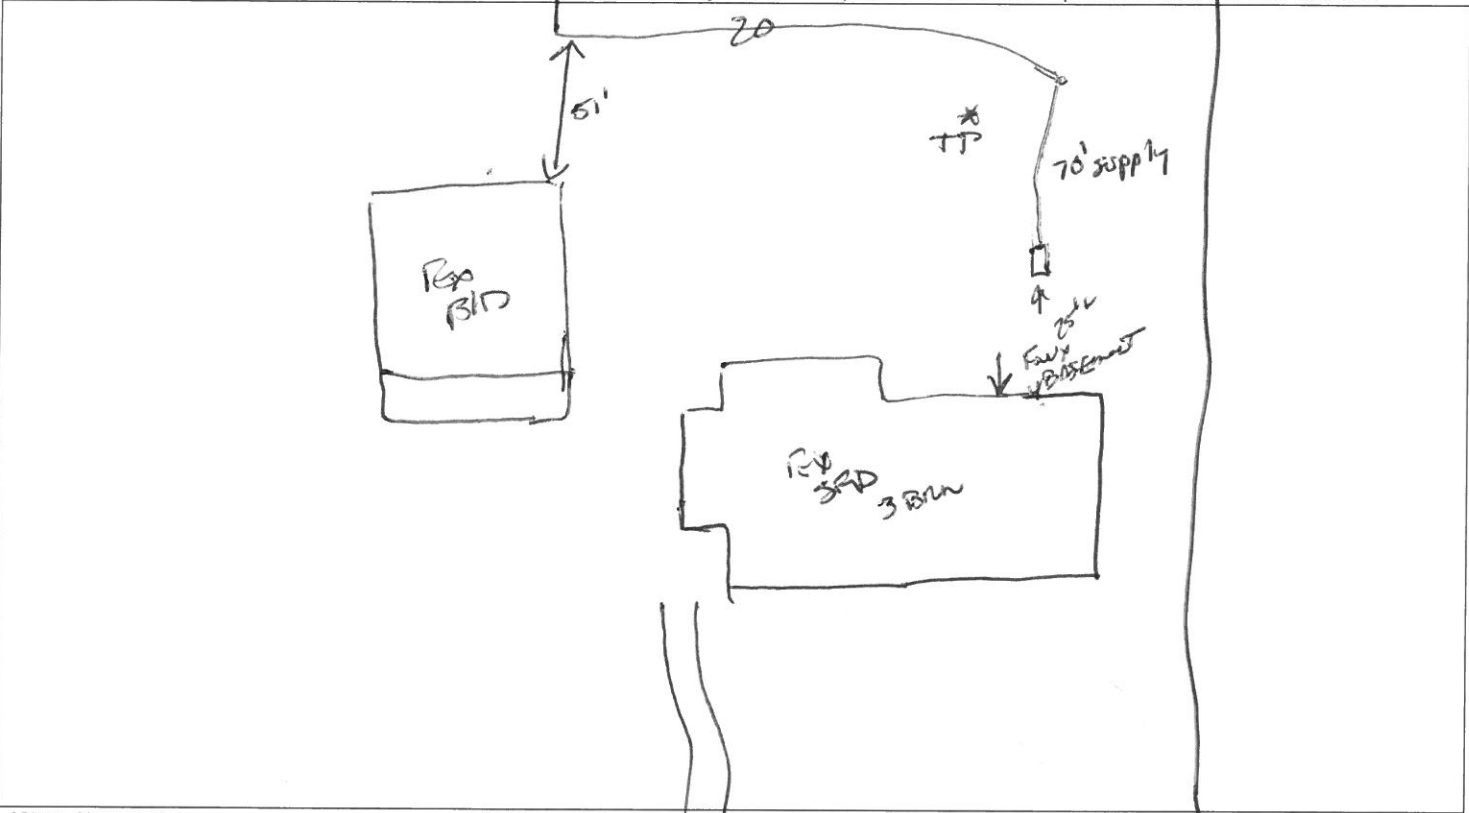

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: Hwy 24  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

- D-Box
- Pump
- Alarm
- H2O Line
- PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 25% REDUCED Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface Drainage Field No. of ditches 1 exact length of each ditch 240 feet width of ditches 3 feet depth of ditches 24-18 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: James E. Markant Date 10-1-20