

HTE# _____

Harnett County Department of Public Health

No. 26516

PERMIT # EH2102-0007

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: Pump 767 Stockyard Rd (SR 2035)

Name: (owner) Karen Parham SUBDIVISION _____ LOT # _____

System Installer: Larry Sharp Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: Type III (Pump to 25' reduction) Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

DB PT 237/1000

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

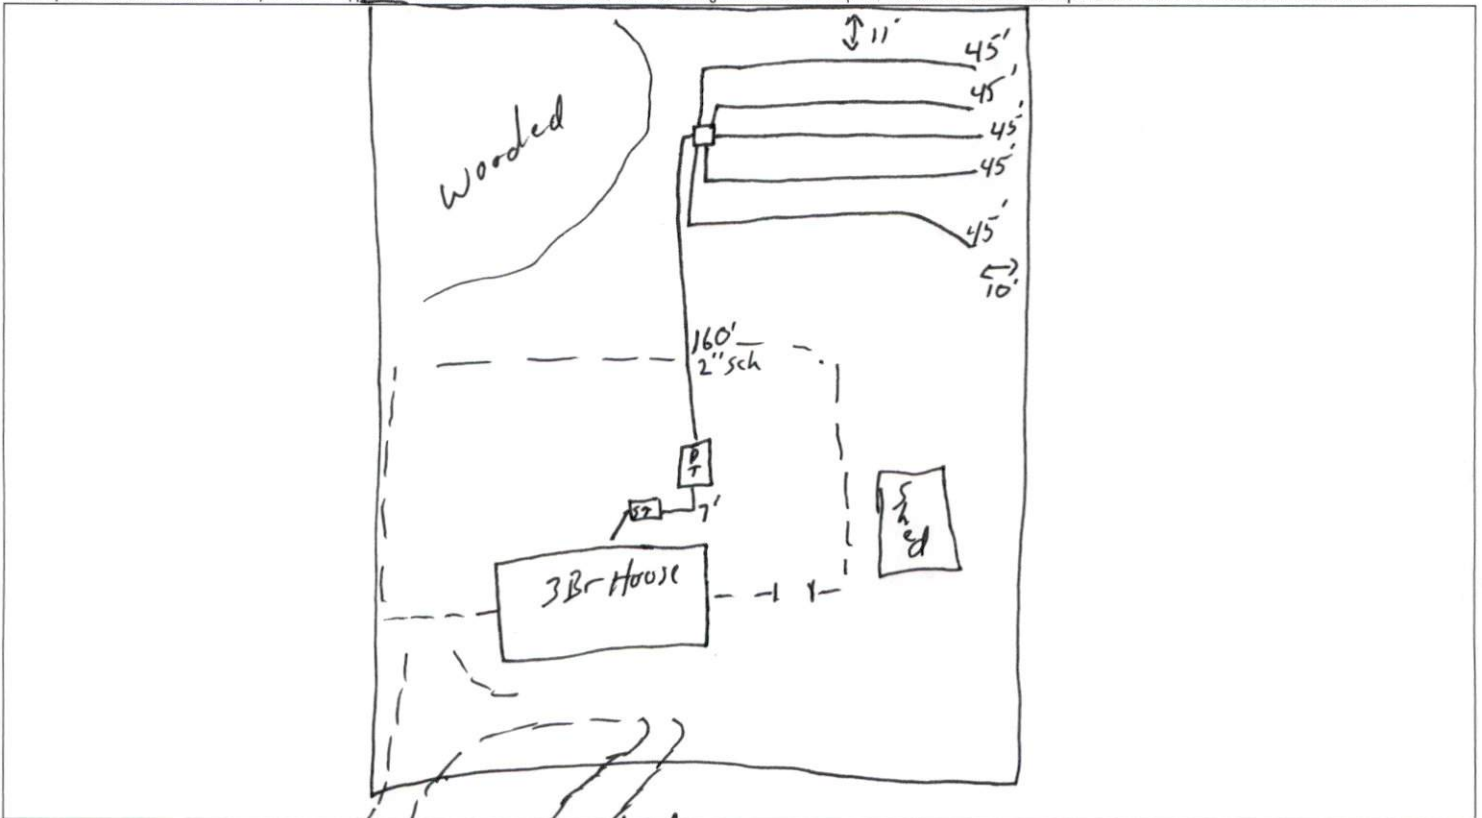

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25' reduction E2 flow Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 5 exact length of each ditch 45 feet width of ditches 3 feet depth of ditches 23 inches

French Drain Required: _____ Linear feet

Authorized State Agent

Moh... RETH

Date

3-25-21