

Harnett County Department of Public Health

Operation Permit

PERMIT # EH 2102-0022

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 521437 Ballant 2D

Name: (owner) BRIAN GARZA

SUBDIVISION Ballant Woods

LOT # 50

System Installer: CLAY ADAMS

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Pump to 2520 TUBS 4" ID Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

EZ Lay Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

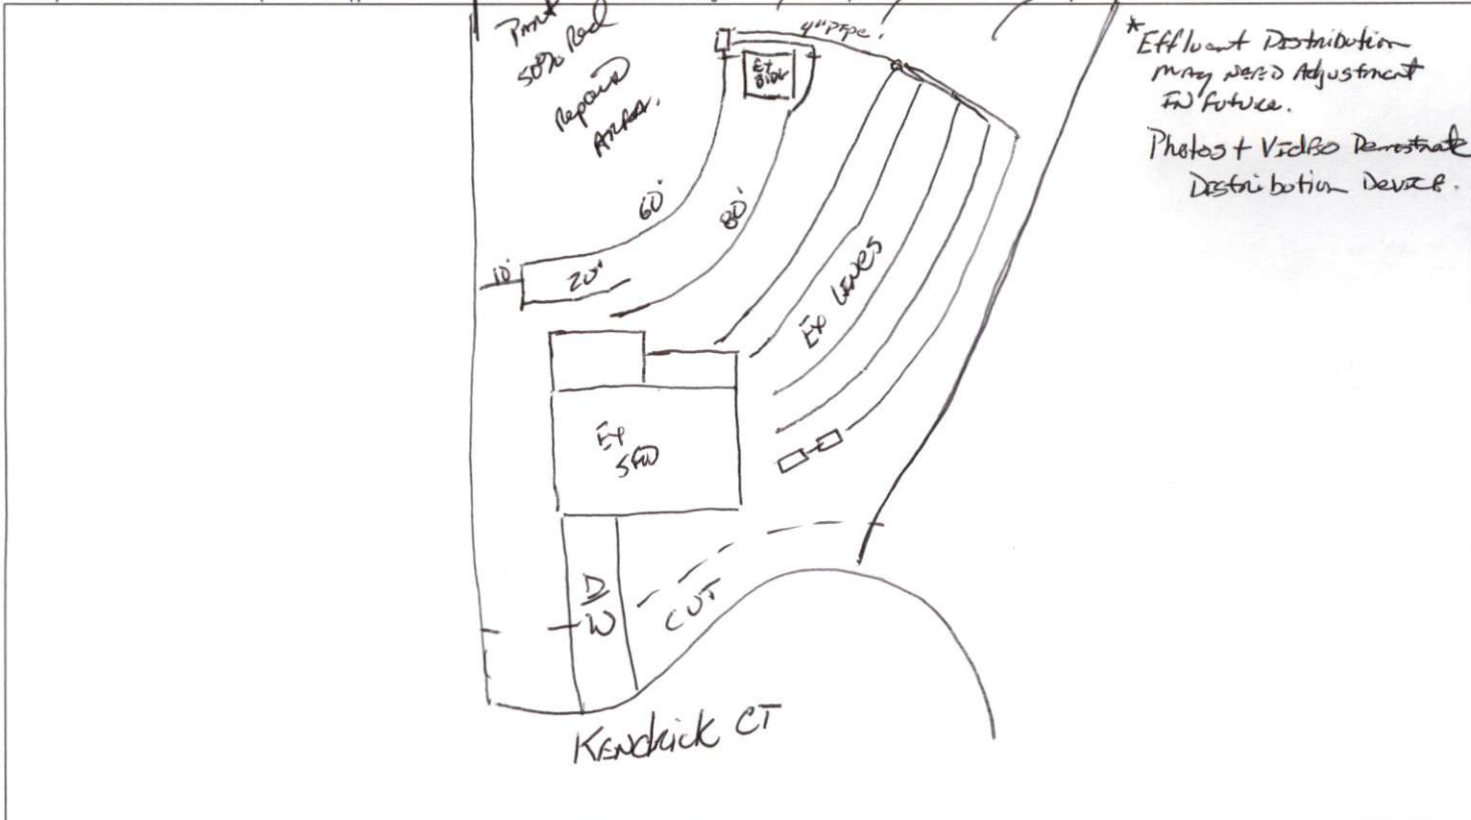

* Effluent Distribution may need adjustment in future.
Photos + Video Document Distribution Device.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 1520 TUBS Septic Tank: 54 gallons Pump Tank: 54 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 2 of each ditch 80 feet ditches 3 feet ditches 22 inches
French Drain Required: _____ Linear feet

Authorized State Agent James E. Manhart Date 8-24-21