

# Harnett County Department of Public Health

PERMIT # CH 2103-0004

## Operation Permit

8-18-22

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 62 + 68 ROCK CROSSING DR. (JONESBORO RD)

Name: (owner) ART INVESTMENTS      SUBDIVISION ROCK CROSSING MHP      LOT # \_\_\_\_\_

System Installer: HAROLD STRICKLAND


Basement with plumbing:  Garage  Number of Bedrooms 4 (TOTAL) - 2 EACH

Type of Water Supply:  Community    Public    Well      Distance from well NA feet

System Type: 250 REJECTION SYS. III B      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

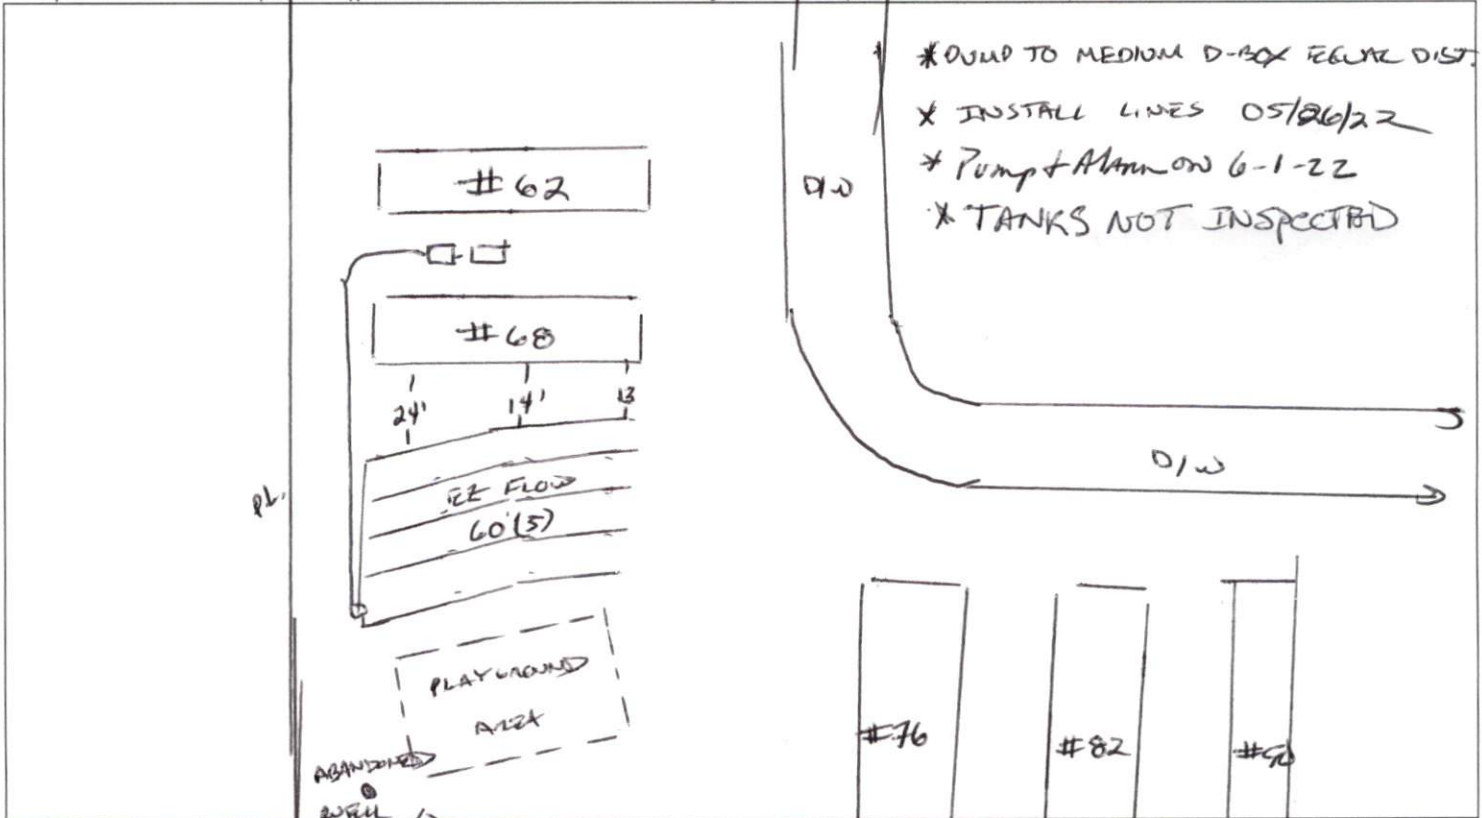

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box    \_\_\_\_\_ Pump    \_\_\_\_\_ Alarm    \_\_\_\_\_ H2O Line    \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other PER FLOW III B      Septic Tank: \_\_\_\_\_ gallons      Pump Tank: \_\_\_\_\_ gallons

Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 5      of each ditch 60 feet      ditches 3 feet      ditches 26 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent Jones & Manday III REAS      Date 6-1-22