

Harnett County Department of Public Health

PERMIT # EH2106-0011

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 3813 JOHNSON COUNTY RD. (521551)

Name: (owner) ROBERT + ALISON BALLARD SUBDIVISION _____ LOT # _____

System Installer: ENVIRONMENTAL SERVICES (LINC) #4867

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 50+ feet


System Type: 25% REDUCTION S.T. III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

- * PUMP TO D-BOX EQUAL DISTRIBUTION
- * INSTALLED BOTH DEED TO SHALLOW (IGW) w/ STEPDOWN @ TURN
- * EXT TANK SHALL BE PUMPED, CUSHED, AND BACKFILLED ON SITE
- * INSIDE LINE 50FT → STEPDOWN → 40FT
- * OUTSIDE LINE 60FT → STEPDOWN → 30FT

* PUMP TANK EXACTLY 3FT BELOW GRADE

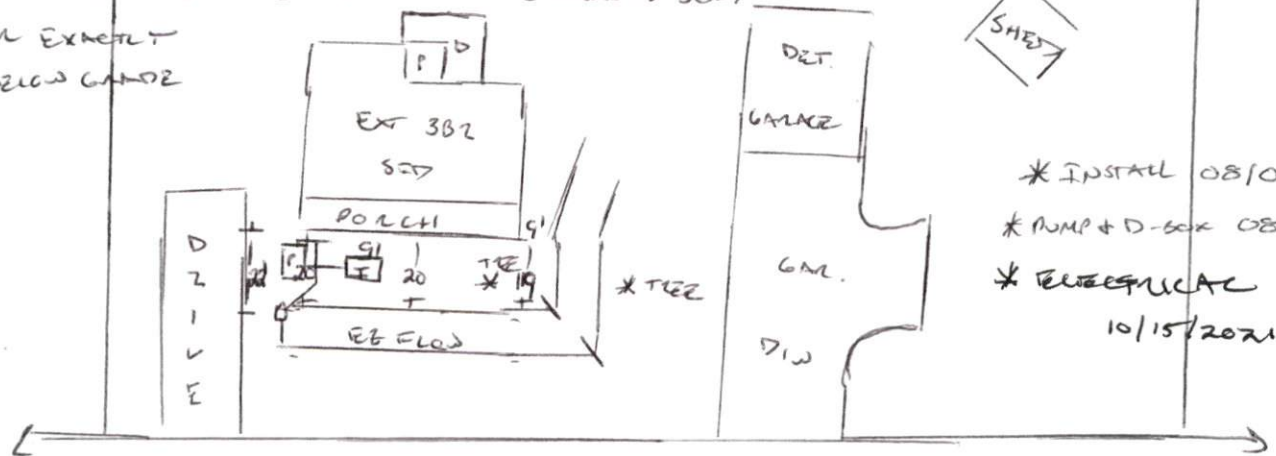

- * INSTALL 08/05/21
- * PUMP + D-BOX 08/13/21
- * ELECTRICAL 10/15/2021

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EE FLOW III B Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 2 of each ditch 90 feet ditches 3 feet ditches 30 → 16 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 10/15/2021