

Harnett County Department of Public Health Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: Ginny Byrd Porter PROPERTY LOCATION: Wild Forest Ln (SR1203)
 NEW REPAIR EXPANSION SUBDIVISION Wild Forest MHP LOT # _____
 Type of Structure: MHP Site Improvements required prior to Construction Authorization Issuance: _____
 Proposed Wastewater System Type: _____
 Projected Daily Flow: _____ GPD
 Number of bedrooms: _____ Number of Occupants: _____ max
 Basement Yes No
 Pump Required: Yes No May be required based on final location and elevations of facilities
 Type of Water Supply: Community Public Well Distance from well _____ feet Permit valid for: Five years
 Permit conditions: _____ No expiration

Authorized State Agent: Mph A RETH Date: 07-27-21 SEE ATTACHED SITE SKETCH
 The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization (Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Ginny Byrd Porter PROPERTY LOCATION: Wild Forest Ln (SR1203)
 SUBDIVISION Wild Forest MHP LOT # _____
 Facility Type: MHP New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** Pump Tank Replacement (Initial) Wastewater Flow: 1080 GPD
 (See note below, if applicable) (Repair)

Installation Requirements/Conditions

Septic Tank Size _____ gallons	Number of trenches _____	Trench Spacing: _____ Feet on Center
Pump Tank Size <u>3500</u> gallons	Exact length of each trench _____ feet	Soil Cover: _____ inches
	Trenches shall be installed on contour at a _____	(Maximum soil cover shall not exceed 36" above the trench bottom)
	Maximum Trench Depth of: _____ inches	
	(Trench bottoms shall be level to +/-1/4" in all directions)	
Pump Requirements: _____ ft. TDH vs. _____ GPM		Aggregate Depth: _____ inches below pipe
		_____ inches above pipe
		_____ inches total

Conditions: 36" Curtain Drain Above new pump tank, and daylight curtain drain to culvert pipe. reconnect pump tank to supply line with pump system

**WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
 NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.**

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.
 Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: Mph A RETH Date: 07-27-21
 Construction Authorization Expiration Date: 07-27-26

Application # EH2107-0013

Harnett County Department of Public Health Site Sketch

Property Location: Wild Forest Ln (SR1203)

Issued To: Ginny Byrd Porter


Subdivision Wild Forest MHP

Lot #

Authorized State Agent: *[Signature]*

Date: 07-27-21

* 36" Curtain Drain Above TANKS TO
Divert lateral Ground water to culvert pipe
* Crush old TANK + SET NEW 3500 Gallon Pump Tank
↳ reconnect pump to old supply line
Woods

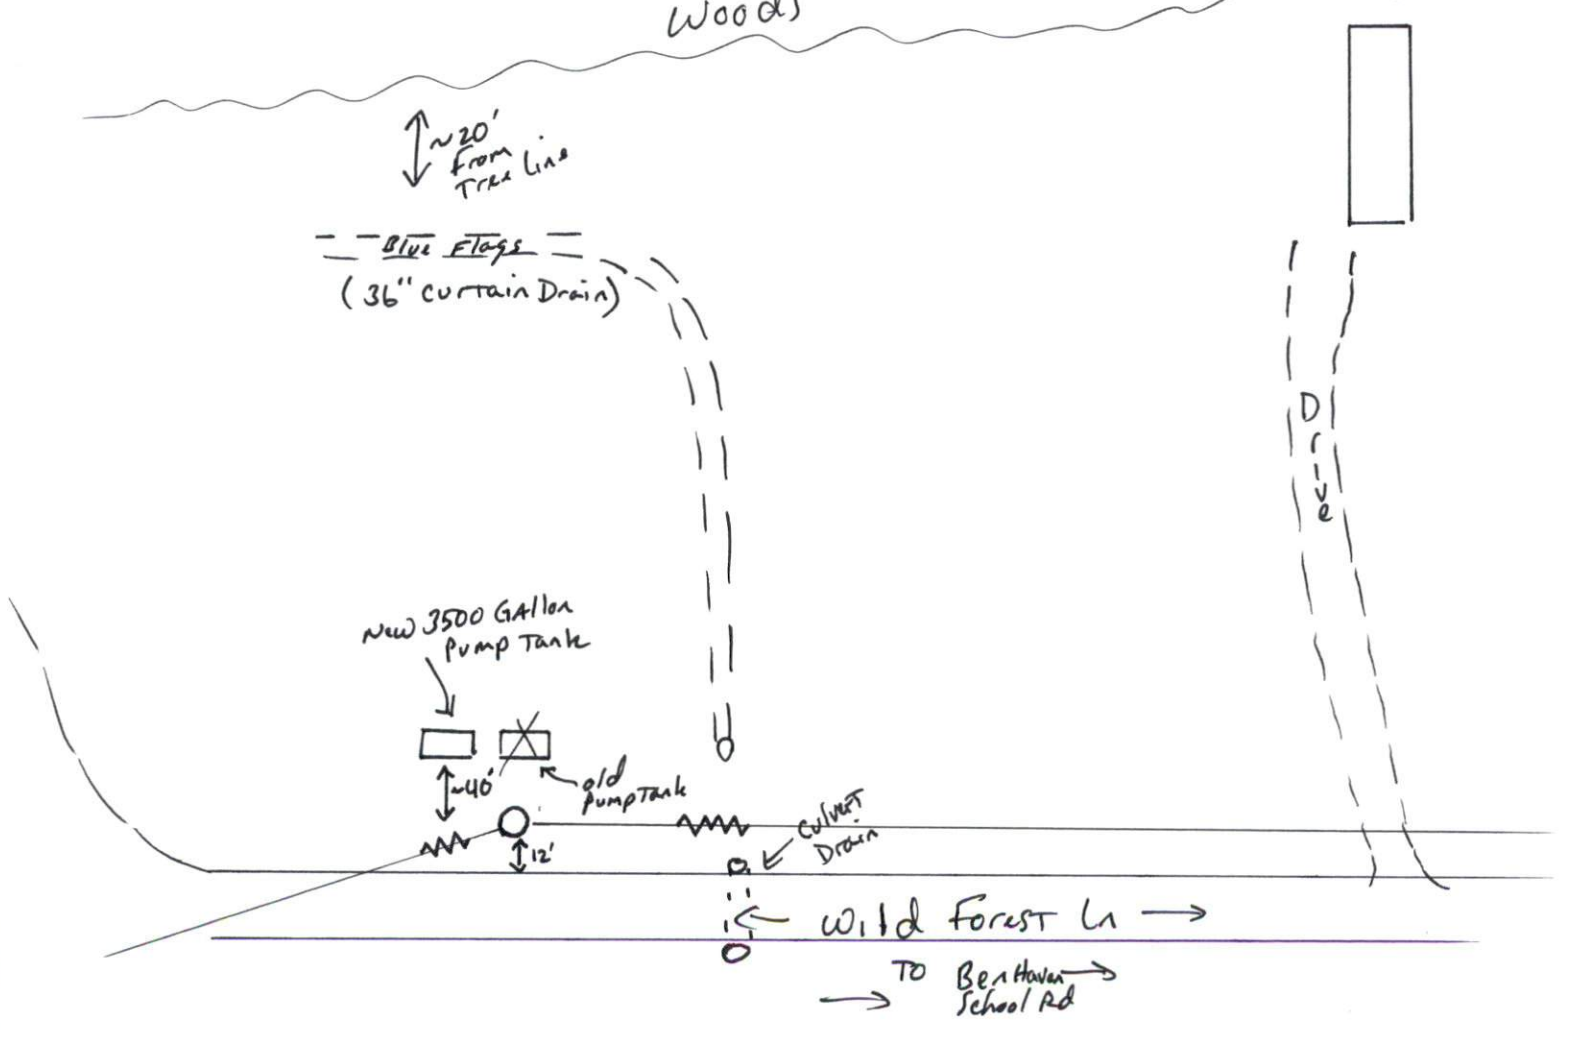

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.