

The North Carolina Administrative Code requires **applications for septic permits** to be signed by the owner of the property to be evaluated or by the owner's legal representative. Applications submitted by an owner's legal representative must include this completed and signed document. **Please note that the person named the legal representative on this document must make the application. The signature of the person named the legal representative on this document must also appear at the bottom of this document.**

I, Tony W. Warren, hereby authorize
(property owner's full name)

Gerard E. Rodriguez to serve as my legal
(legal representative's full name)

representative for submitting an application for an evaluation by the Harnett County Health Department of property owned by me for the purpose of obtaining a permit to install, repair or expand an on-site wastewater system. I understand that submittal of the application for evaluation also authorizes the Harnett County Health Department to perform said evaluation on my property.

Property Owner's Address: 4055 NC Hwy 55 W Angier, NC 27501

Property Owner's Phone: (910) 710-6646

Parcel Identification Number (PIN): 0682-94-0324.000

Parcel Size: 7.469 Parcel Location: 4055 NC Hwy 55 W Angier, NC 27501

Signature: Tony W. Warren Date: 4/5/21
(property owner's full name)

Signature: Gerard E. Rodriguez Date: 4-5-21
(legal representative's full name)



Initial Application Date: _____

Application # _____

CU# _____

COUNTY OF HARNETT RESIDENTIAL LAND USE APPLICATION

Central Permitting 420 McKinney Pkwy, Lillington, NC 27546 Phone: (910) 893-7525 ext:1 Fax: (910) 893-2793 www.harnett.org/permits

****A RECORDED SURVEY MAP, RECORDED DEED (OR OFFER TO PURCHASE) & SITE PLAN ARE REQUIRED WHEN SUBMITTING A LAND USE APPLICATION****

LANDOWNER: Tony Warren Mailing Address: 4055 NC 55 W

City: Angier State: NC Zip: _____ Contact No: 919-710-6646 Email: none

APPLICANT: GERARD E. RODRIGUEZ Mailing Address: 225 GREEN ST. SUITE 910

City: FAYETTEVILLE State: NC Zip: 28301 Contact No: 910-580-5533 Email: gerardrodriguez712@gmail.com

*Please fill out applicant information if different than landowner

ADDRESS: 4055 NC 55 W Angier, NC 27501 PIN: 0682-94-0324.000

Zoning: _____ Flood: _____ Watershed: _____ Deed Book / Page: _____

Setbacks - Front: _____ Back: _____ Side: _____ Corner: _____

PROPOSED USE:

SFD: (Size 45 x 55) # Bedrooms: 3 # Baths: 2 Basement(w/w bath): n Garage: n Deck: n Crawl Space: y Slab: n Slab: _____ Monolithic
TOTAL HTD SQ FT 2475 GARAGE SQ FT 0 (Is the bonus room finished? () yes () no w/ a closet? () yes () no (if yes add in with # bedrooms)

Modular: (Size _____ x _____) # Bedrooms _____ # Baths _____ Basement (w/w bath) _____ Garage: _____ Site Built Deck: _____ On Frame _____ Off Frame _____
TOTAL HTD SQ FT _____ (Is the second floor finished? () yes () no Any other site built additions? () yes () no

Manufactured Home: _____ SW _____ DW _____ TW (Size _____ x _____) # Bedrooms: _____ Garage: _____ (site built? _____) Deck: _____ (site built? _____)

Duplex: (Size _____ x _____) No. Buildings: _____ No. Bedrooms Per Unit: _____ TOTAL HTD SQ FT _____

Home Occupation: # Rooms: _____ Use: _____ Hours of Operation: _____ #Employees: _____

Addition/Accessory/Other: (Size _____ x _____) Use: _____ Closets in addition? () yes () no

TOTAL HTD SQ FT _____ GARAGE _____

Water Supply: County _____ Existing Well _____ New Well (# of dwellings using well _____) *Must have operable water before final (Need to Complete New Well Application at the same time as New Tank)

Sewage Supply: _____ New Septic Tank _____ Expansion Relocation _____ Existing Septic Tank _____ County Sewer (Complete Environmental Health Checklist on other side of application if Septic)

Does owner of this tract of land, own land that contains a manufactured home within five hundred feet (500') of tract listed above? () yes () no

Does the property contain any easements whether underground or overhead () yes () no

Structures (existing or proposed): Single family dwellings: existing _____ Manufactured Homes: _____ Other (specify): 8 sheds

If permits are granted I agree to conform to all ordinances and laws of the State of North Carolina regulating such work and the specifications of plans submitted. I hereby state that foregoing statements are accurate and correct to the best of my knowledge. Permit subject to revocation if false information is provided.

Gerard E. Rodriguez
Signature of Owner or Owner's Agent

8-3-2021
Date

It is the owner/applicants responsibility to provide the county with any applicable information about the subject property, including but not limited to: boundary information, house location, underground or overhead easements, etc. The county or its employees are not responsible for any incorrect or missing information that is contained within these applications.

*This application expires 6 months from the initial date if permits have not been issued**

APPLICATION CONTINUES ON BACK

strong roots • new growth

****This application expires 6 months from the initial date if permits have not been issued****

This application to be filled out when applying for a septic system inspection.

County Health Department Application for Improvement Permit and/or Authorization to Construct

IF THE INFORMATION IN THIS APPLICATION IS FALSIFIED, CHANGED, OR THE SITE IS ALTERED, THEN THE IMPROVEMENT PERMIT OR AUTHORIZATION TO CONSTRUCT SHALL BECOME INVALID. The permit is valid for either 60 months or without expiration depending upon documentation submitted. (Complete site plan = 60 months; Complete plat = without expiration)

Environmental Health New Septic System

- **All property irons must be made visible.** Place "pink property flags" on each corner iron of lot. All property lines must be clearly flagged approximately every 50 feet between corners.
- Place "orange house corner flags" at each corner of the proposed structure. Also flag driveways, garages, decks, out buildings, swimming pools, etc. Place flags per site plan developed at/for Central Permitting.
- Place orange Environmental Health card in location that is easily viewed from road to assist in locating property.
- If property is thickly wooded, Environmental Health requires that you clean out the **undergrowth** to allow the soil evaluation to be performed. Inspectors should be able to walk freely around site. **Do not grade property.**
- **All lots to be addressed within 10 business days after confirmation. \$25.00 return trip fee may be incurred for failure to uncover outlet lid, mark house corners and property lines, etc. once lot confirmed ready.**

Environmental Health Existing Tank Inspections

- Follow above instructions for placing flags and card on property.
- Prepare for inspection by removing soil over **outlet end** of tank as diagram indicates, and lift lid straight up (*if possible*) and then **put lid back in place.** (Unless inspection is for a septic tank in a mobile home park)
- **DO NOT LEAVE LIDS OFF OF SEPTIC TANK**

"MORE INFORMATION MAY BE REQUIRED TO COMPLETE ANY INSPECTION"

SEPTIC

If applying for authorization to construct please indicate desired system type(s): can be ranked in order of preference, must choose one.

- Accepted Innovative Conventional Any
 Alternative Other _____

The applicant shall notify the local health department upon submittal of this application if any of the following apply to the property in question. If the answer is "yes", applicant **MUST ATTACH SUPPORTING DOCUMENTATION**:

- YES NO Does the site contain any Jurisdictional Wetlands?
- YES NO Do you plan to have an irrigation system now or in the future?
- YES NO Does or will the building contain any drains? Please explain. _____
- YES NO Are there any existing wells, springs, waterlines or Wastewater Systems on this property?
- YES NO Is any wastewater going to be generated on the site other than domestic sewage?
- YES NO Is the site subject to approval by any other Public Agency?
- YES NO Are there any Easements or Right of Ways on this property?
- YES NO Does the site contain any existing water, cable, phone or underground electric lines?
 If yes please call No Cuts at 800-632-4949 to locate the lines. This is a free service.

I Have Read This Application And Certify That The Information Provided Herein Is True, Complete And Correct. Authorized County And State Officials Are Granted Right Of Entry To Conduct Necessary Inspections To Determine Compliance With Applicable Laws And Rules. I Understand That I Am Solely Responsible For The Proper Identification And Labeling Of All Property Lines And Corners And Making The Site Accessible So That A Complete Site Evaluation Can Be Performed.

Residential Subsurface Wastewater Treatment and Disposal System Proposal

Property:
4055 NC 55 W
Angier, NC
PIN: 0682-94-0324.000
Harnett County, NC
Ground Truth Job # 21-147

Prepared For:

The Right of Way Group, LLC
225 Green Street, Suite 910
Fayetteville, NC 28301

Prepared By:



Ground Truth Soil Consulting, PLLC
1302 Roberts Road
Newport, NC 28570
(252) 725-1320

August 3, 2021


John C. Roberts



INTRODUCTION & SITE DESCRIPTION

A Soil & Site Evaluation was performed for NCDOT Parcel 003 located at 4055 NC 55 W, Angier, NC (PIN: 0682-94-0324.000). Ground Truth Soil Consulting, PLLC (Ground Truth) was retained to prepare a proposal for an on-site wastewater treatment and disposal system that would allow for the relocation of a subsurface septic system for an existing 3-bedroom home (360 GPD). The lot was evaluated in accordance with North Carolina statutes for waste disposal (“Laws and Rules for Sewage Treatment and Disposal Systems”, amended December 6, 2018”).

The NCDOT project R5705A is proposed to impact the existing septic drainfield. A relocation permit is requested to relocate the septic tank, pump tank and septic drainfield. The existing drainfield utilizes a pump tank to properly transport wastewater to the drainfield. It is assumed the existing septic system is a repair. As such, repair area is not required to be allocated.

The field survey was conducted in May and June 2021 by John C. Roberts, LSS. Soil borings were advanced via a hand auger and evaluated under moist conditions using procedures listed in the *Field book for Describing and Sampling Soils, Version 3.0*. Soil color was determined using a Munsell Soil Color Chart. Observations of the landscape as well as soil properties (depth, texture, structure, soil wetness, restrictive horizons, etc.) were recorded. It was determined sufficient amount of Provisionally Suitable Group III soils are available within the project area for installation of a Pump to Accepted System initial system for a 3-bedroom system. Sufficient area of Provisionally Suitable soils also exists to support a Pump to Accepted System repair system.

LOCATION

The lot is located at 4055 NC 55 W ANGIER, NC 27501.

PLANS AND SPECIFICATIONS

A. Septic Tank

1. The septic tank shall be State approved (Section .1953 of 15A NCAC 18A), watertight, structurally sound, and 1,000 gallons in capacity (at minimum).
2. The septic tank shall be fitted with an approved effluent filter.
3. It is the responsibility of the septic contractor to thoroughly inspect the septic tank prior to accepting delivery to assure that the tanks have had time to properly cure and are free of cracks or other structural deficiencies.

B. Pump Tank

1. The pump tank shall be State approved, of one-piece construction, watertight, structurally sound and 1,000 gallons in capacity (at minimum). Again, it is the responsibility of the septic tank contractor to thoroughly inspect each pump tank prior to accepting delivery.
2. All pipe penetrations into the tank shall be booted (i.e., C-293 boot with a stainless-steel strap).
3. The pump tank shall have access risers that extend, at a minimum, 6 inches above finished grade and must have less than 36 inches of fill over its top once finished grade has been established (a reinforced concrete tank will be required if finished soil cover is 36 inches or greater in depth).

4. Floats, pump and control circuits, and the control panel shall meet the requirements of Rule .1952(c). Panel and control equipment shall include lightning protection, be protected from unauthorized access, and always remain accessible to the system operator.
5. The pump and alarm controls shall be provided with manual circuit disconnects within a watertight, corrosion resistant, Nema 4x rated control panel. The control panel must be securely mounted outside, adjacent to the pump tank riser and at a minimum of 18 inches above finished grade. Pump and float control wiring should be long enough to reach from the tank to the control panel without splicing, routed through wire conduit, and sealed at the openings within the pump tank as well as the control panel enclosure. It is paramount that the conduit is properly sealed to prevent the escape of flammable gases from the pump tank. Furthermore, there must be two electrical circuits for the pump tank controls: one for the pump and one for the alarm controls.
6. Float switch tie downs must be made of a corrosion resistant material (per OWPS, all metal in the tanks shall be stainless steel). Floats should be mounted on a separate “float tree” rather than the pump supply line (see pump tank detail).
7. The pump removal system will be via a pump tether made of nylon rope or its equivalent. The tether material should be resistant to mildew and rot.

C. Pipes and Fittings

1. All discharge piping, connectors and supply lines should be made of SCH 40 PVC.
2. All joints must be properly “welded” utilizing the appropriate PVC cement for each application.
3. The supply line will be approximately 270 feet long from the septic tank to the upper septic drainline.

D. Distribution Method

1. Drainlines will be fed via pump to serial distribution.
2. The supply manifold conveys effluent from the pump to the lateral distribution lines.
3. The supply manifold can be prefabricated or constructed. The manifold shall have a gate valve on the inlet side and a threaded PVC plug on the opposite end for a threaded standpipe.

E. Drainfield Installation-Initial

1. The drainfield has been previously laid out on-site utilizing metal stemmed flags. The property owner/builder should mark this area and isolate it as much as possible from construction traffic.
2. Under no circumstances shall any construction take place within the drainfield area while the soil is in a wet condition.
3. The specified system is a gravity-flow system. Accepted Systems, Infiltrator Quick4 chambers or equivalent will be utilized. Drainlines shall be installed no deeper than 20 inches.
4. The drainfield consists of three (3) lateral trenches to be constructed 3-foot wide by 86 feet in length. Total drainline length is 258 feet.
5. The maximum trench depth for this system shall be 20 inches.
6. The laterals are to be installed keeping the individual trench bottoms level from beginning to end.
7. The trenches should be left open for the final inspection by the HCEH.

F. Final Landscaping

1. Final cover over the drainfield shall be at least 6 inches deep. If additional cover is needed, Group II (sandy loam) or Group III (sandy clay loam) soil shall be utilized.
2. The drainfield shall be shaped to shed rainwater and be free from low spots.
3. The drainfield area should be planted with grass as soon as possible to prevent erosion. The soil should be limed (if necessary) and fertilized prior to planting. After applying grass seed, the area should be heavily mulched with straw or other suitable material.

G. Utility Conflicts

1. The builder and property owner must take special care in planning for water, power, gas, telephone and cable lines. These utilities shall be kept clear of all parts of the septic system and its proposed repair area. Improper planning for underground utilities can negatively impact the installation and, in some cases, cause irreparable damage and permit revocation. If there are any questions regarding preferred routes, contact the HCEH as soon as possible.
2. Lawn irrigation should not be placed over the drainfield area.

MAINTENANCE

H. In General

1. The owner must maintain the drainfield area through periodic mowing. The drainfield must not be allowed to become overgrown.
2. The septic tank should be pumped every 4 years or when the solids within the septic tank reach an elevation that is equivalent to 25 percent of the volume of the tank. In some situations, the tanks may need to be pumped more frequently. If using a garbage disposal, it is recommended that the homeowner has the septic and pump tanks cleaned out annually.
3. When it becomes necessary to clean the effluent filter, the filter should be removed and the accumulated debris washed back into the septic tank – not onto the lawn.
4. Any damp areas, leakages or malfunctions in the drainfield area should be addressed immediately.
5. Divert gutter downspouts and surface water runoff away from the septic tanks and septic drainfield.

DESIGN SPECIFICS

Initial System

Daily Design Flow:	360 GPD – 3-bedroom house
Septic Tank Size:	1,000 Gallons (minimum)
Pump Tank Size:	1,000 Gallons (minimum)
Effluent Loading Rate:	0.35 GPD per sq. ft.
Drainfield Type:	Accepted Systems Quick 4 Chambers or Equivalent
Distribution Method:	Pump to Serial Distribution
Number of Drainlines:	(3) 3' Wide x 86' Long
Total Trench Length:	258 Linear Feet
Maximum Trench Depth:	20 inches
Final Cover Requirement:	6 Inches

Repair Specifics

Effluent Loading Rate:	0.35 GPD per sq. ft.
Drainfield Type:	Accepted Systems Quick 4 Chambers or Equivalent
Distribution Method:	Pump to Serial Distribution
Total Trench Length:	258 Linear Feet
Maximum Trench Depth:	20 Inches
Final Cover Requirement:	6 Inches




Ground Truth Soil Consulting, PLLC

4055 NC 55 Angier, NC
PIN:
0682-94-0324.000

Soil and Site Evaluation

Harnett County

Scale:




Figure

1

Date:
August
2021

GT Job
No.
21-148

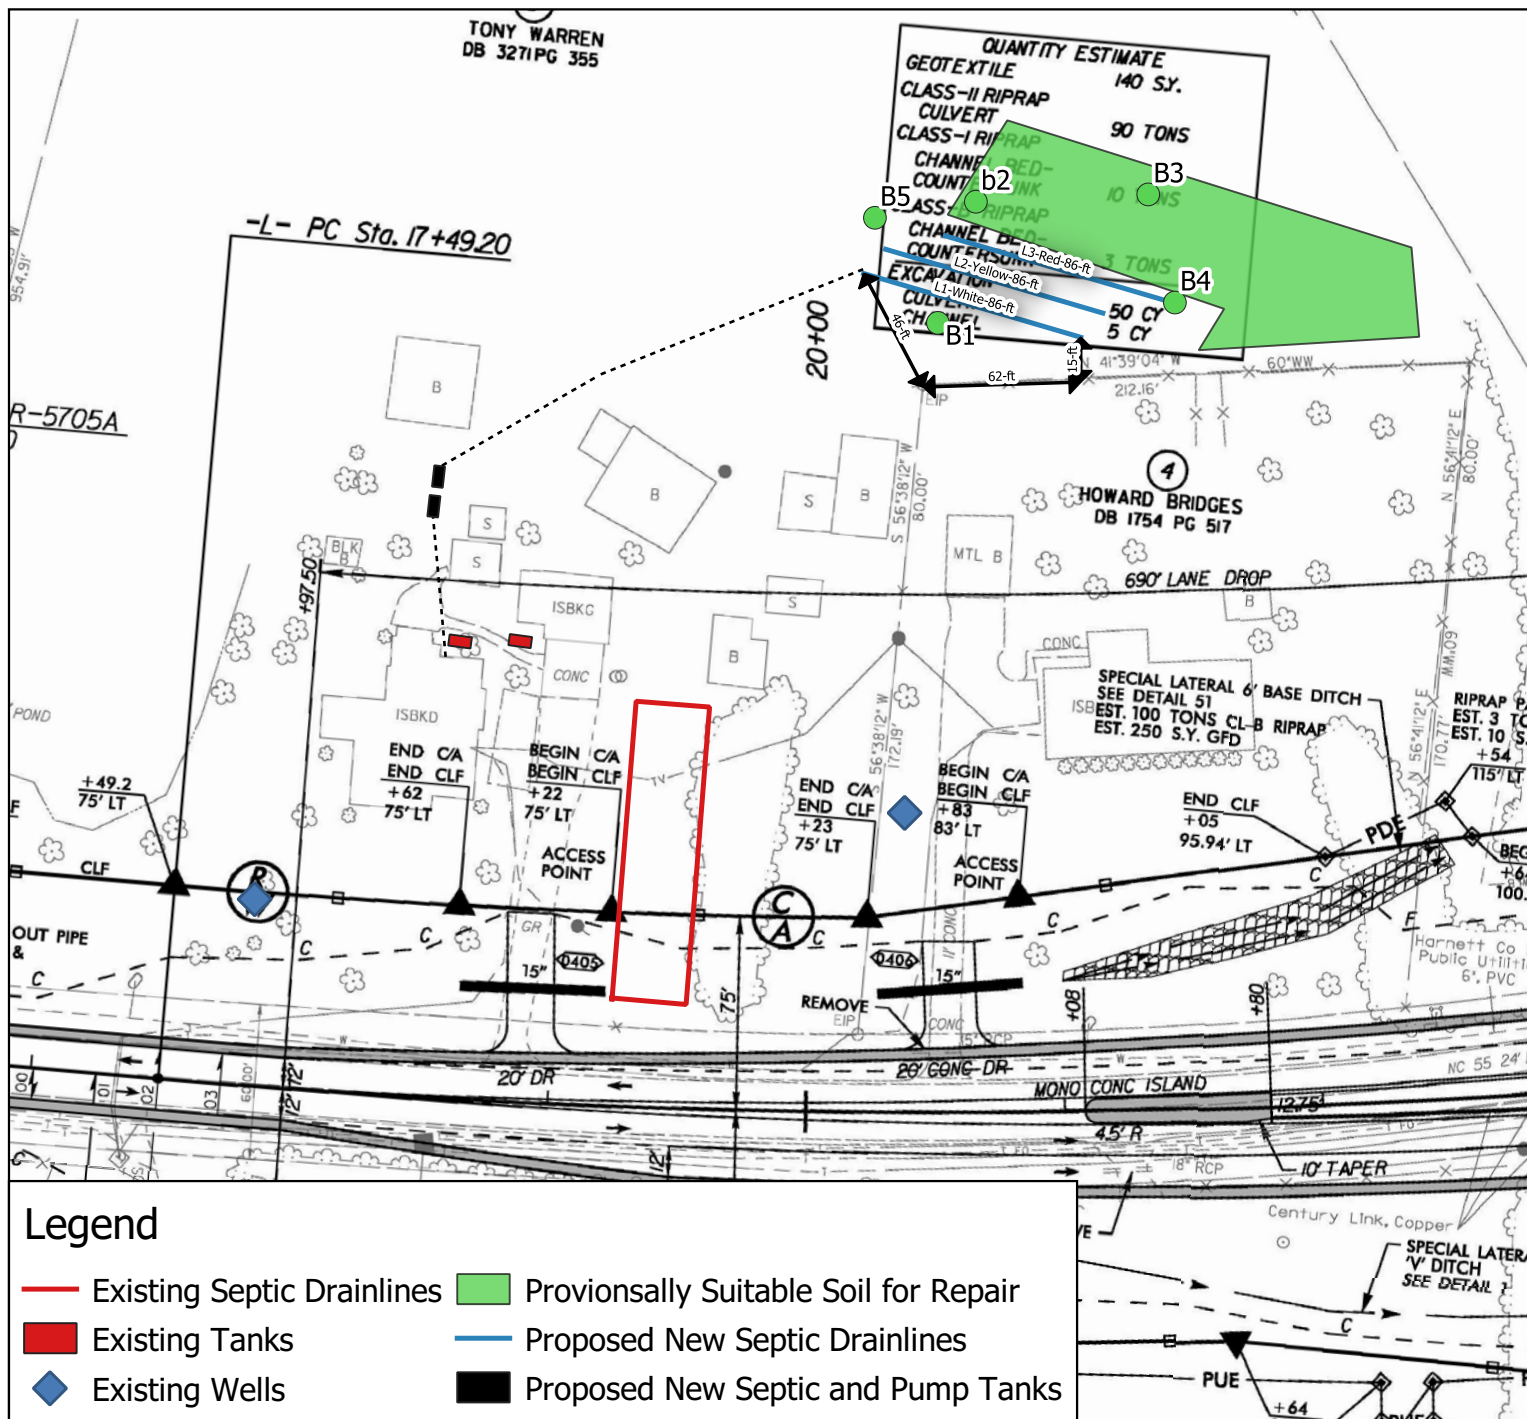

Parcel 003

Pump System Design Criteria

Mailing Address: 4055 HWY 55 Angier, NC 27501

D# : _____ PIN: _____ S/D: _____ Lot#: _____

Site Address: 4055 HWY 55 Angier, NC 27501

Bedrooms: 3

Daily Flow: 360 gallons

Septic Tank: 1000 gallons

Pump Tank: 1000 gallons

LTAR: 0.35 gpd/sqft

Effective (trench) LTAR 0.46667 gpd/sqft

Amt. of Drainline: 771 sqft or 257 linear ft

TRENCHES Length (ft): 258 Depth (in): 20 Stone Depth (in): N/A

SUPPLY LINE Length (ft): 270 Diameter: 2" sch 40 pvc

CALCULATIONS:

Dose Volume (gal): 126 with Pipe Vol @ 75 Total Flow: 23 gpm

Dose Pump Run Time (min): 5.48 Daily Pump Run Time (min): 15.65

Drawdown: 126 gallons divided by 21 gal/ inch = 6.00 inches

Pump Tank Elevation(ft): 102.48 Pump Elevation (ft): 97.48

Friction Head (ft): 3.70 (supply line length + 70' for fittings in pump tank)

Elevation Head (ft): 1

Total Head (ft): 4.70


Pump to Deliver: 23 gpm @ 4.70 ft head

Simplex Control Panel (SJE Rhombus 112 or equal) with elapsed time meter, cycle counter, alarm, and pump on separate circuits is required. Floats to be determined by type of pump tank used.



A septic filter (Polylok PL-122 or equal) is required.

Possible Pumps Include:

Liberty Pumps FL-30 Series 1/3HP

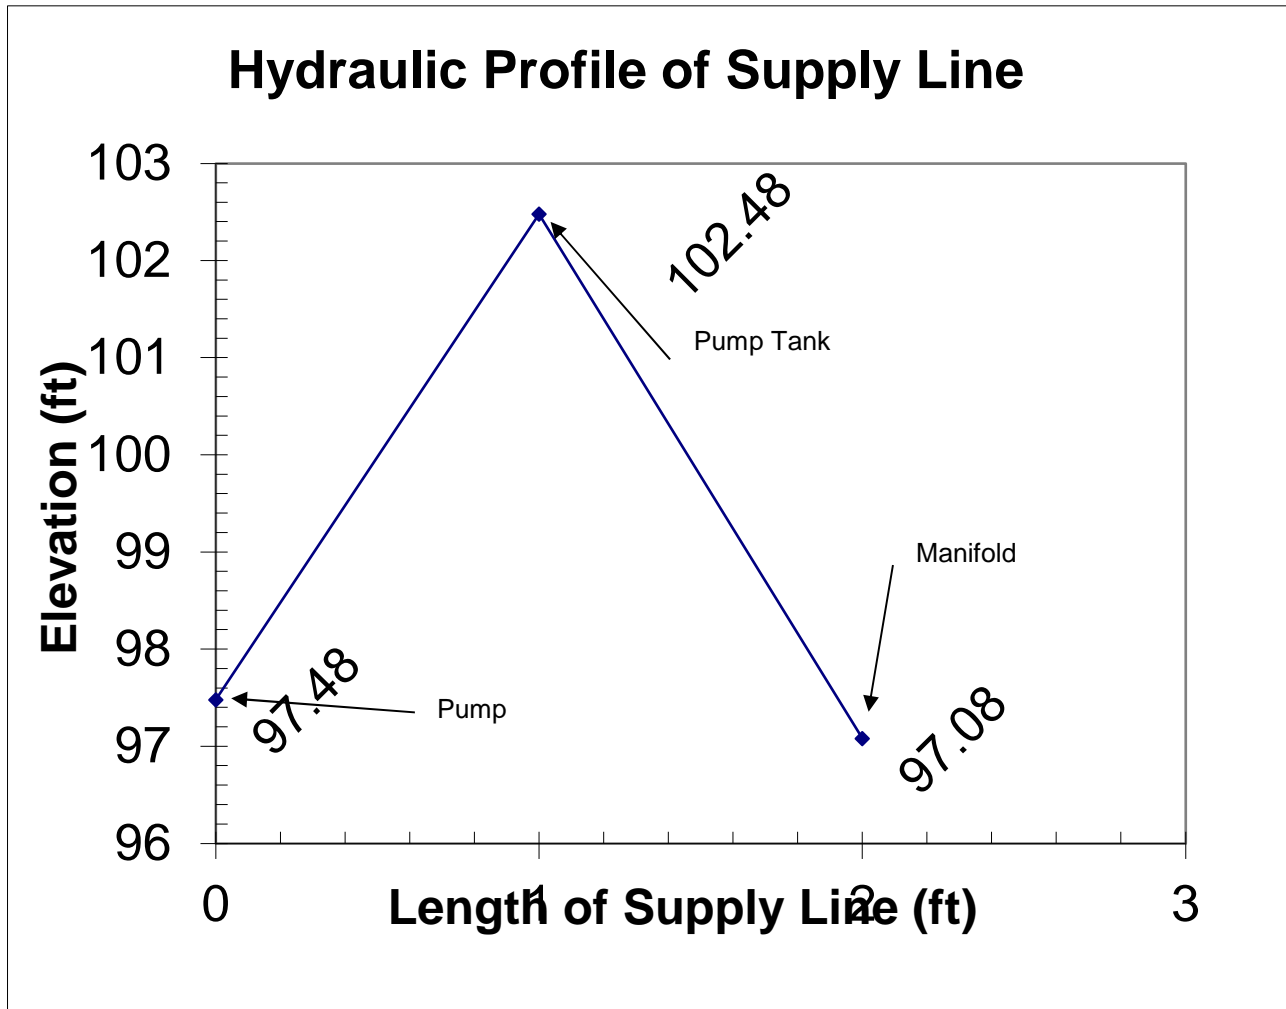


	Distance	Elevation
Pump Elevation	0	97.48
Pump Tank Elevation	1	102.48
Top Drainline	2	97.08

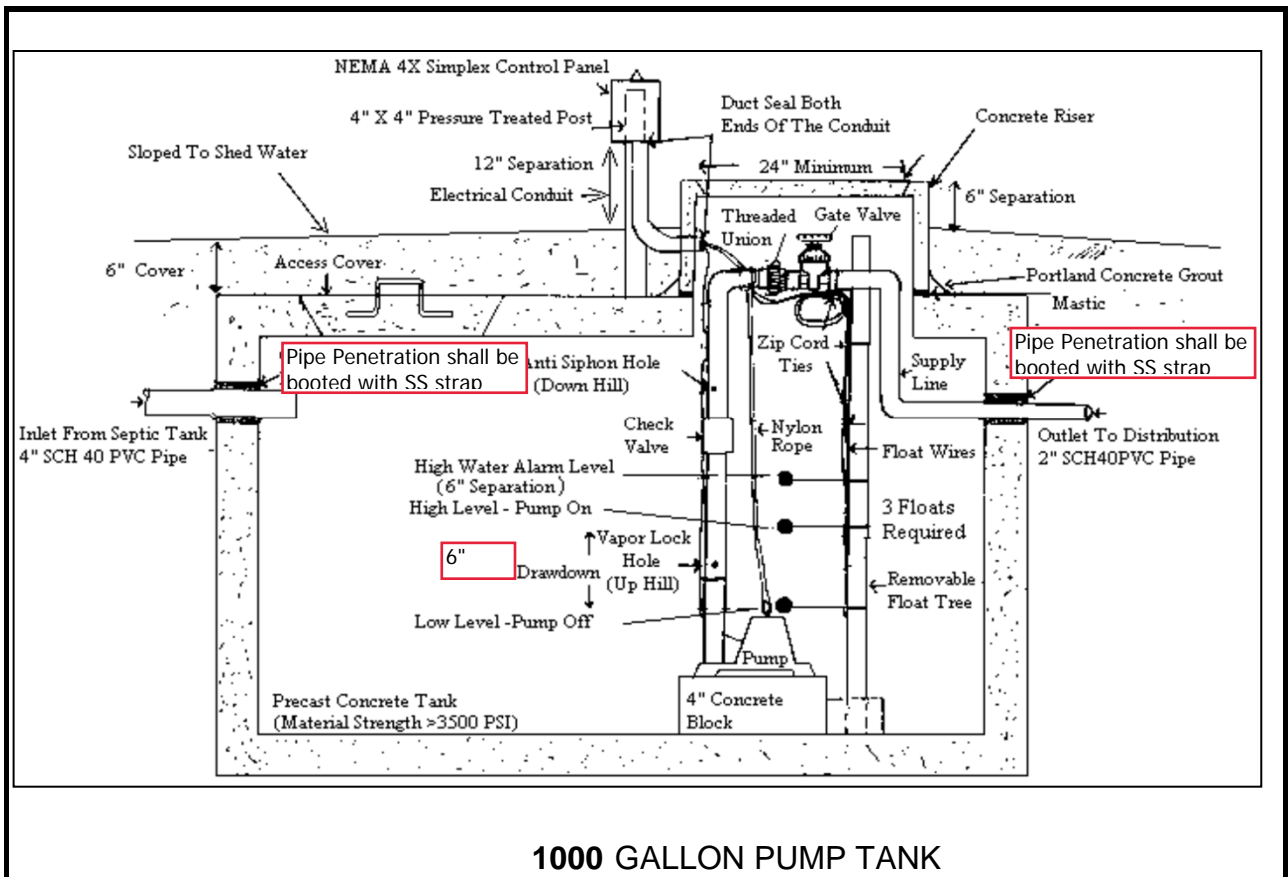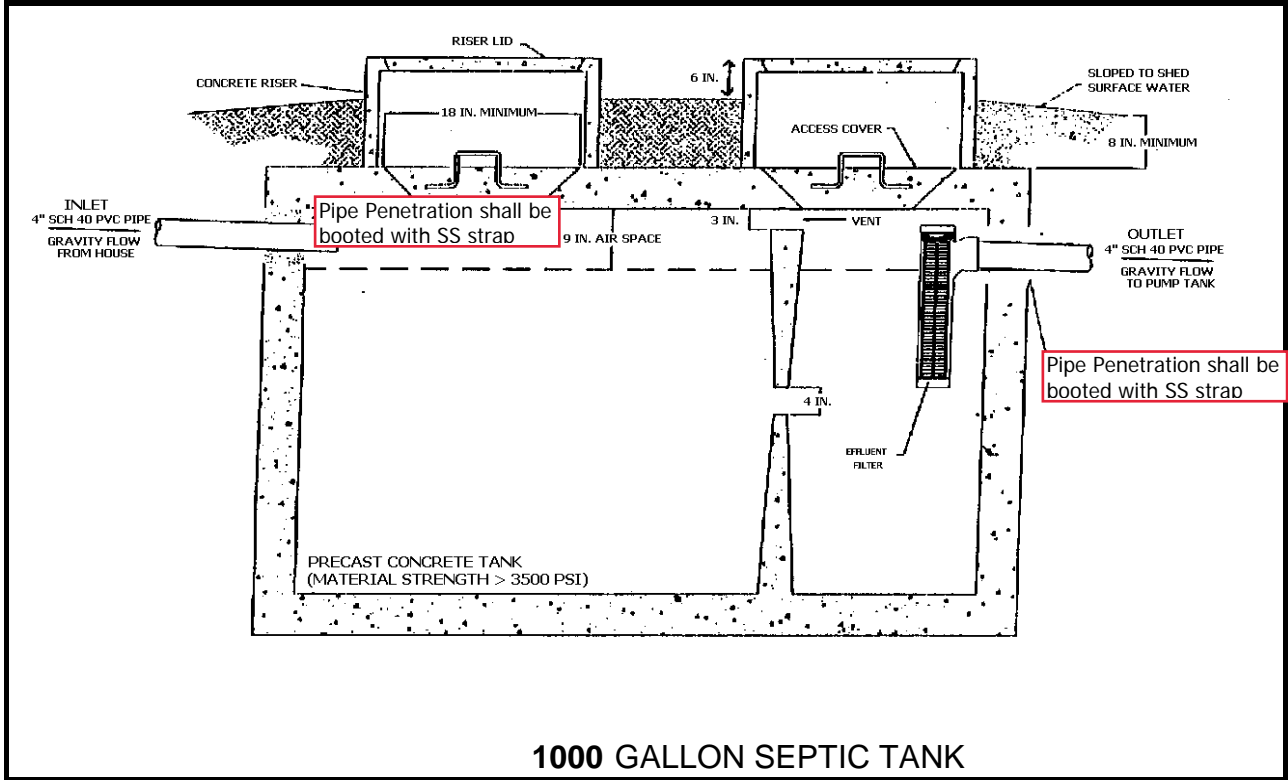

MODEL 112 Control Panel

Single phase, simplex motor contactor control.


The Model 112 control panel provides a reliable means of controlling one 120, 208, or 240 VAC single-phase pump in pump chambers, sump pump basins, irrigation systems and lift stations. Two control switches activate a magnetic motor contactor to turn the pump on and off. If an alarm condition occurs, an additional alarm switch activates the audio/visual alarm system.

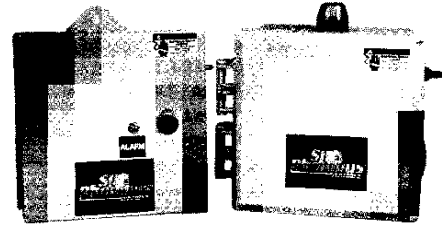

indoor

indoor/outdoor

Model Shown
1121W914X

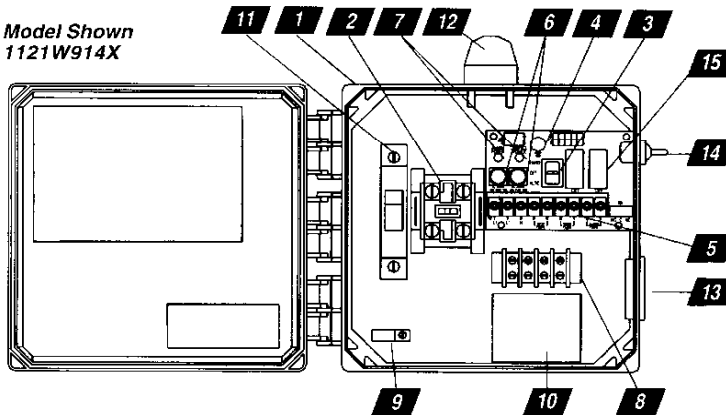

1. **Enclosure** measures 8 x 8 x 4 inches (20.32 X 20.32 X 10.16 cm). Choice of NEMA 1 (steel for indoor use), or NEMA 4X (ultraviolet stabilized thermoplastic with removable flanges for outdoor or indoor use).
* Options selected may increase enclosure size and change component layout.
2. **Magnetic Motor Contactor** controls pump by switching hot electrical lines.
3. **HOA Switch** for manual pump control (mounted on circuit board).
4. **Green Pump Run Indicator Light** (mounted on circuit board).
5. **Float Switch Terminal Block** (mounted on circuit board).
6. **Alarm and Control Fuses** (mounted on circuit board).
7. **Alarm and Control Power Indicators** (mounted on circuit board).
8. **Pump Input Power and Pump Connection Terminal Block**
9. **Ground Lug**
10. **Terminal Block Installation Label**
- ★ 11. **Circuit Breaker** (optional) provides pump disconnect and branch circuit protection. required (2X)

STANDARD ALARM PACKAGE (other options available)

12. **Red Alarm Beacon** provides 360° visual check of alarm condition.
Note: NEMA 1 style utilizes a door mounted indicator in lieu of a beacon.
13. **Alarm Horn** provides audio warning of alarm condition (83 to 85 decibel rating).
Note: NEMA 1 style utilizes an internally mounted buzzer (83 to 85 decibel) in lieu of horn.
14. **Exterior Horn Test/Normal/Silence Switch** allows alarm horn to be silenced and testing of horn and light to ensure proper operation of alarm system.
15. **Horn Silence Relay** automatically resets alarm after alarm condition has been resolved (mounted on circuit board).


FEATURES

- Entire control system (panel and switches) is UL Listed to meet and/or exceed industry safety standards
- Dual safety certification for the United States and Canada
- Standard package includes three 20' Sensor Float® control switches
- Complete with step-by-step installation instructions
- Three-year limited warranty



SJE-Rhombus CONTROLS
SJE ELECTRO SYSTEMS, INC.


PO Box 1708, Detroit Lakes, MN 56502
1-888-DIAL-SJE • 1-218-847-1317
1-218-847-4617 Fax
email: sje@sjerhombus.com
www.sjerhombus.com

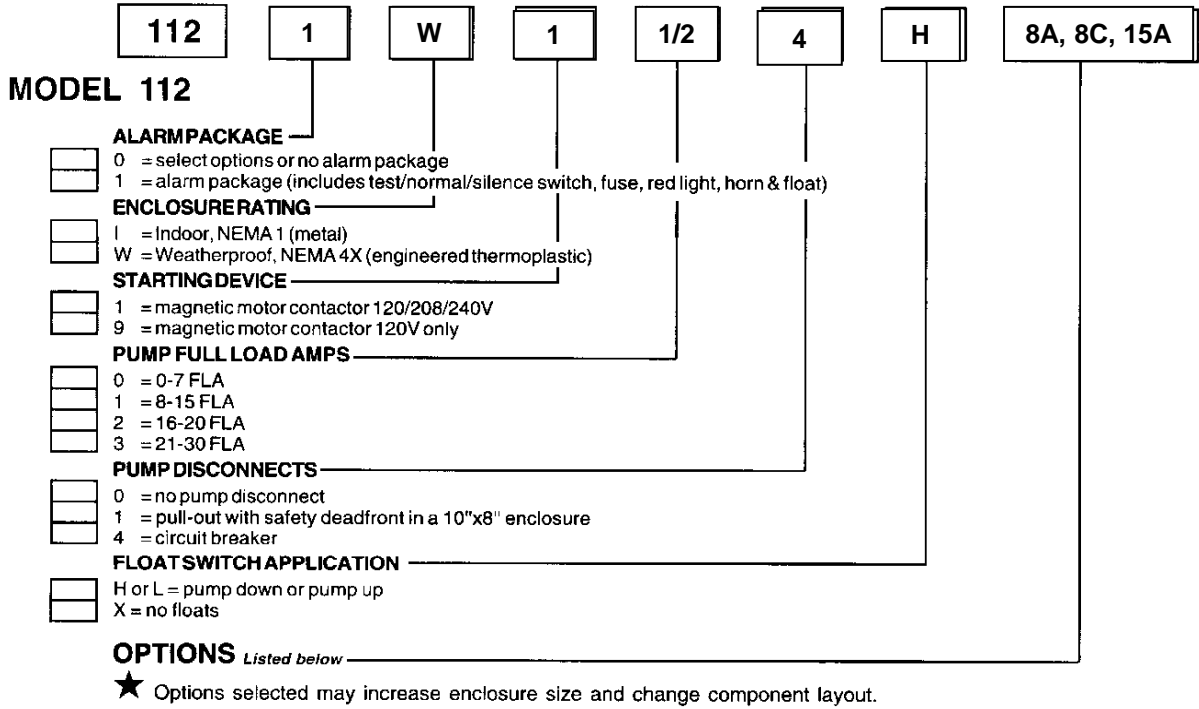

If additional features are required, call the factory for a quote on either a Pro-Line or Engineered Custom control panel system.

CODE	DESCRIPTION	CODE	DESCRIPTION
<input type="checkbox"/>	1A Red beacon only / no audio <i>must select 1E if floats included</i>	<input type="checkbox"/>	11C NEMA 1 alarm panel <i>must select option 6A</i>
<input type="checkbox"/>	1C Horn only / no visual <i>must select 1E if floats included</i>	<input type="checkbox"/>	11D NEMA 4X alarm panel <i>must select option 6A</i>
<input type="checkbox"/>	1E Alarm float	<input type="checkbox"/>	15A Control / alarm circuit breaker <i>Does not include the circuit board as in standard.</i>
<input type="checkbox"/>	3A Alarm flasher	<input type="checkbox"/>	16A 10' cord in lieu of 20'
<input type="checkbox"/>	★ 4A Low level cutout <i>select option 4D if floats included</i>	<input type="checkbox"/>	16B 15' cord in lieu of 20'
<input type="checkbox"/>	★ 4B Red low-level indicator & alarm <i>must select 4A also</i>	<input type="checkbox"/>	16C 30' cord in lieu of 20'
<input type="checkbox"/>	4D Low-level float	<input type="checkbox"/>	16D 40' cord in lieu of 20'
<input type="checkbox"/>	6A Auxiliary alarm contact, form C type	<input type="checkbox"/>	17A SJE SignalMaster® / mounting strap ●
<input type="checkbox"/>	★ 8A Elapsed time meter	<input type="checkbox"/>	17B SJE SignalMaster® / externally weighted ●
<input type="checkbox"/>	★ 8C Event (cycle) counter	<input type="checkbox"/>	17C Sensor Float® / internally weighted ▲
<input type="checkbox"/>	10E Lockable latch - NEMA 4X	<input type="checkbox"/>	17D Sensor Float® / externally weighted ▲
<input type="checkbox"/>	10E Lockable latch - NEMA 1	<input type="checkbox"/>	17E Sensor Float® Mini / pipe clamp ▲
<input type="checkbox"/>	★ 10F Lightning arrester	<input type="checkbox"/>	17F Sensor Float® Mini / externally weighted ▲
<input type="checkbox"/>	★ 10K Anti-condensation heater	<input type="checkbox"/>	19X Door mounted pump run indicator
		<input type="checkbox"/>	21A Pumpmaster® in lieu of on/off switches ●
		<input type="checkbox"/>	21B PumpMaster® Plus in lieu of on/off switches ●
		<input type="checkbox"/>	21C Super Single® in lieu of on/off switches ▲
		<input type="checkbox"/>	21D Double Float™ in lieu of on/off switches ▲



● Mechanically-activated ▲ Mercury-activated

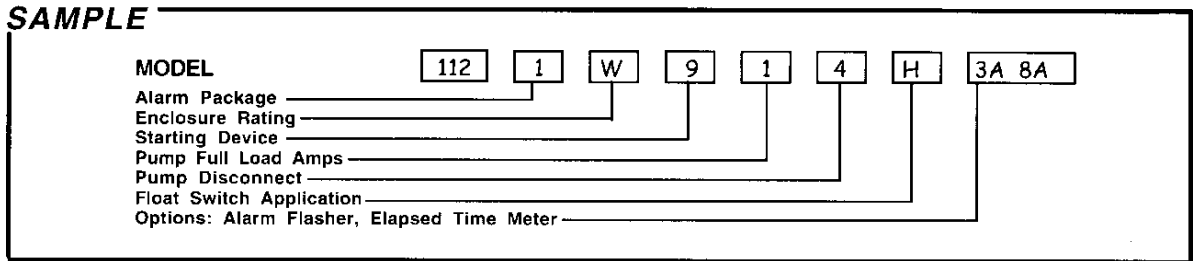


Pump Specification

FL30-Series

1/3 HP Submersible Effluent Pumps

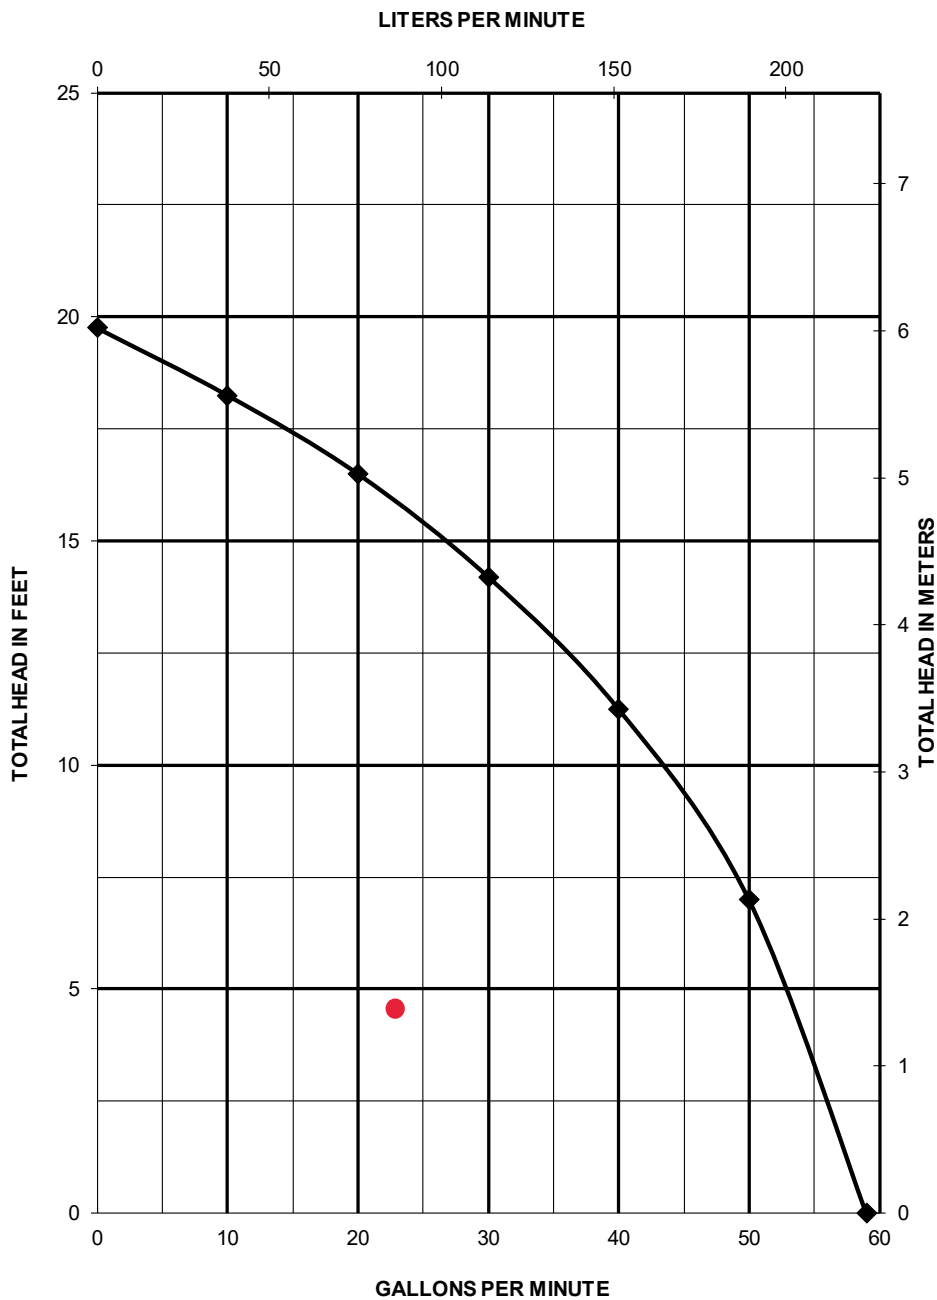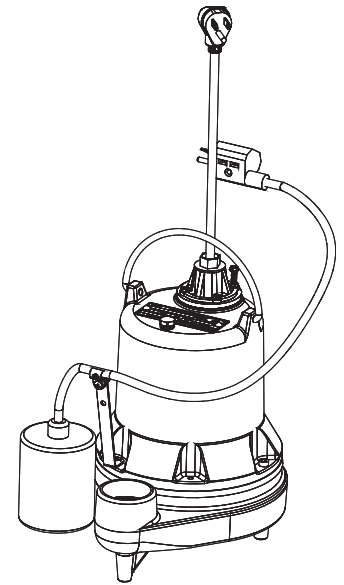

FL30-Series Dimensional Data

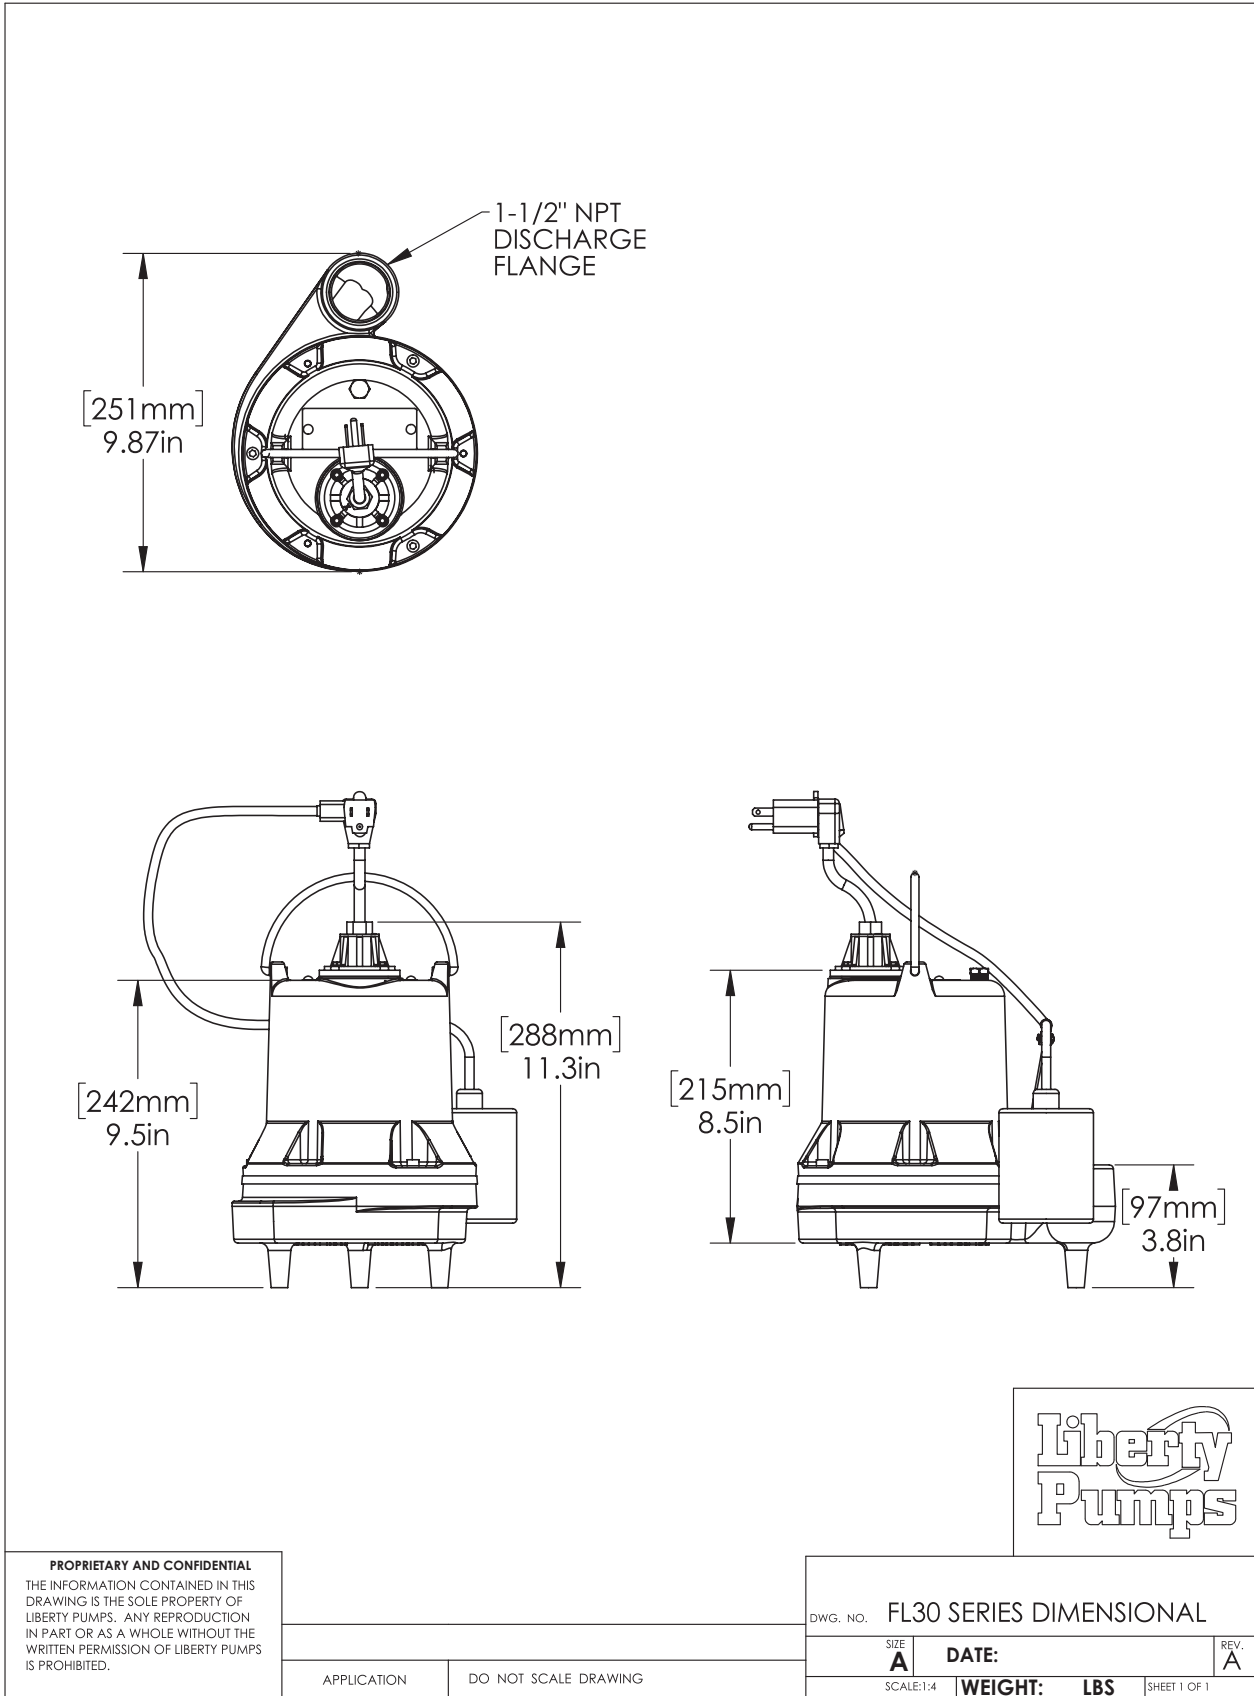

FL30-Series Electrical Data

MODEL	HP	VOLTAGE	PHASE	FULL LOAD AMPS	LOCKED ROTOR AMPS	THERMAL OVERLOAD TEMP	STATOR WINDING CLASS	CORD LENGTH	PUMP DISCHARGE	AUTOMATIC
FL31A	1/3	115	1	10.5	26	105°C / 221°F	B	10'	1-1/2" NPT	YES
FL31A-2	1/3	115	1	10.5	26	105°C / 221°F	B	25'	1-1/2" NPT	YES
FL31A-3	1/3	115	1	10.5	26	105°C / 221°F	B	35'	1-1/2" NPT	YES
FL31M	1/3	115	1	10.5	26	105°C / 221°F	B	10'	1-1/2" NPT	NO
FL31M-2	1/3	115	1	10.5	26	105°C / 221°F	B	25'	1-1/2" NPT	NO
FL31M-3	1/3	115	1	10.5	26	105°C / 221°F	B	35'	1-1/2" NPT	NO
FL31M-5	1/3	115	1	10.5	26	105°C / 221°F	B	50'	1-1/2" NPT	NO
FL32A	1/3	208-230	1	5.5	12	105°C / 221°F	B	10'	1-1/2" NPT	YES
FL32A-2	1/3	208-230	1	5.5	12	105°C / 221°F	B	25'	1-1/2" NPT	YES
FL32A-3	1/3	208-230	1	5.5	12	105°C / 221°F	B	35'	1-1/2" NPT	YES
FL32M	1/3	208-230	1	5.5	12	105°C / 221°F	B	10'	1-1/2" NPT	NO
FL32M-2	1/3	208-230	1	5.5	12	105°C / 221°F	B	25'	1-1/2" NPT	NO
FL32M-3	1/3	208-230	1	5.5	12	105°C / 221°F	B	35'	1-1/2" NPT	NO
FL32M-5	1/3	208-230	1	5.5	12	105°C / 221°F	B	50'	1-1/2" NPT	NO

FL30-Series Technical Data

IMPELLER	MULTI-VANE ENGINEERED POLYMER
PAINT	POWDER COATING
MAX LIQUID TEMP	60°C / 140°F
MAX STATOR TEMP (1-PHASE)	130°C / 250°F
THERMAL OVERLOAD	105°C / 221°F
POWER CORD TYPE	SJTW
MOTOR HOUSING	CLASS 25 CAST IRON
VOLUTE	CLASS 25 CAST IRON
SHAFT	STAINLESS
HARDWARE	STAINLESS
O-RINGS	BUNA-N
MECHANICAL SEAL	UNITIZED CERAMIC CARBON
WEIGHT	37 LBS / 16.8 KG

FL30-Series Specifications

1.01 GENERAL

The contractor shall provide labor, material, equipment, and incidentals required to provide _____ (QTY) centrifugal pumps as specified herein. The pump models covered in this specification are FL30-Series single-phase pumps. The pump furnished for this application shall be model _____ as manufactured by Liberty Pumps.

2.01 OPERATING CONDITIONS


Each submersible pump shall be rated at 1/3 hp, _____ volts, single-phase, 60 Hz, 1725 RPM. The unit shall produce _____ GPM at _____ feet of total dynamic head.

The submersible pump shall be capable of handling effluent with 3/4" solids handling capability. The submersible pump shall have a shut-off head of 19.8 feet and a maximum flow of 58 GPM @ 5 feet of total dynamic head.

The pump shall be controlled with:

- _____ Piggyback style ON/OFF float switch
- _____ NEMA 4X outdoor simplex control panel with three float switches and a high water alarm
- _____ NEMA 1 indoor simplex control panel with three float switches and a high water alarm
- _____ NEMA 4X outdoor simplex control panel with four float switches and a high water alarm
- _____ NEMA 1 indoor simplex control panel with four float switches and a high water alarm
- _____ NEMA 4X outdoor duplex control panel with three float switches and a high water alarm
- _____ NEMA 1 indoor duplex control panel with three float switches and a high water alarm
- _____ NEMA 4X outdoor duplex control panel with four float switches and a high water alarm
- _____ NEMA 1 indoor duplex control panel with four float switches and a high water alarm

3.01 CONSTRUCTION

Each centrifugal effluent pump shall be equal to the  certified FL30-Series pumps as manufactured by Liberty Pumps, Bergen NY. The castings shall be constructed of class 25 cast iron. The motor housing shall be oil filled to dissipate heat. Air filled motors shall not be considered equal since they do not properly dissipate heat from the motor. All mating parts shall be machined and sealed with a Buna-N O-ring. All fasteners exposed to the liquid shall be stainless steel. The motor shall be protected on the top side with sealed cord entry plate with molded pins to conduct electricity, eliminating the ability of water to enter internally through the cord. The motor shall be protected on the lower side with a unitized ceramic/carbon seal with stainless steel housings and spring. The pump shall be furnished with stainless steel handle.

4.01 ELECTRICAL POWER CORD

The submersible pump shall be supplied with 10, 25, 35, or 50 feet of multiconductor power cord. It shall be cord type SJTW, capable of continued exposure to the pumped liquid. The power cord shall be sized for the rated full load amps of the pump in accordance with the National Electric Code. The power cable shall not enter the motor housing directly but will conduct electricity to the motor by means of a watertight compression fitting cord plate assembly, with molded pins to conduct electricity. This will eliminate the ability of water to enter internally through the cord by means of a damaged or wicking cord.

5.01 MOTORS

Single-phase motors shall be oil filled, permanent split capacitor, class B insulated NEMA B design, rated for continuous duty. Since air filled motors are not capable of dissipating heat as effectively, they shall not be considered equal. At maximum load, the winding temperature shall not exceed 130°C un submerged. The pump motor shall have an integral thermal overload switch in the windings for protecting the motor. The capacitor circuit shall be mounted internally in the pump.

6.01 BEARINGS AND SHAFT

Upper and lower ball bearings shall be required. The bearings shall be a single ball/race type bearing. Both bearings shall be permanently lubricated by the oil that fills the motor housing. The motor shaft shall be made of 300 or 400 series stainless steel and have a minimum diameter of 0.500".

7.01 SEALS

The pump shall have a unitized carbon/ceramic seal with stainless steel housings and spring equal to Crane Type 6a. The motor plate/housing interface shall be sealed with a Buna-N O-ring.

8.01 IMPELLER

The impeller shall be engineered polymer, with pump out vanes on the back shroud to keep debris away from the seal area. It shall be threaded to the motor shaft.

9.01 CONTROLS

All units can be supplied with CSA and UL approved automatic wide angle tilt float switches. The switches shall be equipped with piggyback style plug that allows the pump to be operated manually without the removal of the pump in the event that a switch becomes inoperable. Manual pumps are operable by means of a pump control panel.

10.01 PAINT

The exterior of the casting shall be protected with powder coat paint.

11.01 SUPPORT

The pump shall have cast iron support legs, enabling it to be a freestanding unit. The legs will be high enough to allow 3/4" solids to enter the volute.

12.01 SERVICEABILITY

Components required for the repair of the pump shall be shipped within a period of 24 hours.

13.01 FACTORY ASSEMBLED TANK SYSTEMS WITH GUIDE RAIL AND QUICK DISCONNECT DISCHARGE

- Factory mounted guide rail system with pump suspended by means of bolt-on quick disconnect that is sealed by means of nitrile grommets or O-rings. The discharge piping shall be schedule 80 PVC and furnished with a PVC check valve and shut-off ball valve. The tank shall be wound fiberglass or roto-molded plastic. An inlet hub shall be provided with the fiberglass systems.
- Stainless steel guide rail
- Zinc plated steel guide rail
- " diameter of basin
- " height of basin
- " distance from top of tank to discharge pipe outlet
- Fiberglass cover
- Structural foam polymer cover
- Steel cover
- Simplex system with outdoor panel and alarm
- Duplex system with outdoor panel and alarm
- Separate outdoor alarm
- Remote outdoor alarm

14.01 TESTING

The pump shall have a ground continuity check and the motor chamber shall be hi-potted to test for electrical integrity, moisture content, and insulation defects. The motor and volute housing shall be pressurized, and an air leak decay test performed to ensure integrity of the motor housing. The pump shall be run, voltage current monitored, and checked for noise or other malfunction.

15.01 QUALITY CONTROL

The pump shall be manufactured in an ISO 9001 certified facility.

16.01 WARRANTY

Standard limited warranty shall be 3 years.