

Harnett County Department of Public Health 17532 V5421 N

PERMIT # EH 2206-0004

Operation Permit

New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: Hwy 421

Name: (owner) Jeremy + Rebecca Thomas SUBDIVISION _____ LOT # _____

System Installer: CDX Septic

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: 25% Reduc Flow System Type #6 Chd Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

QUICKY

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

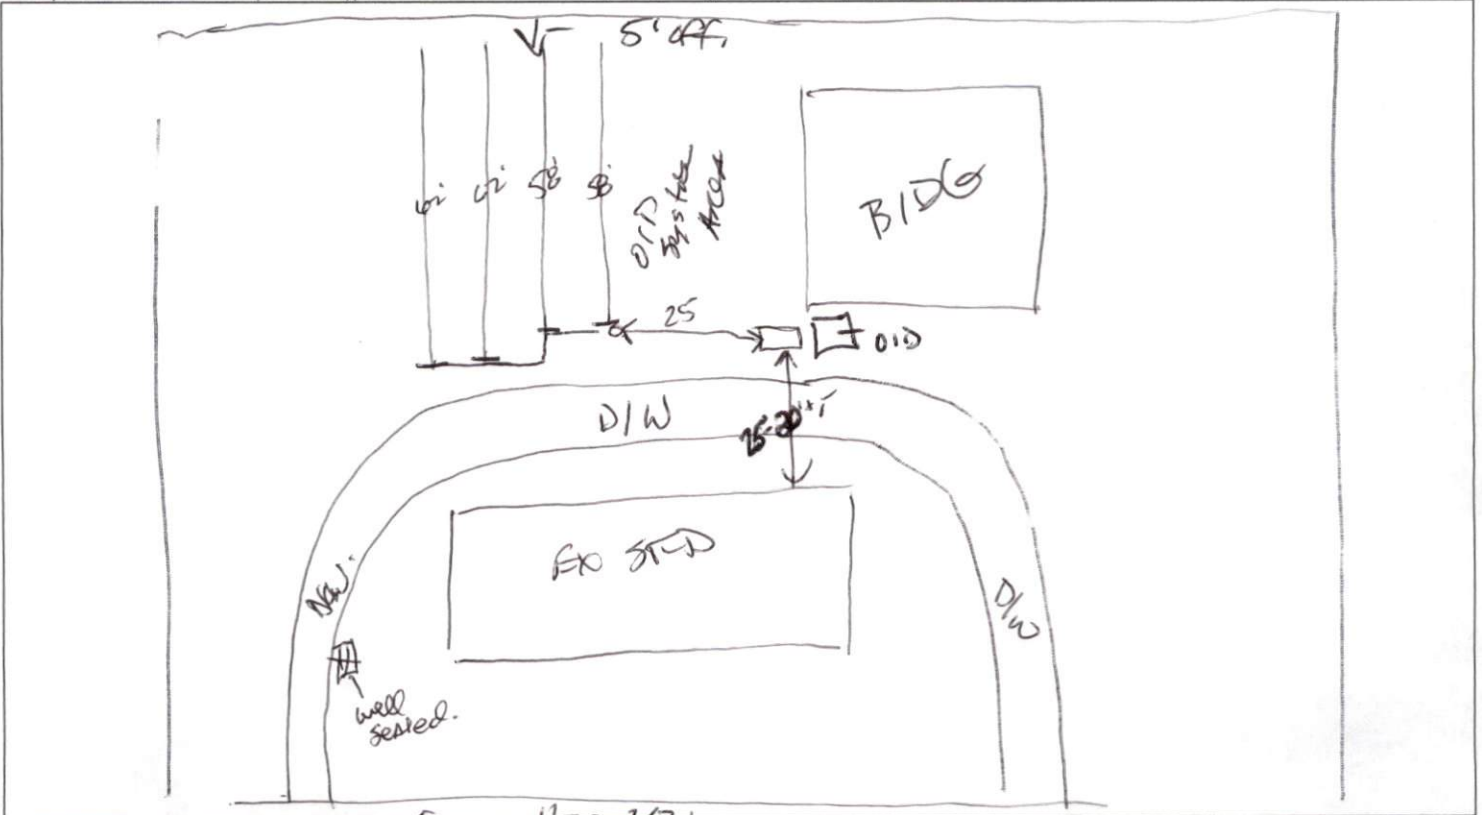

PERMIT CONDITIONS: Sanford Hwy 421 → Beone Thaid

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

_____ D-Box
 _____ Pump
 _____ Alarm
 _____ H2O Line
 _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Red Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 4 of each ditch 60' feet ditches 3 feet ditches 22 inches

French Drain Required: _____ Linear feet

Authorized State Agent: Jane S. Markham Date: 8-9-22