

# Harnett County Department of Public Health

PERMIT # EH2302-0013

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 201 TIRZAH DR

Name: (owner) KARL CROSS      SUBDIVISION TIRZAH VILLAGE      LOT # 6

System Installer: EASTERN SERVIC


Basement with plumbing:     Garage     Number of Bedrooms 3

Type of Water Supply:  Community     Public     Well    Distance from well \_\_\_\_\_ feet

System Type: IIIg      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

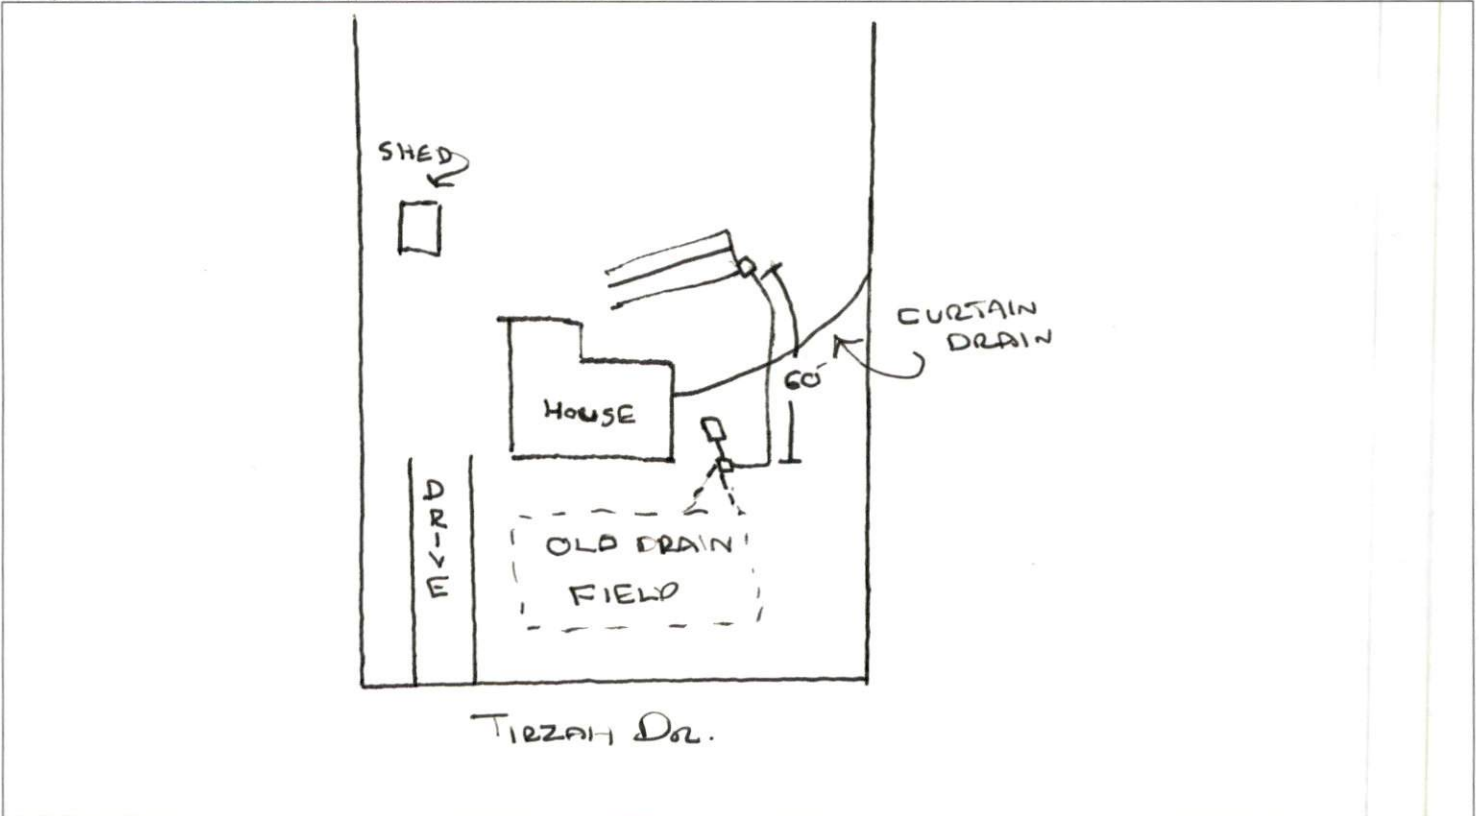

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: 50' CURTAIN DRAIN

V. Other: SPEED LEVELS TURNED UP TO OLD FIELD

\_\_\_\_\_ D-Box     \_\_\_\_\_ Pump     \_\_\_\_\_ Alarm     \_\_\_\_\_ H2O Line     \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other CHAMBER (04)    Septic Tank: EXISTING gallons    Pump Tank: \_\_\_\_\_ gallons

Subsurface      No. of      exact length      width of      depth of  
 Drainage Field      ditches 3      of each ditch 60 feet      ditches 3 feet      ditches 18-24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 3/23/23