

Harnett County Department of Public Health

PERMIT # EH2303-0010

Operation Permit

MW

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 2082 Arrowhead Rd (Gr 1780)

Name: (owner) Teresa Jones SUBDIVISION _____ LOT # _____

System Installer: Bochia Mercer

Basement with plumbing: Garage Number of Bedrooms 1200 GPD


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

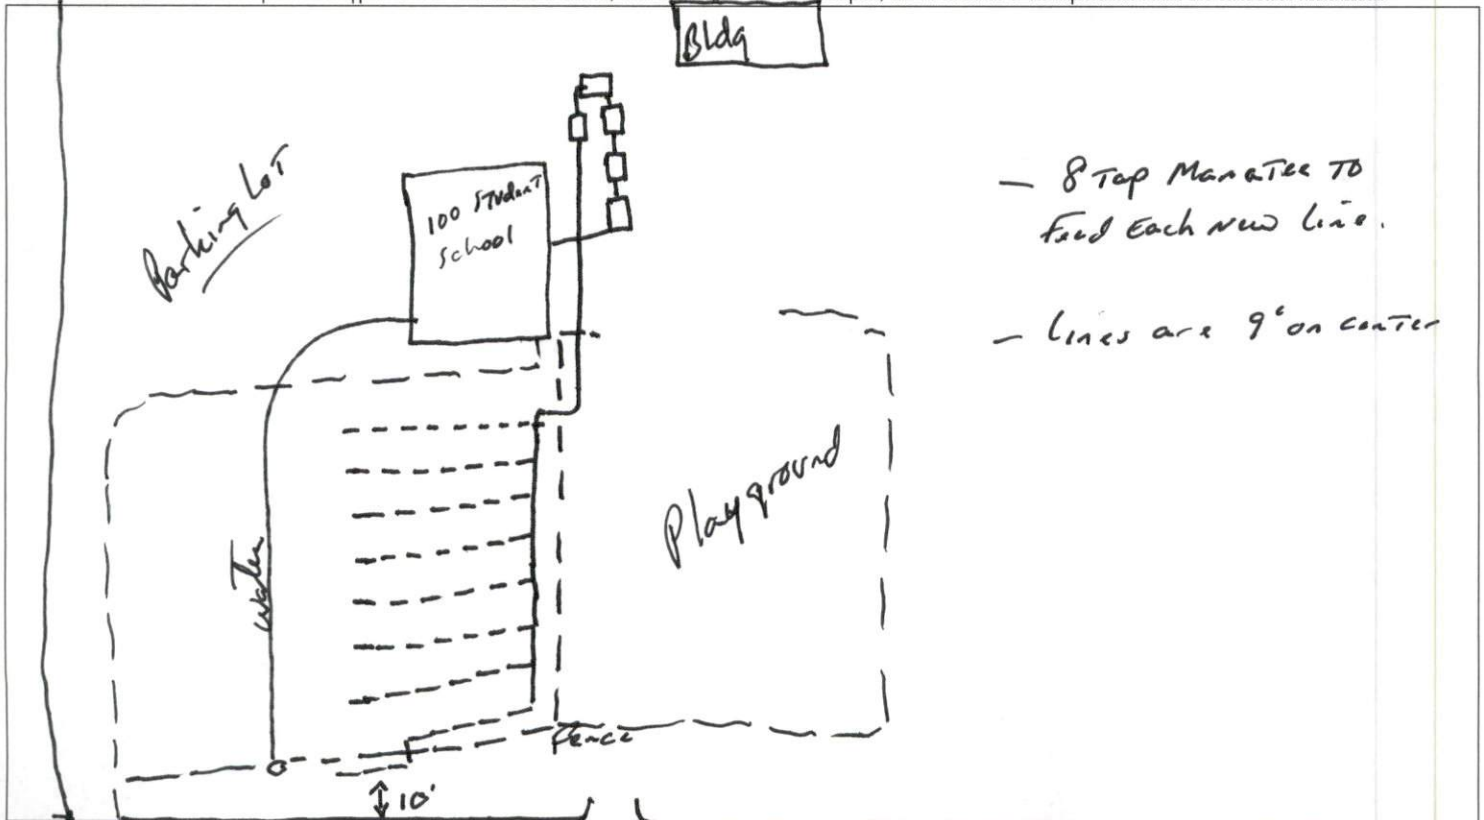

- 8 Top Manatee to Feed Each new line.
- Lines are 9' on center

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property. *-3000 GAL EXISTING*

Type of system: Conventional Other 25% reduction I/Q4 Septic Tank: +1000 gallons Pump Tank: +2000 gallons

Subsurface Drainage Field No. of ditches 8 exact length of each ditch 94 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 8-11-23