

EH 2306-0012

**SOIL/SITE EVALUATION  
 for ON-SITE WASTEWATER SYSTEM**

Owner:

Applicant: *Wilton Angloff*

*Wilton Angloff*  
~~Wilton Angloff~~

Address:

Date Evaluated: 7-18-23

Proposed Facility: *SFD*

Design Flow (.1949): *600*

Location of Site:

Property Recorded:

Water Supply:

Public  Individual  Well *ST*

Evaluation Method:  Auger Boring

Pit  Cut

Type of Wastewater:

Sewage  Industrial Process  Spring  Other  Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	<i>L 2-3%</i>	0-14	<i>SL</i>	<i>fm GRNSWP</i>	<i>Water in Hole</i>				
		14-40	<i>SLom</i>	<i>fm SBKSP</i>	<i>36-38</i> <i>7.5% 21</i>	<i>40"</i>	<i>-</i>	<i>-</i>	<i>.35</i>
2	<i>L 2-3%</i>	0-20	<i>SL</i>	<i>fm GRNSWP</i>	<i>Water in Hole</i>				
		20-48	<i>SL</i>	<i>fm SBKSP</i>	<i>40-42"</i> <i>7.5% Li</i>				<i>.35-.4</i>

Description	Initial System <input checked="" type="checkbox"/>	Repair System <input checked="" type="checkbox"/>	Other Factors (.1946):
Available Space (.1945)			Site Classification (.1948): <i>PS</i>
System Type(s)	<i>com</i>		Evaluated By: <i>JR IRL</i>
Site LTAR	<i>.3-.35</i>	<i>.35-.4</i>	Others Present:


COMMENTS: \_\_\_\_\_

LANDSCAPE POSITIONS	GROUP	TEXTURES	.1955 LTAR	CONSISTENCE MOIST	WET
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE	NS-NON-STICKY SS-SLIGHTLY STICKY
S-SHOULDER SLOPE L-LINEAR SLOPE		LS-LOAMY SAND			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY
N-NOSE SLOPE H-HEAD SLOPE		L-LOAM			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6 - 0.3		P-PLASTIC VP-VERY PLASTIC
CV-CONVEX SLOPE		SIL-SILT LOAM			
T-TERRACE		CL-CLAY LOAM			
FP-FLOOD PLAN		SCL-SANDY CLAY LOAM			
	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

**STRUCTURE**  
 SG-SINGLE GRAIN  
 M-MASSIVE  
 CR-CRUMB  
 GR-GRANULAR  
 SBK-SUBANGULAR BLOCKY  
 ABK-ANGULAR BLOCKY  
 PL-PLATY  
 PR-PRISMATIC

**MINERALOGY**  
 SLIGHTLY EXPANSIVE  
 EXPANSIVE

Show profile locations and other site features (dimensions, references or benchmark, and North)

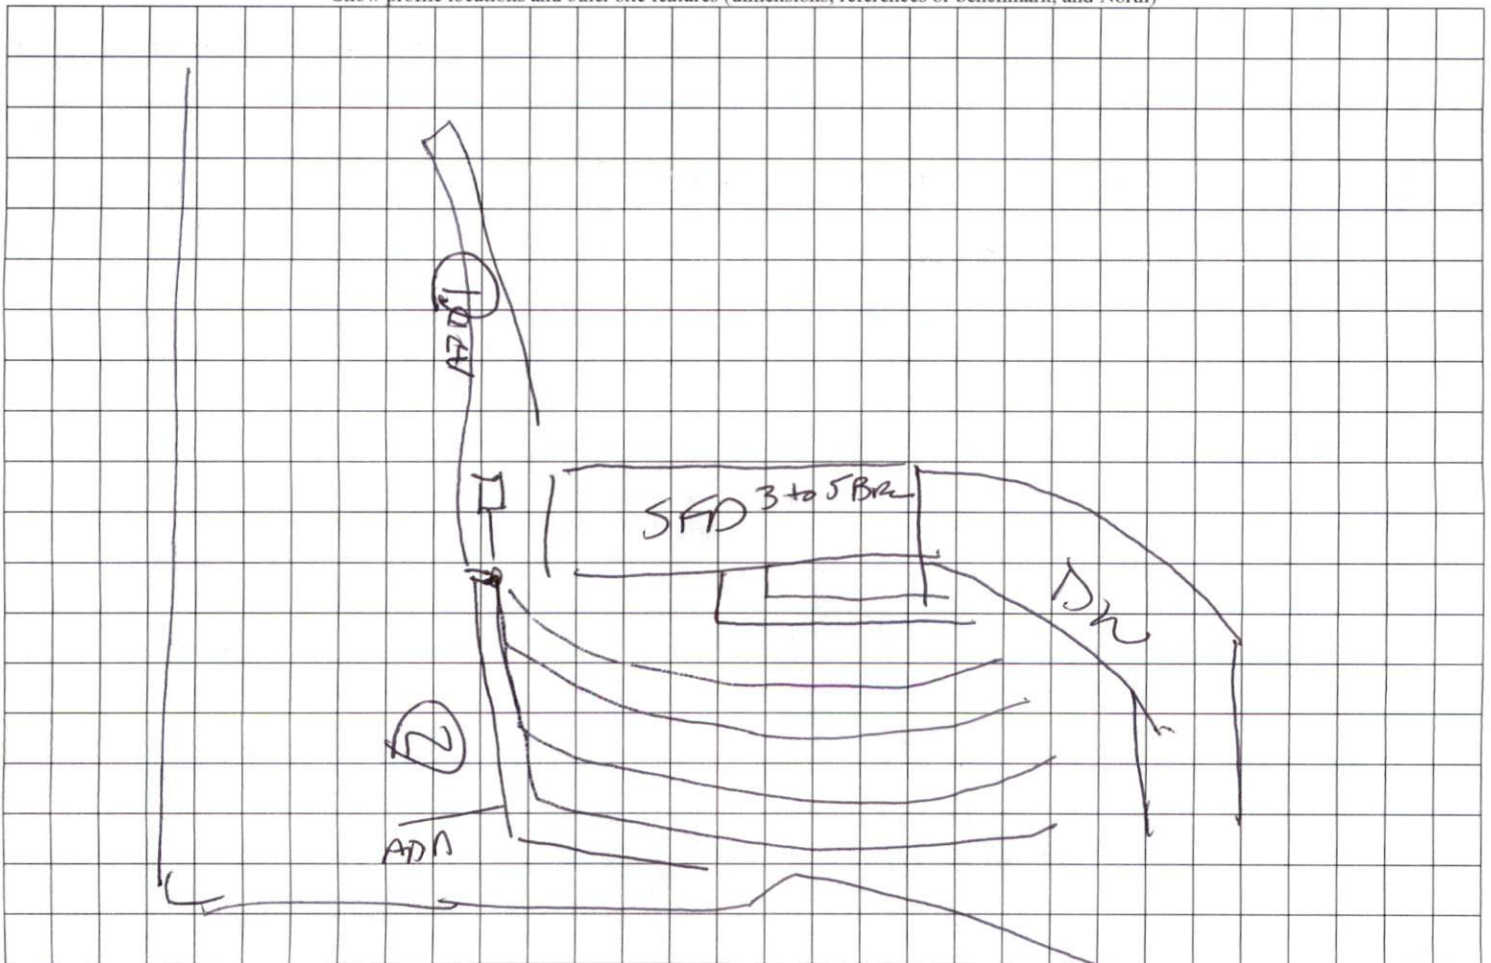

Camella

# CERTIFICATE OF COMPLETION / OPERATIONAL PERMIT

Name: (owner) Charles Lee Hicks  New Installation  Septic Tank  
 Property Location: SR# 1578  Repairs  Nitrification Line  
 Subdivision — Lot # A  
 TAX ID# — Quadrant # —  
 Contractor: Ted Brown Registration # —  
 Basement with Plumbing:  Garage:   
 Water Supply:  Well  Public  Community  
 Distance From Well: 50 min ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system:  Conventional  Other —  
 Size of tank: Septic Tank: 1000 gallons Pump Tank: — gallons  
 Subsurface Drainage Field No. of ditches 4 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18-22 in.  
 French Drain: — Linear feet

PERMIT NO. 09446

Date: 4/11/96  
 Inspected by: Peter A. Bule  
 Environmental Health Specialist

