

Harnett County Department of Public Health

PERMIT # EH2311-4500

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 521513 Needles Creek Rd

Name: (owner) C Mason Poi SUBDIVISION Willow Pond LOT # _____

System Installer: Eastern Septic # 40666


Basement with plumbing: Garage Number of Bedrooms 4 → 8 people max

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 2520 Reductor System Chamber Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

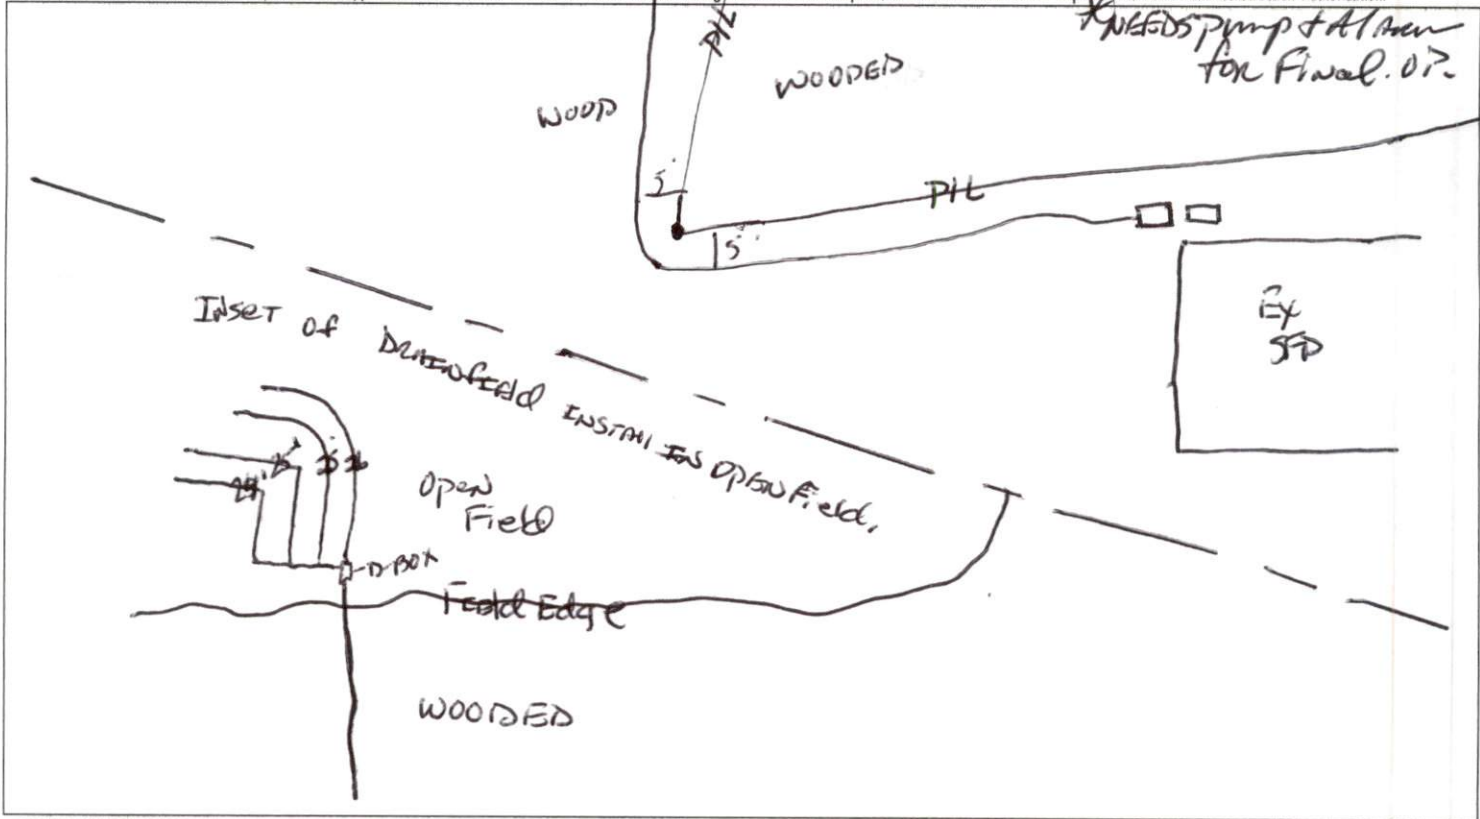

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2520 Reductor Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface No. of exact length 106 width of depth of
 Drainage Field ditches 4 of each ditch 102 feet ditches 3 feet ditches 16-18 inches
 French Drain Required: _____ Linear feet 2148

Authorized State Agent James E. Mansour Date 7-24-24