

# Harnett County Department of Public Health

PERMIT # EH 2406-0009

## Operation Permit

New Installation   
  Septic Tank   
  Nitrification Line   
  Repair   
  Expansion

PROPERTY LOCATION: 140 Ashley

Name: (owner) Stephanie Johansen      SUBDIVISION \_\_\_\_\_      LOT # \_\_\_\_\_

System Installer: Jason Mathews

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: Conventional pump to D-Box      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

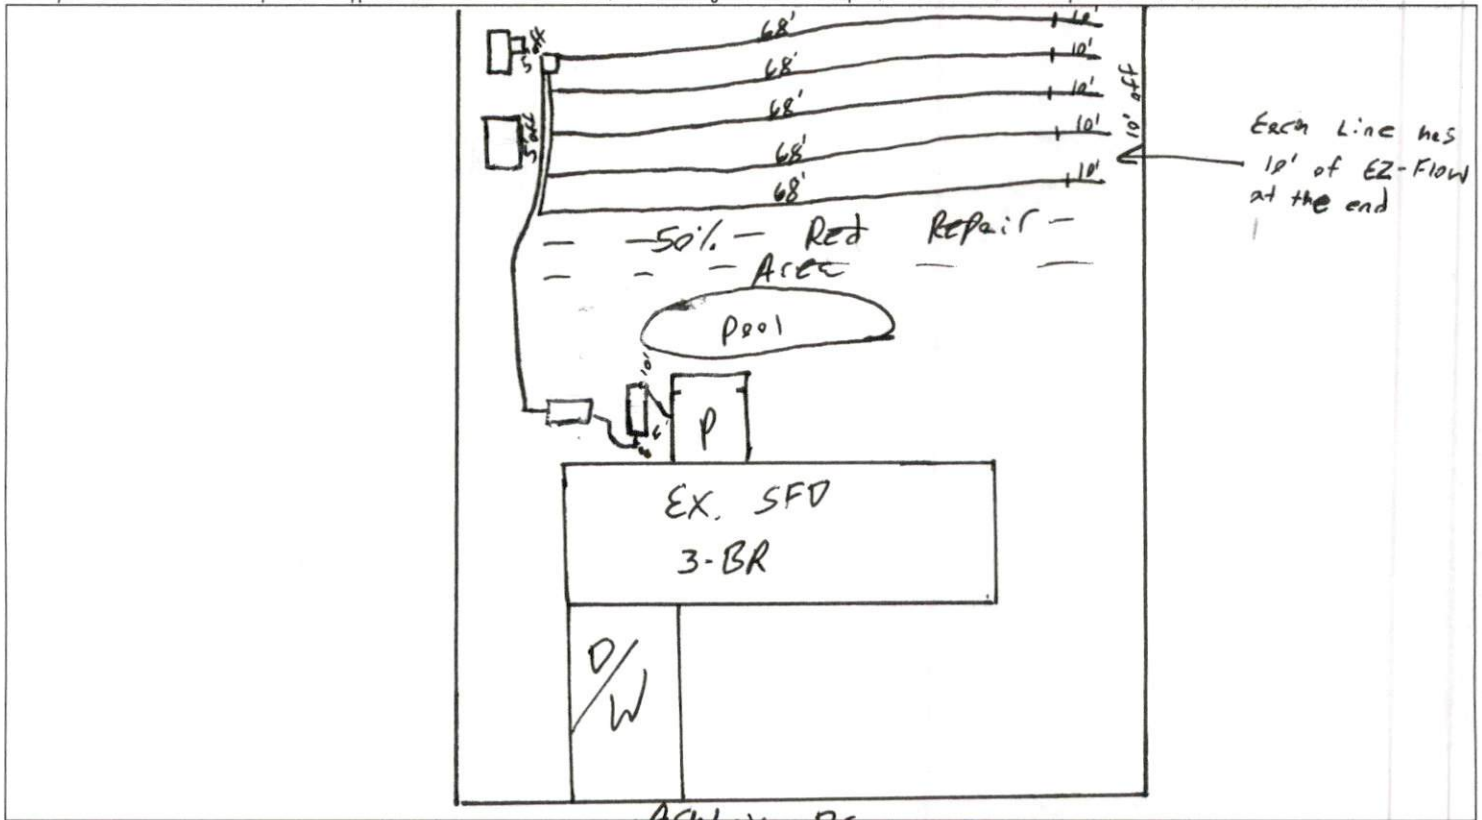

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box   
  Pump   
  Alarm   
  H2O Line   
  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other Conventional pump to D-Box    Septic Tank: 1,000 gallons    Pump Tank: EX. 1,000 gallons

Subsurface Drainage Field    No. of ditches 5    exact length of each ditch 78' feet    width of ditches 3' feet    depth of ditches 18"-20" inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 8-1-24