

# Harnett County Department of Public Health

PERMIT # EH 2504-0004

## Operation Permit

☐ New Installation ☐ Septic Tank ☒ Nitrification Line ☒ Repair ☐ Expansion

PROPERTY LOCATION: 993 Silas Moore Rd, Benson

Name: (owner) Shane MacDonald

SUBDIVISION

LOT # 18

System Installer: Eastern Septic

Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 3

Type of Water Supply: ☐ Community ☐ Public ☒ Well Distance from well \_\_\_\_\_ feet


System Type: EX. Conventional and New 25% Reduction Tanks Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

TYPE II(g)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

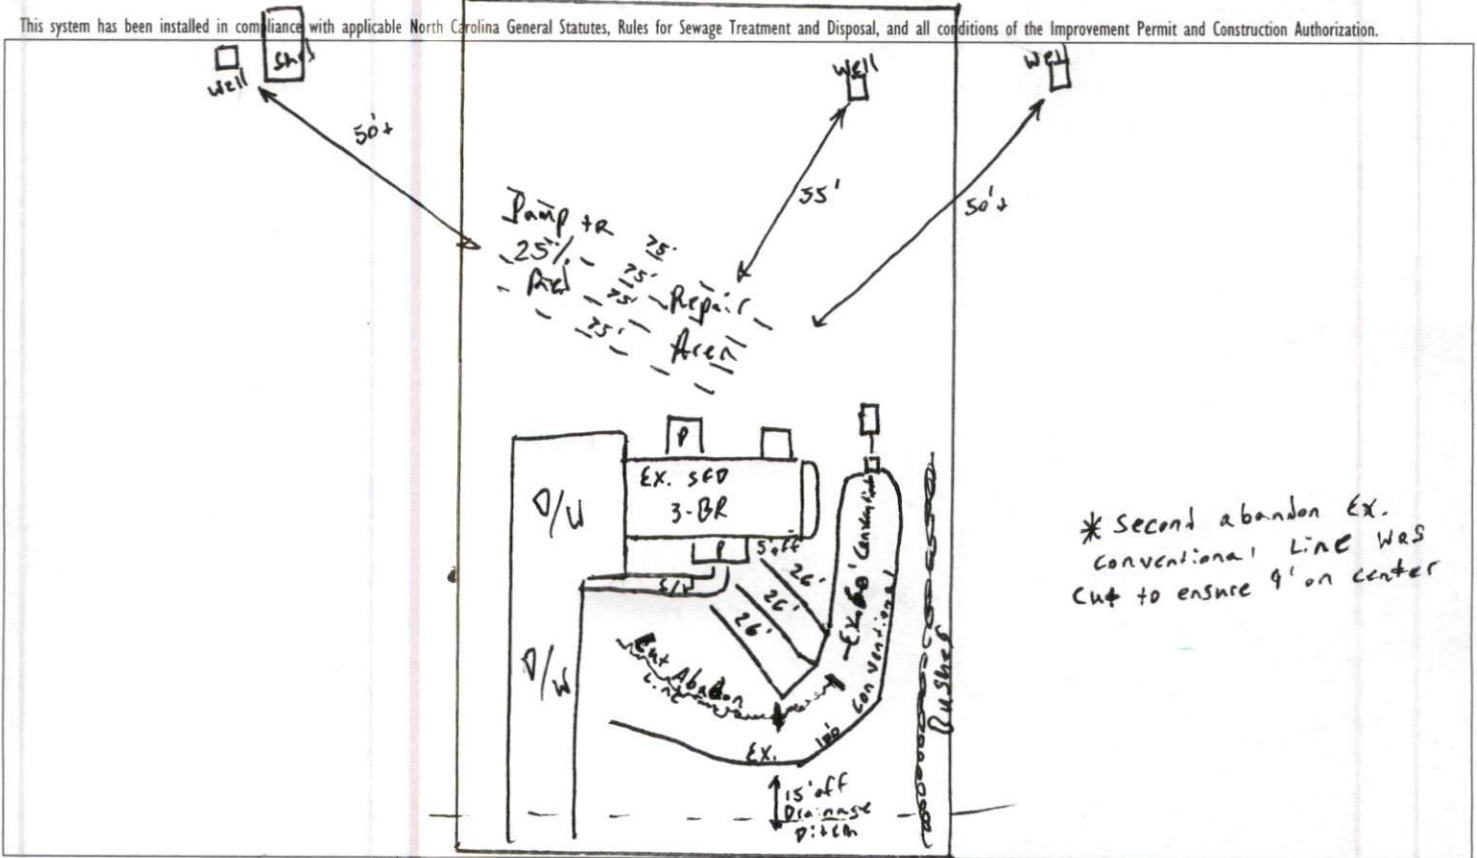

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☒ Conventional ☒ Other Replaced a 100' conventional line with 75' 25% chambers Septic Tank: EX. 1,000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of 2 ditches of each ditch 100' feet width of 3' ditches depth of 24-26" ditches \_\_\_\_\_ inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] RGHS

Date 6-11-25